


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 10/03/2025

Reserve Profile for 10-03-2025

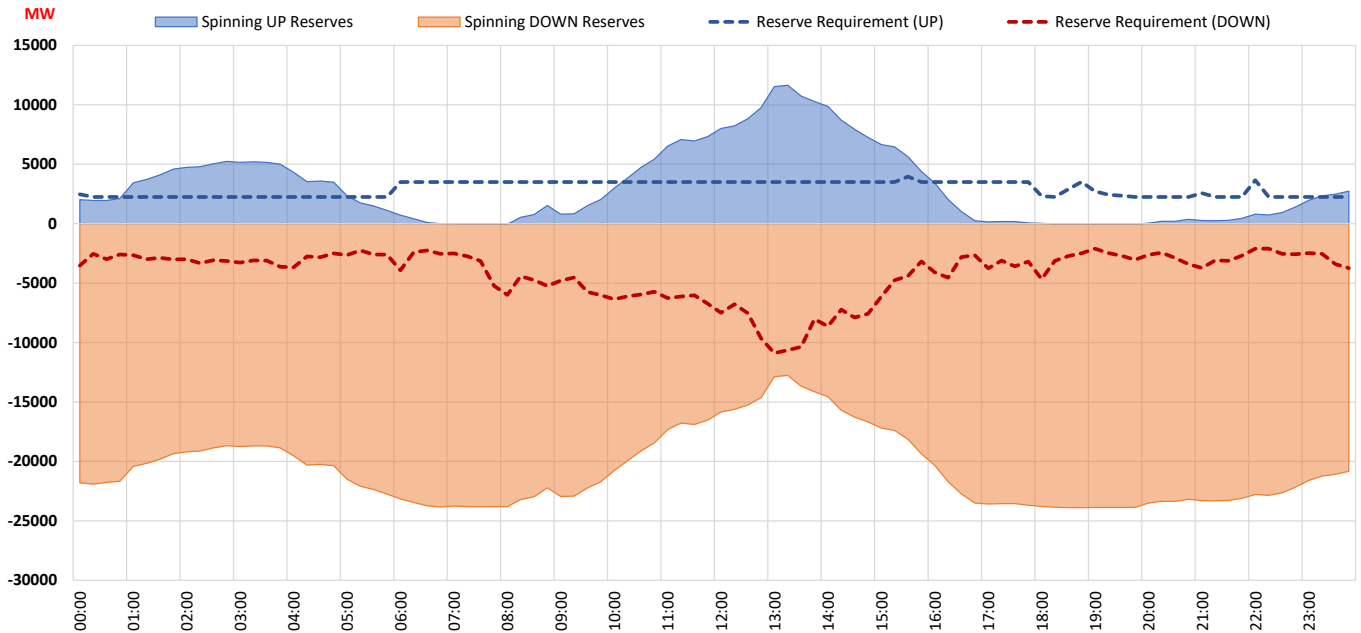


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 10-03-2025

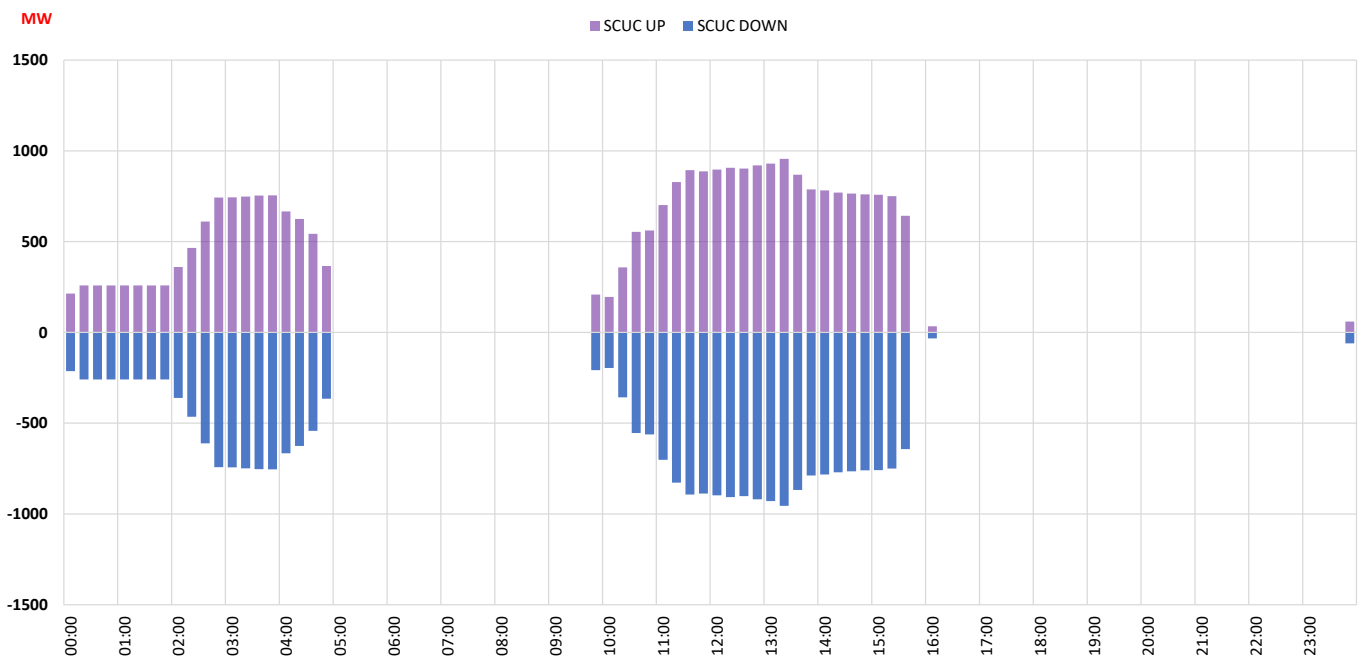


SCUC-Up Scheduled (MWh)	6770
SCUC-Down Scheduled (MWh)	-6770

Tertiary Reserve Ancillary Services (TRAS) Despatched for 10-03-2025

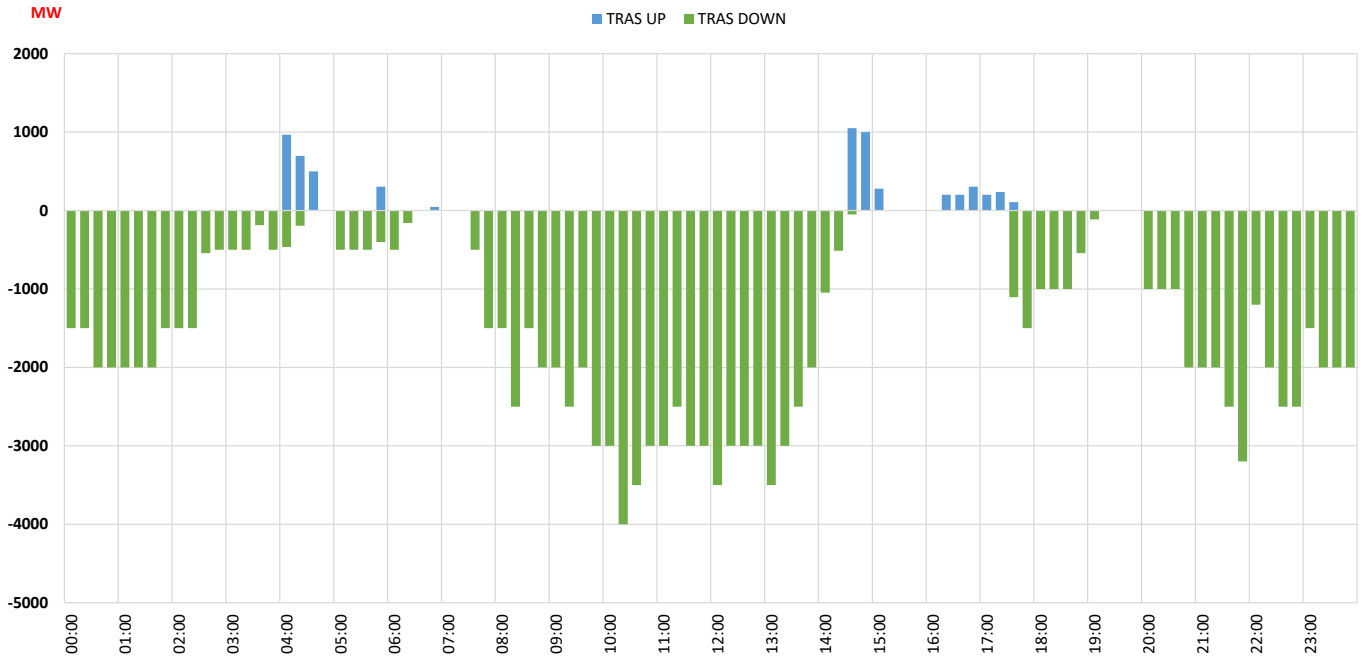

Secondary Reserve Ancillary Services (SRAS) Profile for 10-03-2025

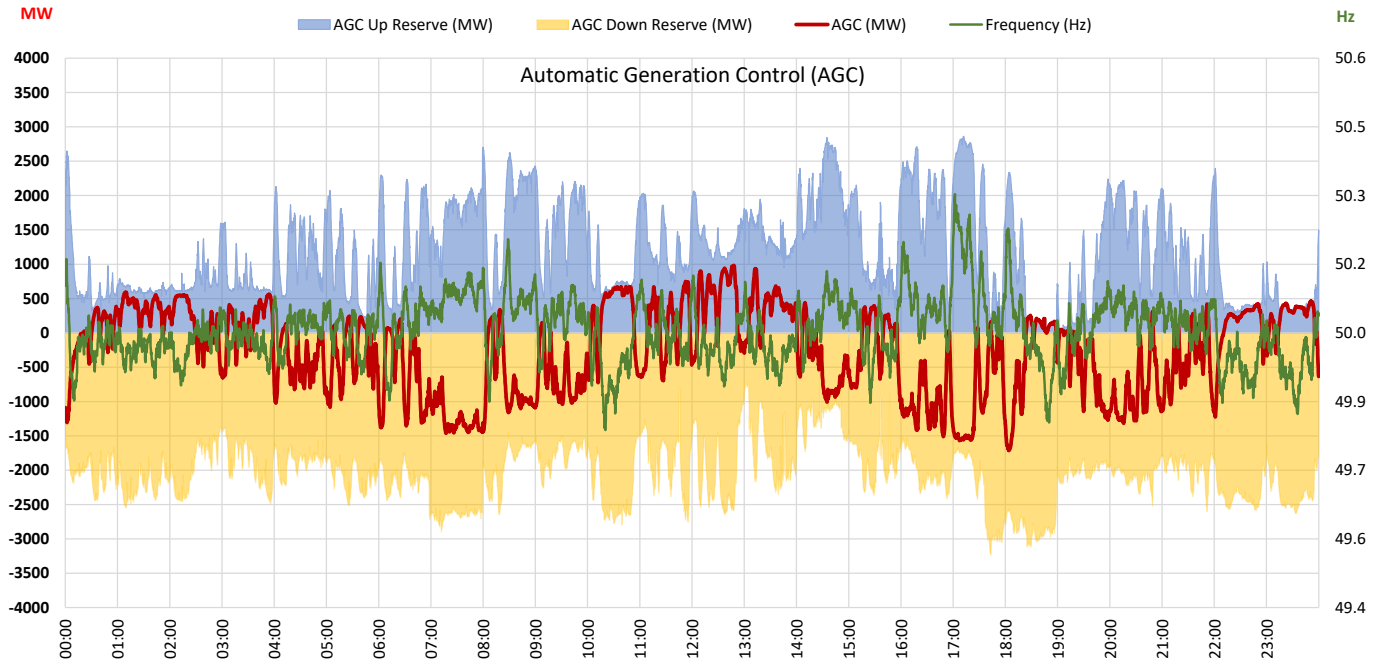

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	3225	-9722	983	-1712	-271
TRAS:	1242	-32026	1000	-4000	-1283
SRAS+TRAS:	4467	-41748	676	-4337	-1553