


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 12/03/2025

Reserve Profile for 12-03-2025

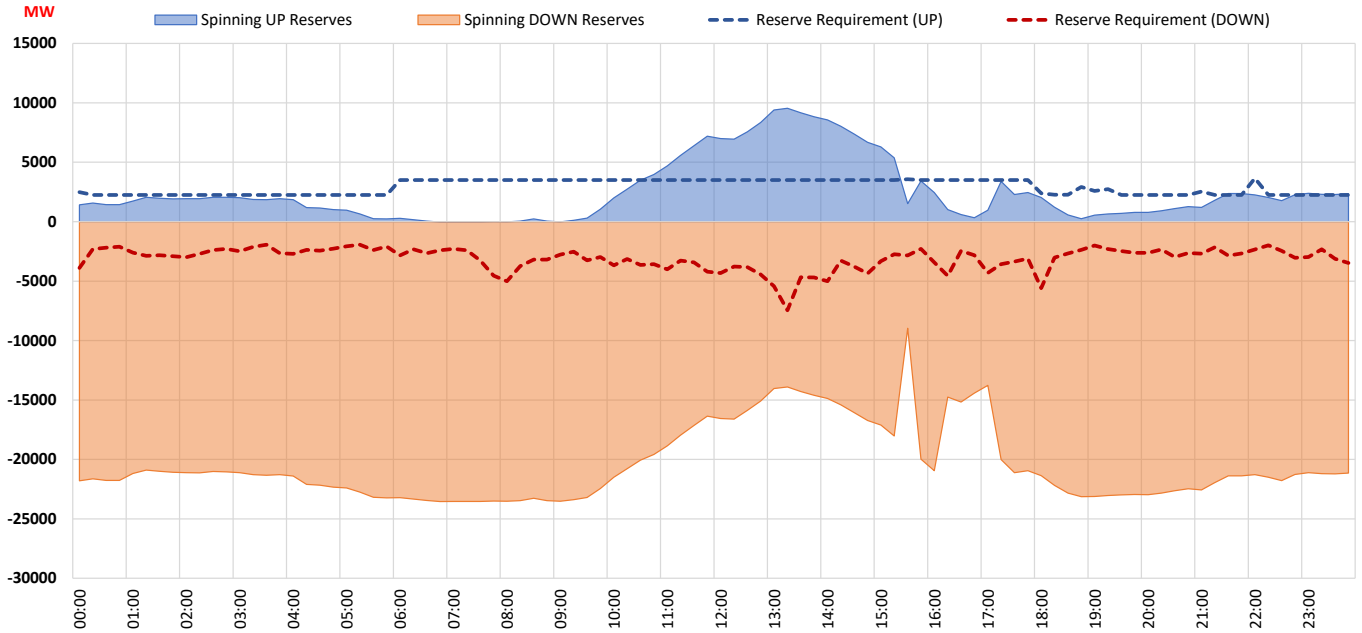


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 12-03-2025

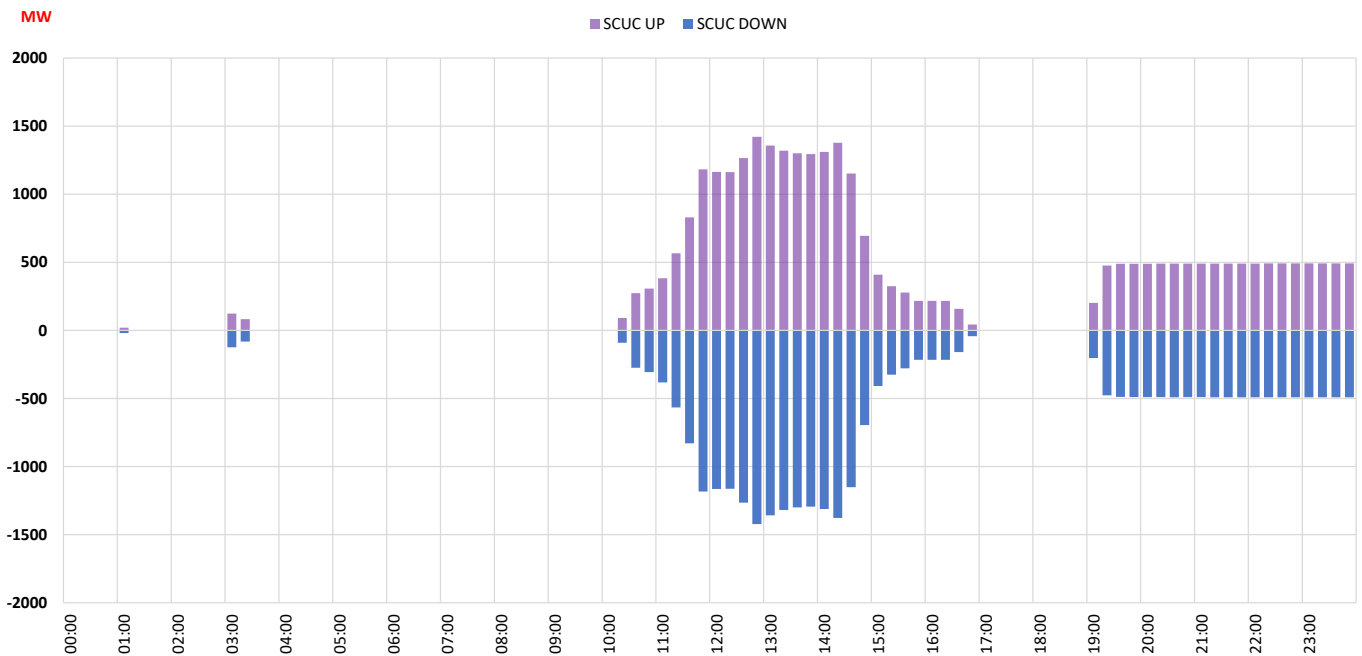


SCUC-Up Scheduled (MWh)	7515
SCUC-Down Scheduled (MWh)	-7515

Tertiary Reserve Ancillary Services (TRAS) Despatched for 12-03-2025

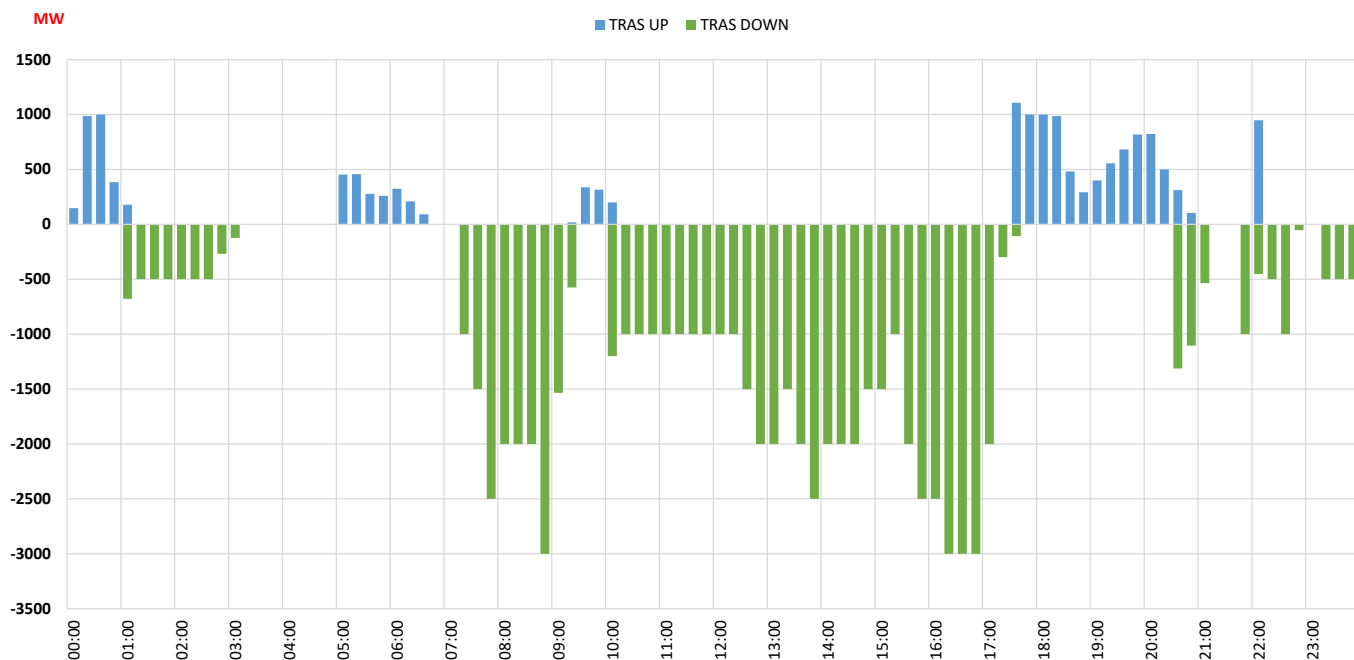

Secondary Reserve Ancillary Services (SRAS) Profile for 12-03-2025

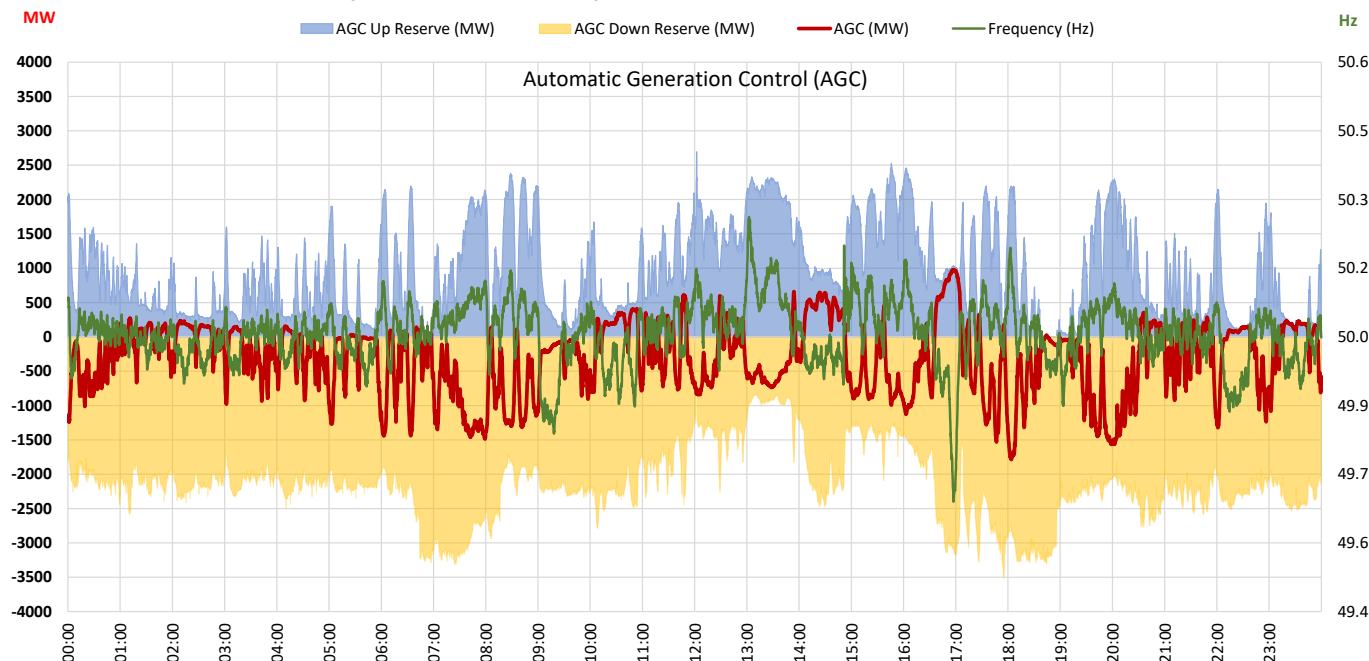

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	1626	-9262	978	-1786	-318
TRAS:	3572	-19091	1000	-3000	-647
SRAS+TRAS:	5198	-28352	1174	-4199	-965