


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 13/03/2025

Reserve Profile for 13-03-2025

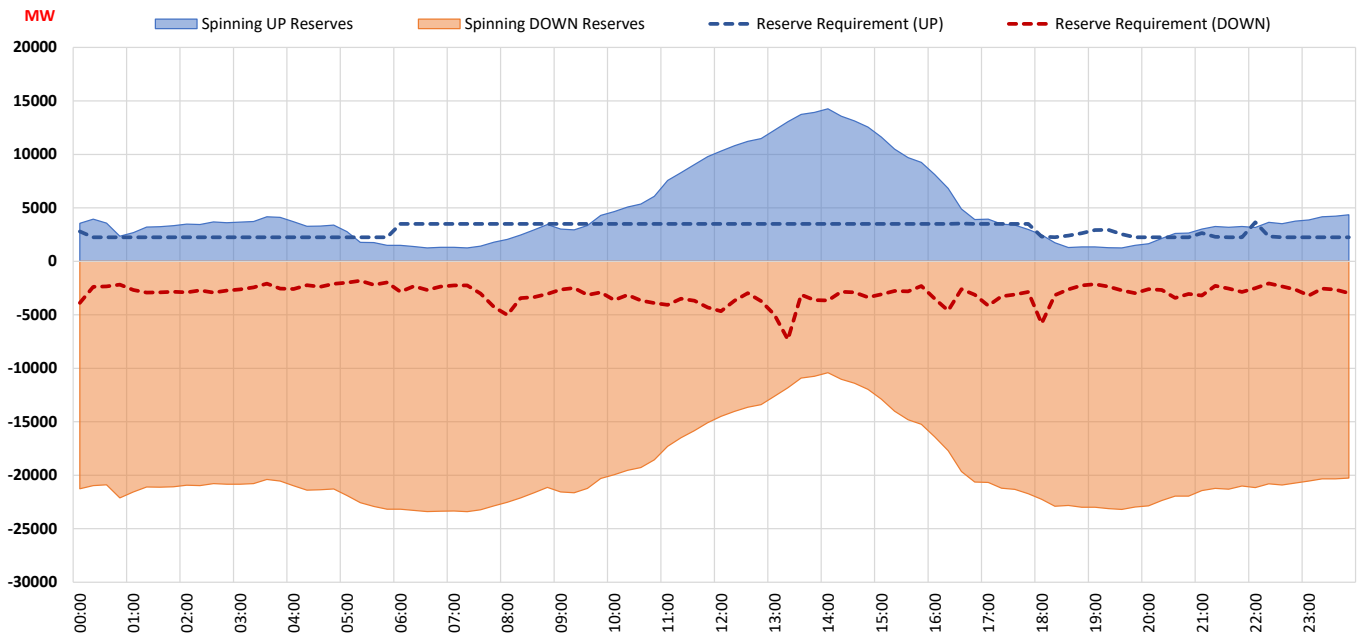


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 13-03-2025

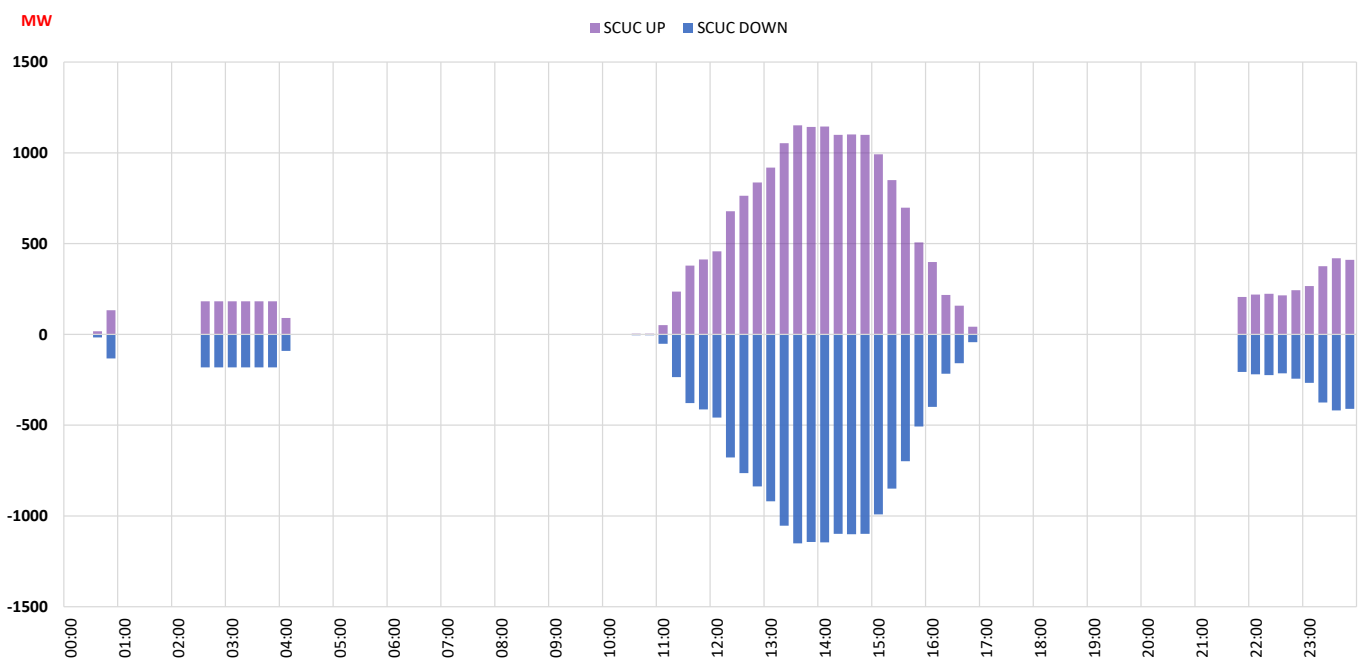


SCUC-Up Scheduled (MWh)	5079
SCUC-Down Scheduled (MWh)	-5079

Tertiary Reserve Ancillary Services (TRAS) Despatched for 13-03-2025

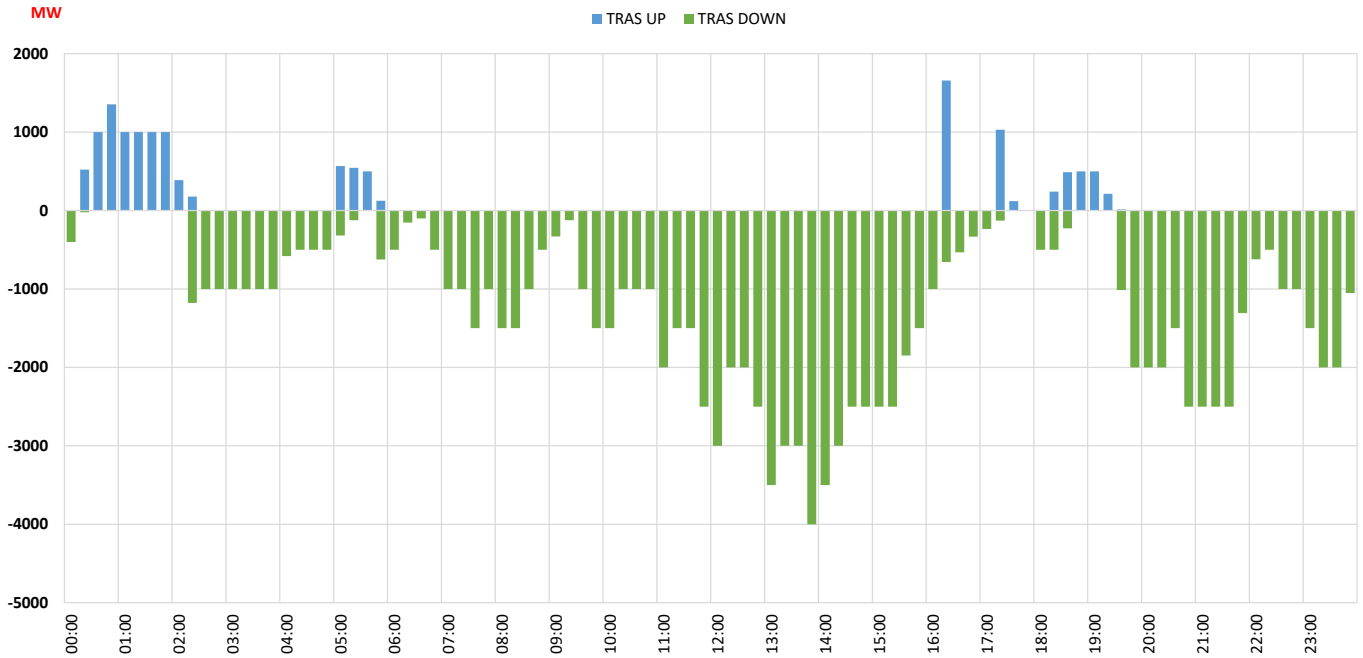

Secondary Reserve Ancillary Services (SRAS) Profile for 13-03-2025

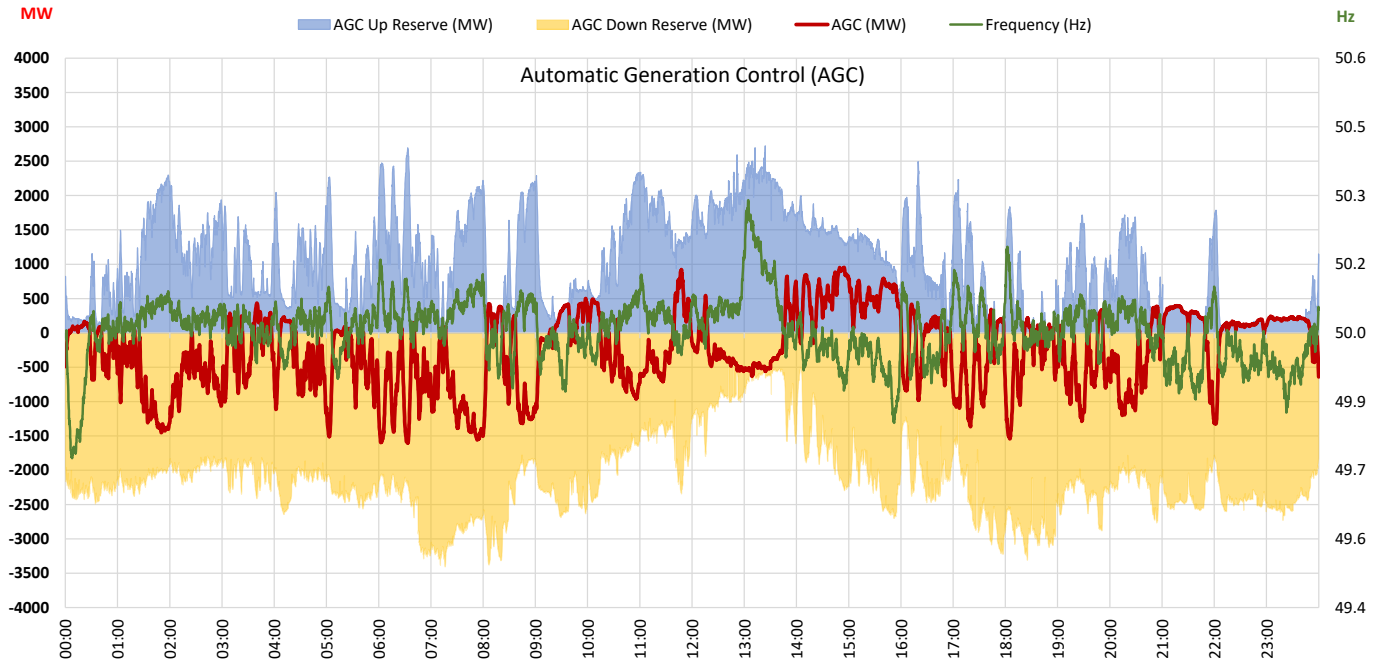

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	2620	-8964	955	-1605	-264
TRAS:	2976	-27595	1353	-4000	-1026
SRAS+TRAS:	5596	-36560	1400	-4133	-1290