


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 14/03/2025

Reserve Profile for 14-03-2025

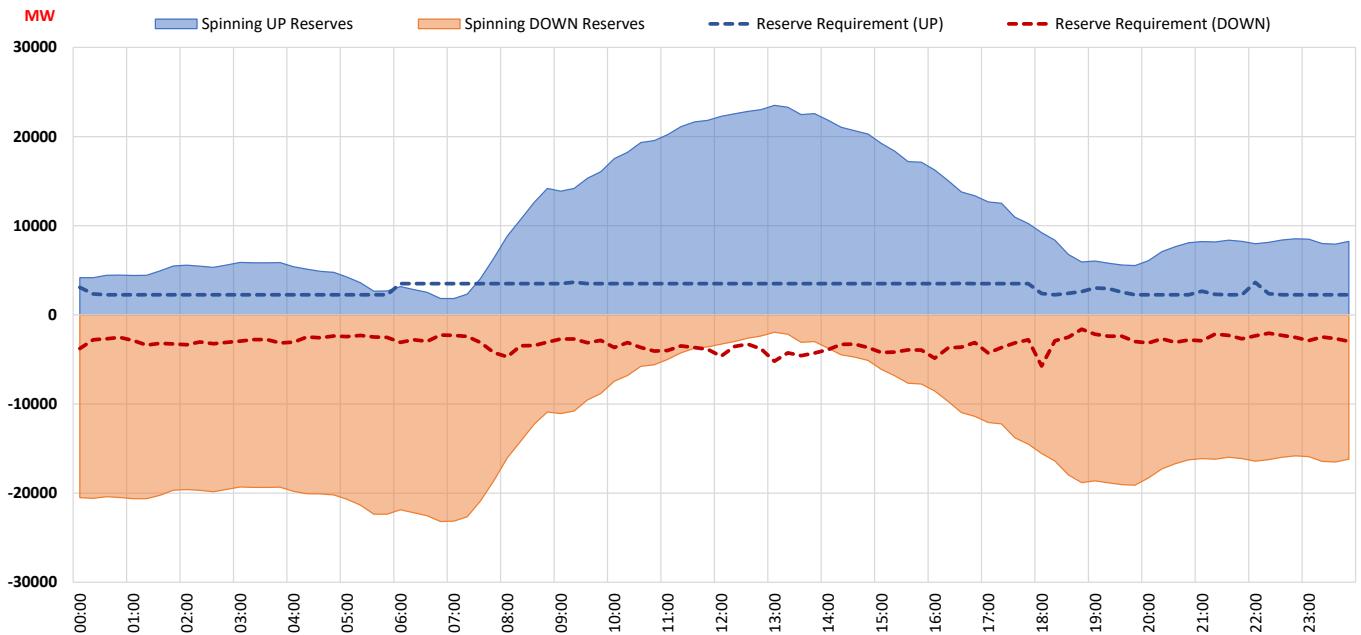


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 14-03-2025

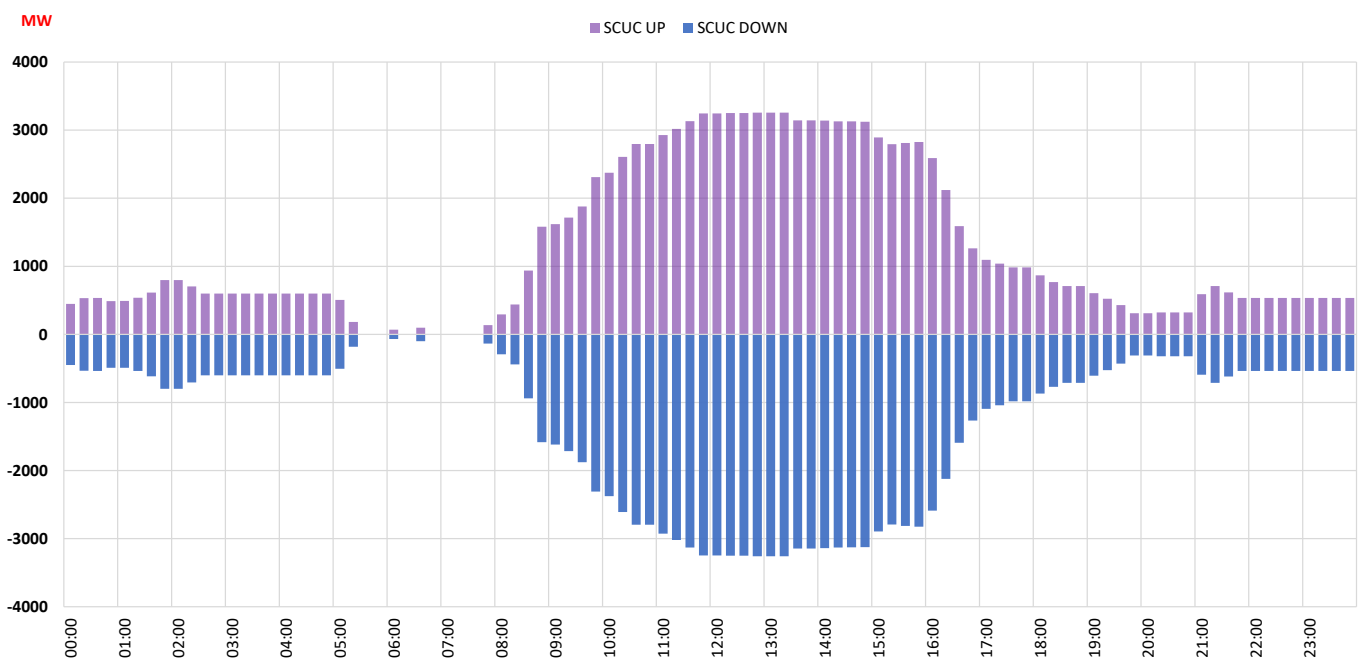


SCUC-Up Scheduled (MWh)	30223
SCUC-Down Scheduled (MWh)	-30222

Tertiary Reserve Ancillary Services (TRAS) Despatched for 14-03-2025

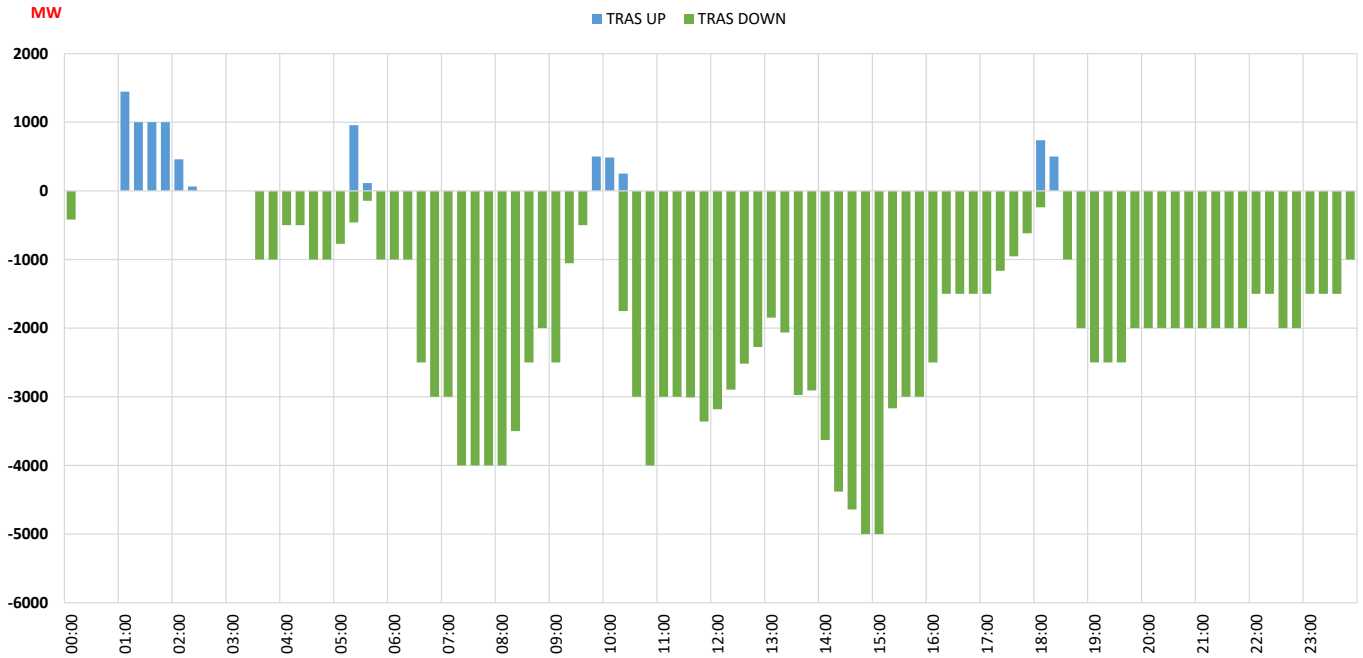

Secondary Reserve Ancillary Services (SRAS) Profile for 14-03-2025

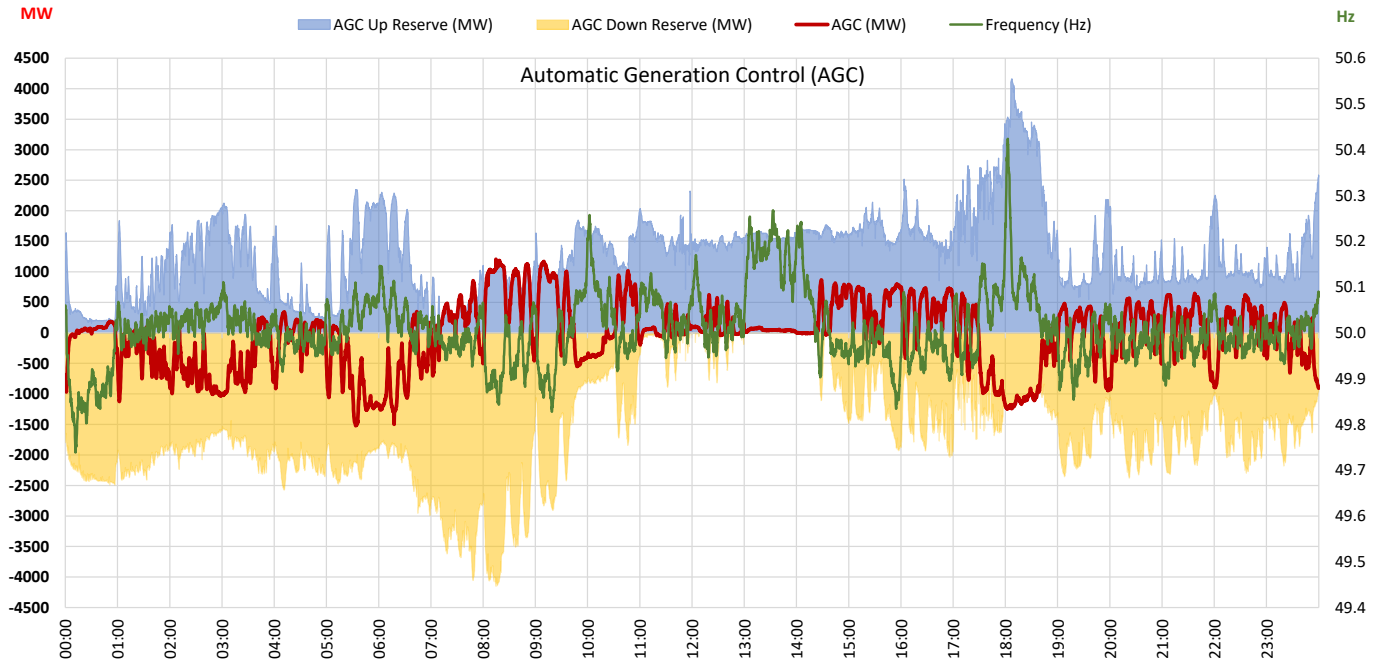

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	4404	-5506	1205	-1522	-46
TRAS:	1864	-42837	1446	-5000	-1707
SRAS+TRAS:	6268	-48343	1431	-4934	-1753