


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 15/03/2025

Reserve Profile for 15-03-2025

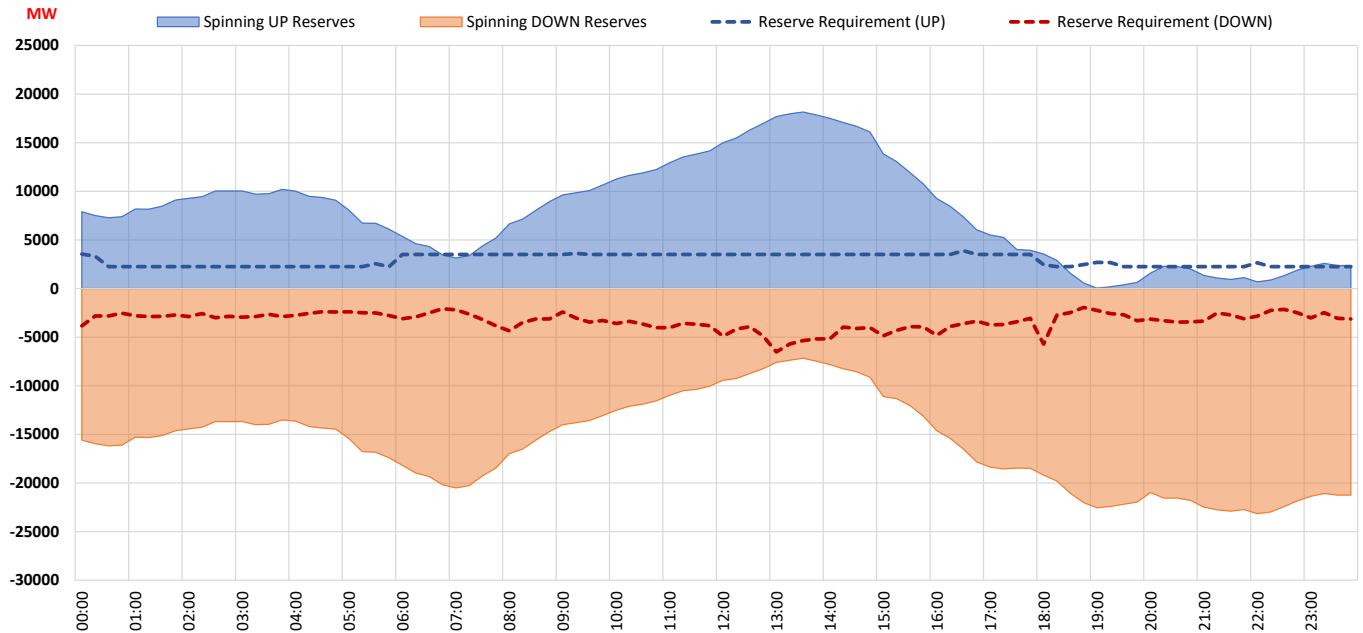


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 15-03-2025

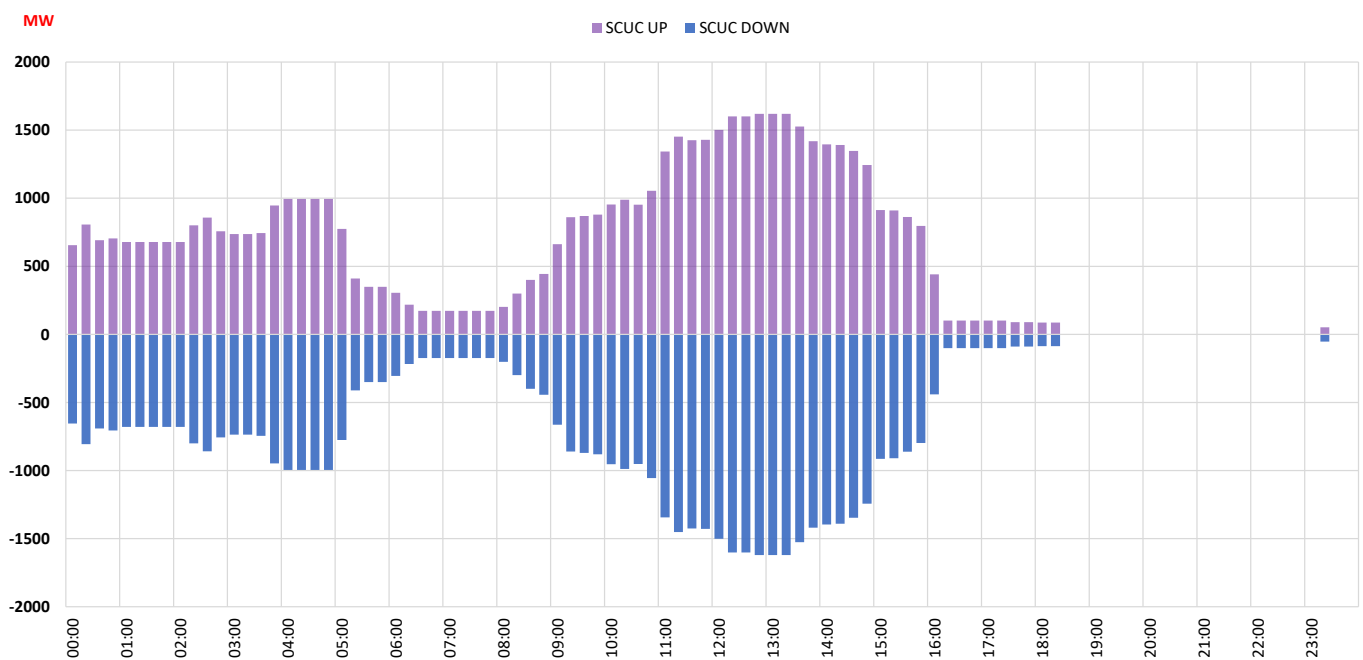


SCUC-Up Scheduled (MWh)	14051
SCUC-Down Scheduled (MWh)	-14050

Tertiary Reserve Ancillary Services (TRAS) Despatched for 15-03-2025

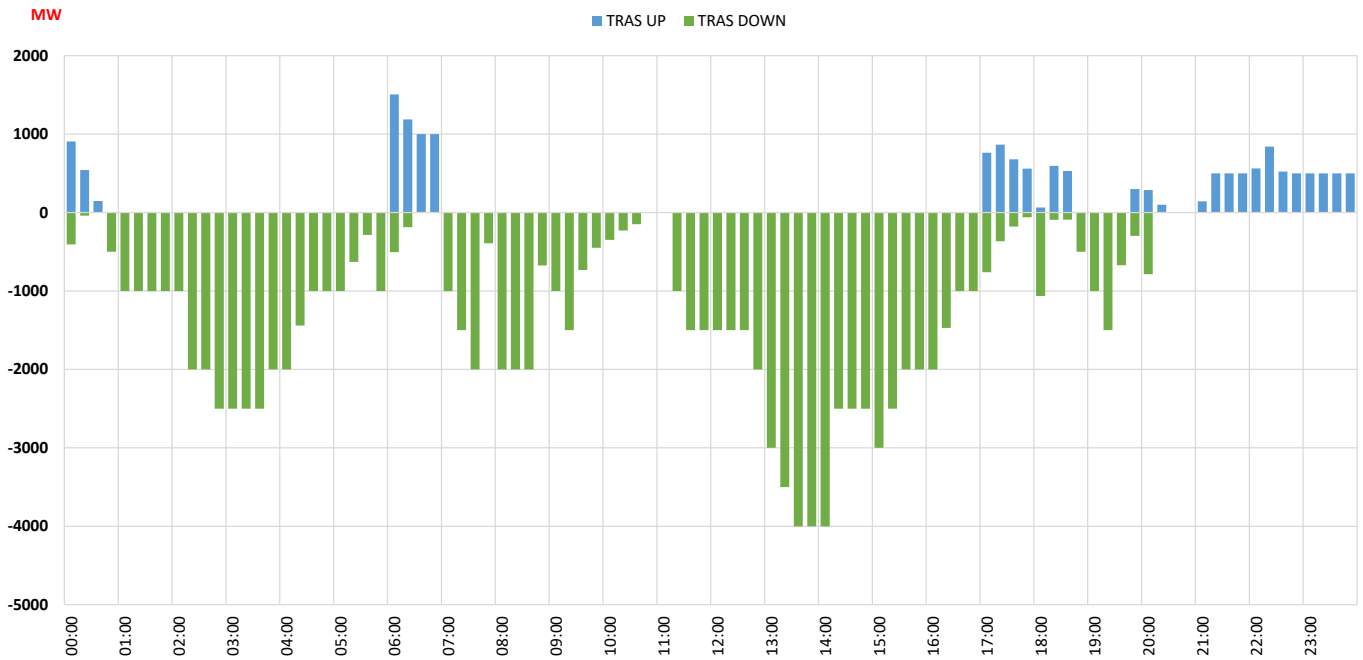

Secondary Reserve Ancillary Services (SRAS) Profile for 15-03-2025

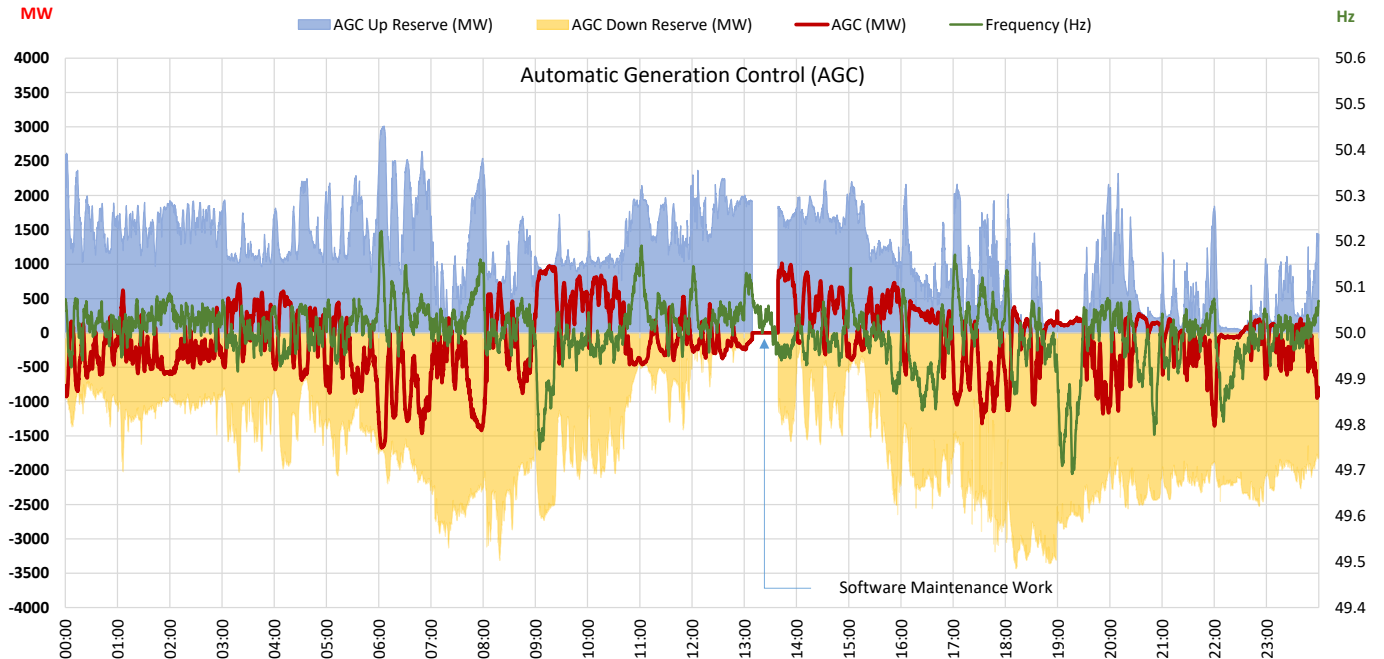

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	3137	-6031	1014	-1672	-121
TRAS:	3438	-25618	1000	-4000	-924
SRAS+TRAS:	6575	-31649	1071	-4151	-1045