


## Grid Controller of India Limited (GRID-INDIA)

### Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 17/03/2025

#### Reserve Profile for 17-03-2025

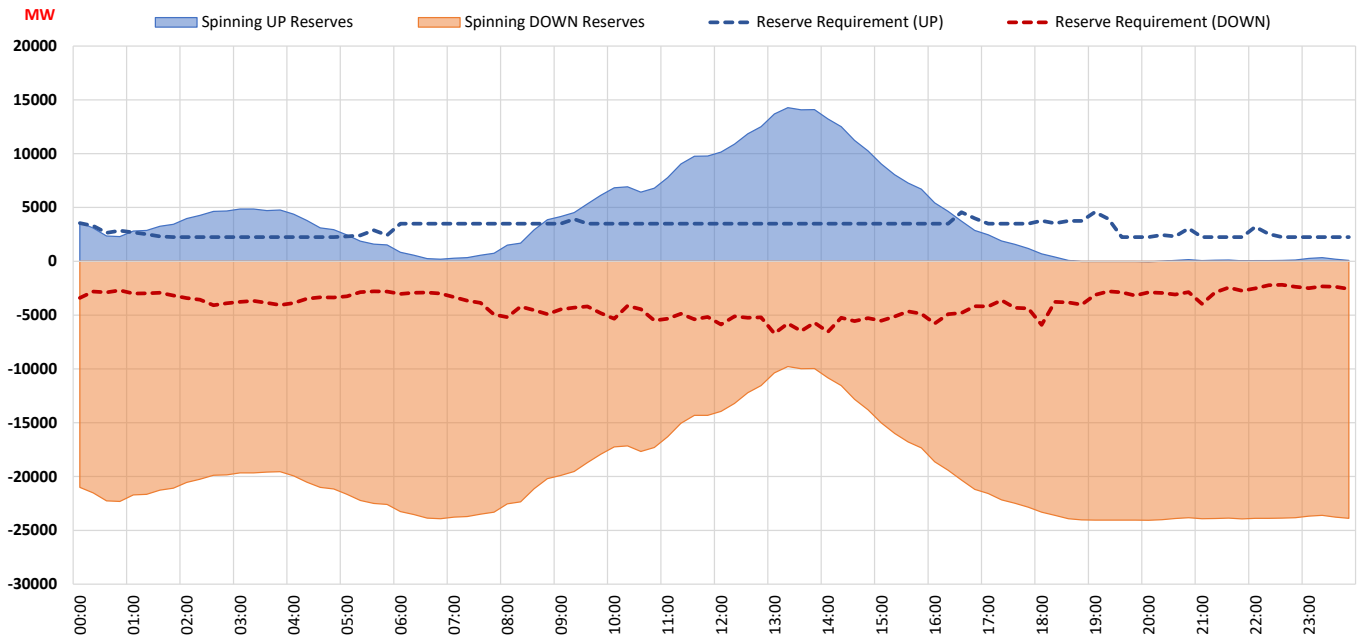


*Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.*

#### SCUC Scheduled for 17-03-2025

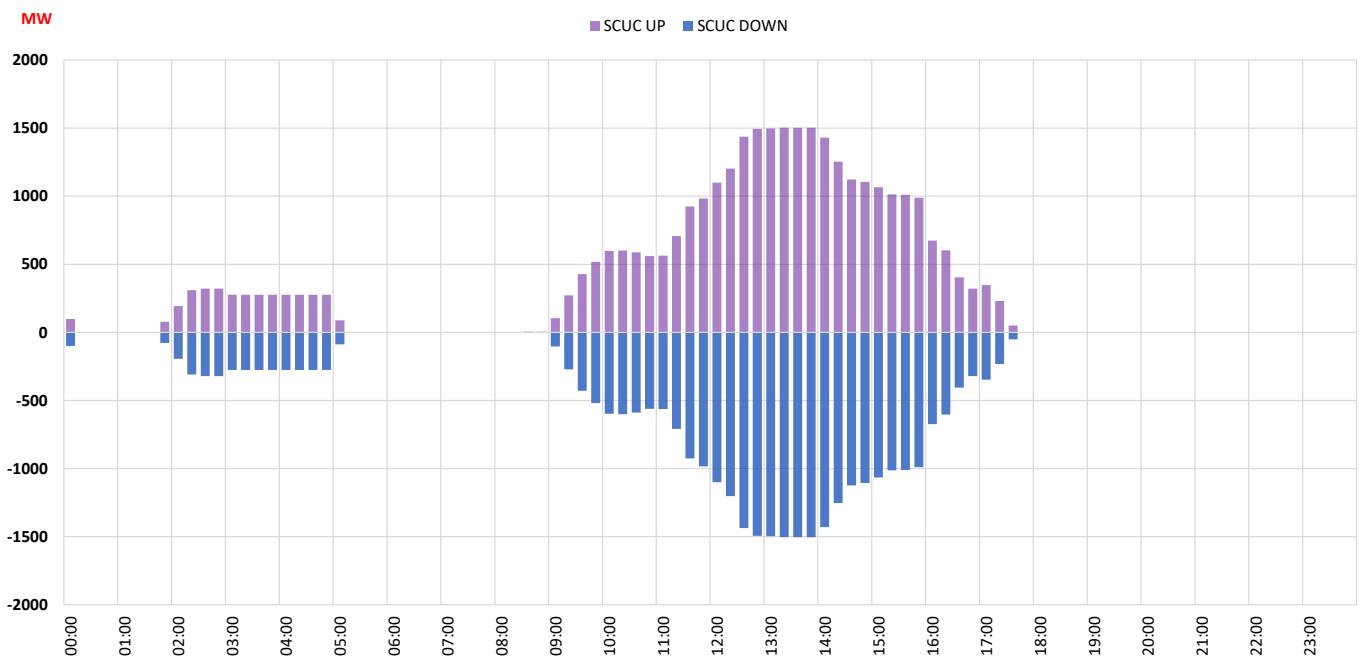


SCUC-Up Scheduled (MWh)	8336
SCUC-Down Scheduled (MWh)	-8336

### Tertiary Reserve Ancillary Services (TRAS) Despatched for 17-03-2025

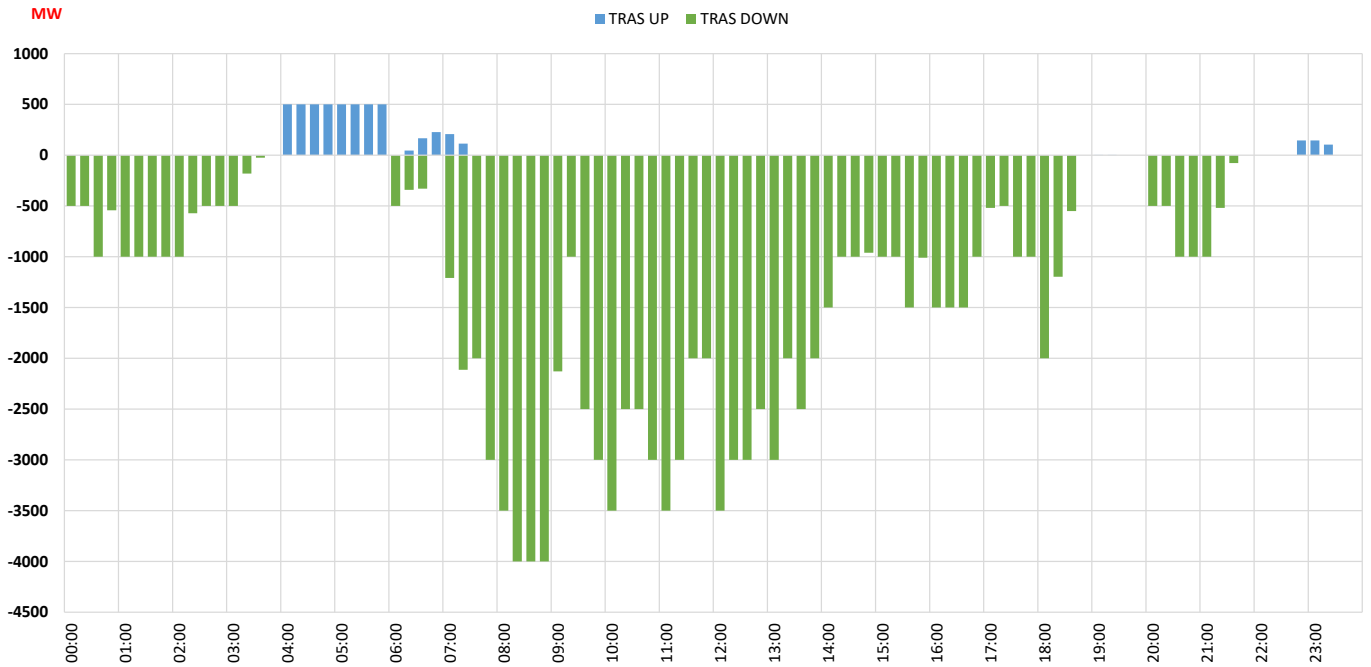

### Secondary Reserve Ancillary Services (SRAS) Profile for 17-03-2025

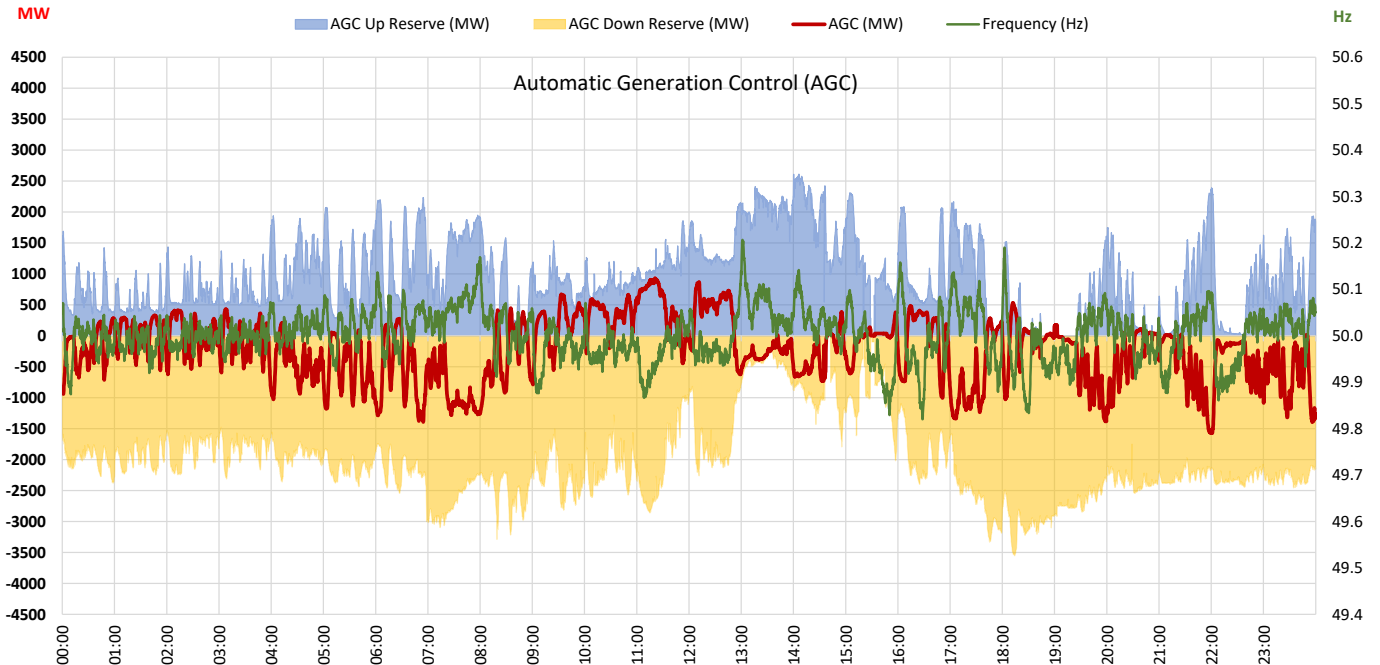

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	2387	-7680	929	-1572	-221
TRAS:	1156	-28060	500	-4000	-1121
SRAS+TRAS:	3542	-35740	709	-4922	-1342