


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 18/03/2025

Reserve Profile for 18-03-2025

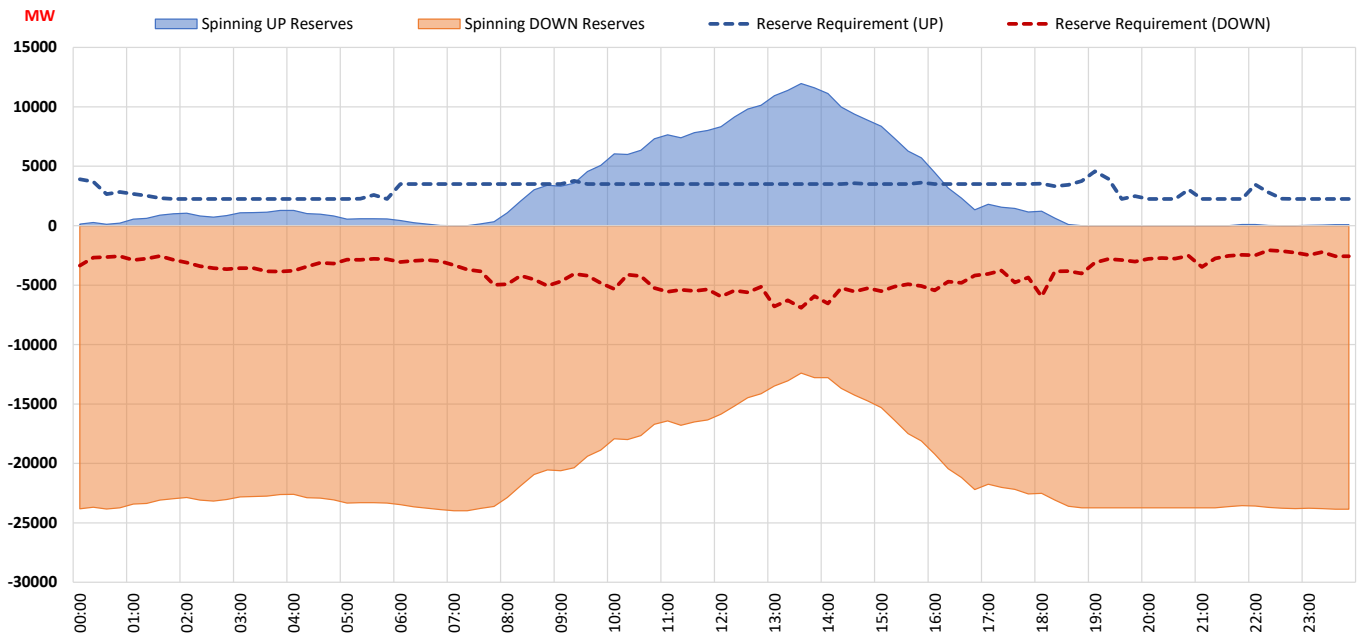


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 18-03-2025

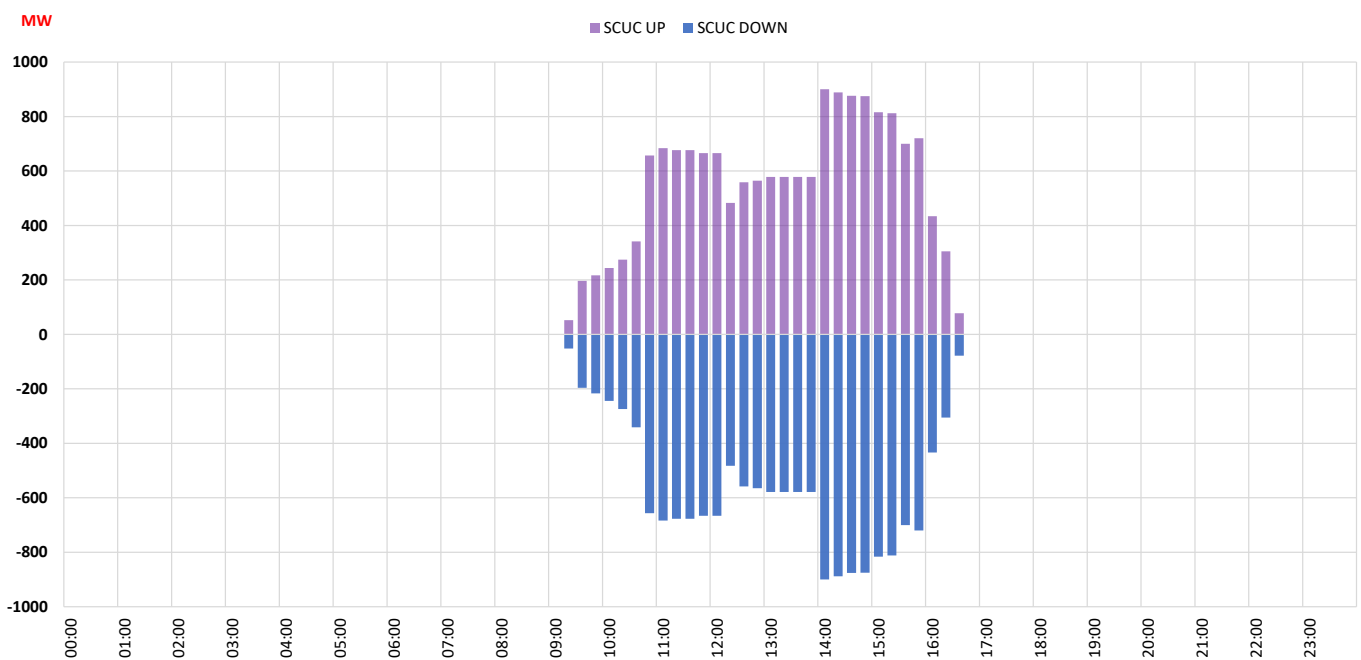


SCUC-Up Scheduled (MWh)	4169
SCUC-Down Scheduled (MWh)	-4169

Tertiary Reserve Ancillary Services (TRAS) Despatched for 18-03-2025

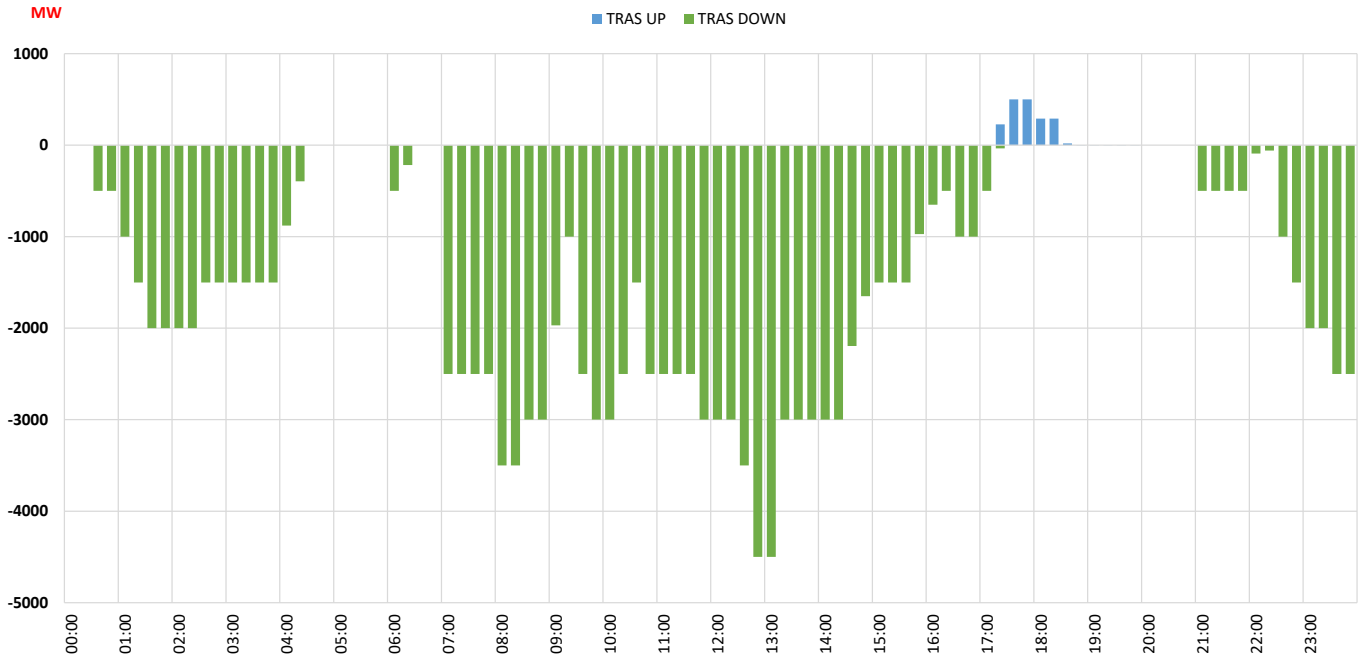

Secondary Reserve Ancillary Services (SRAS) Profile for 18-03-2025

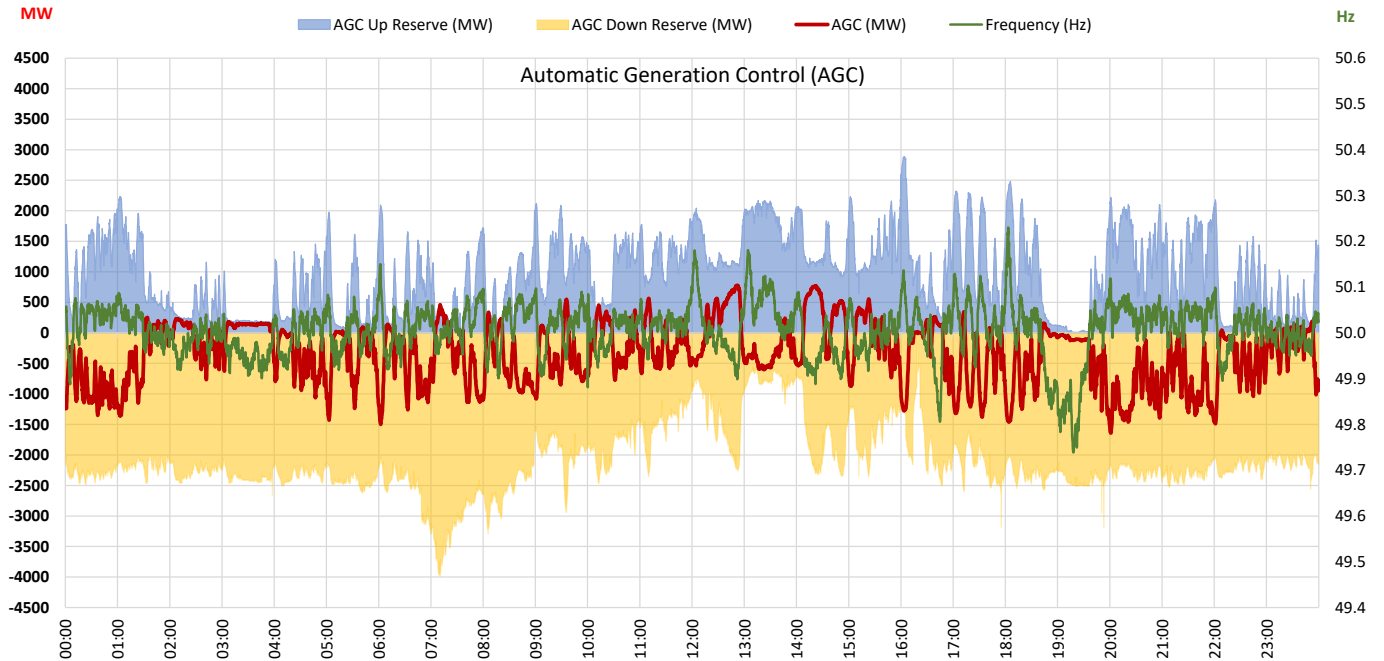

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	1443	-9568	779	-1642	-339
TRAS:	448	-33519	500	-4500	-1378
SRAS+TRAS:	1891	-43087	596	-5000	-1717