


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 19/03/2025

Reserve Profile for 19-03-2025

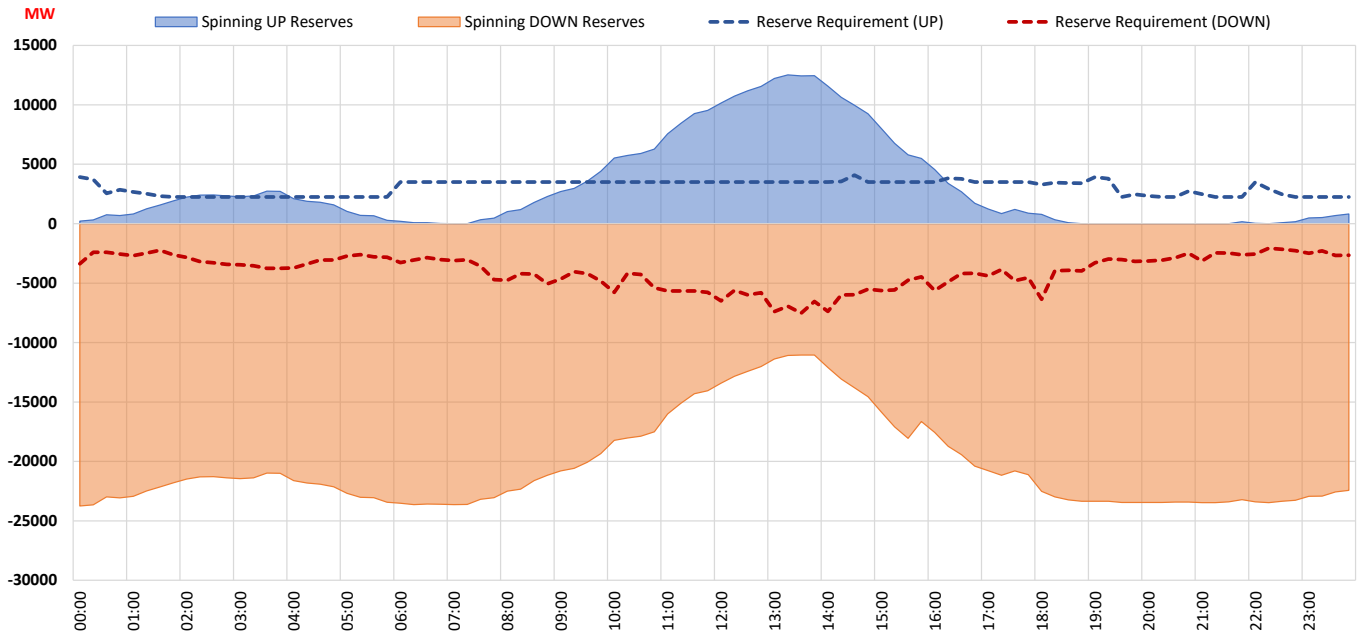


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 19-03-2025

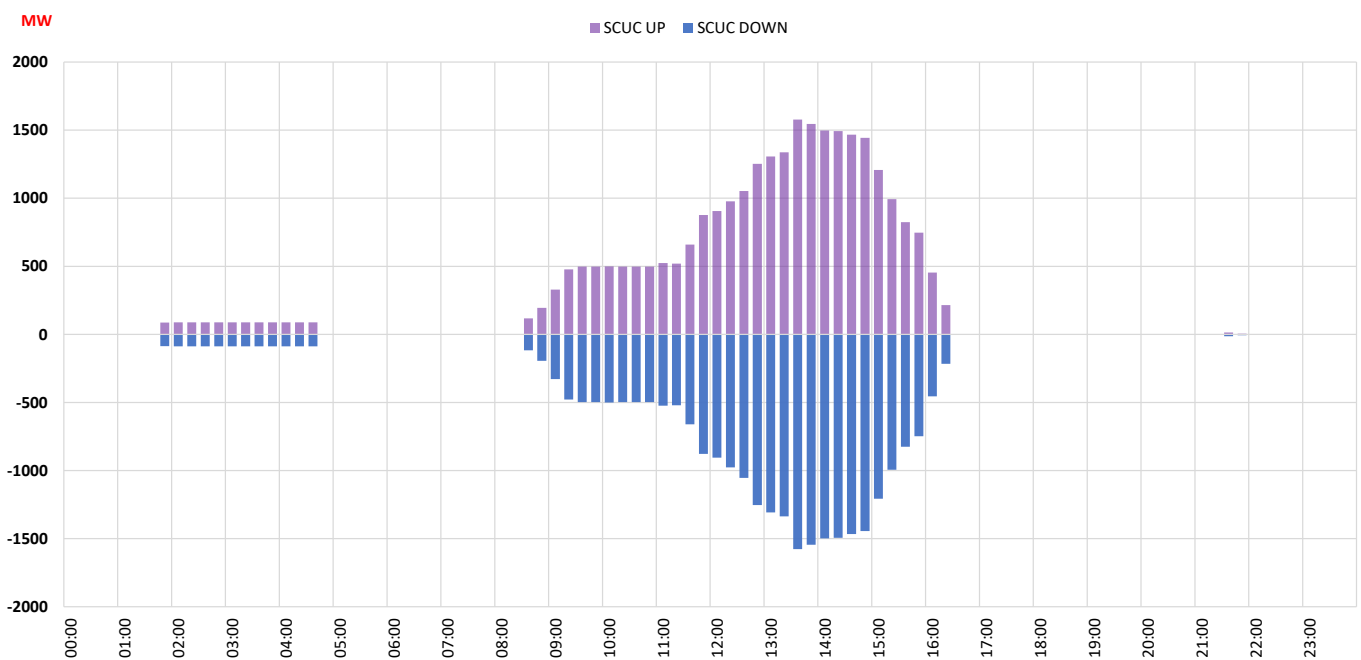


SCUC-Up Scheduled (MWh)	7015
SCUC-Down Scheduled (MWh)	-7016

Tertiary Reserve Ancillary Services (TRAS) Despatched for 19-03-2025

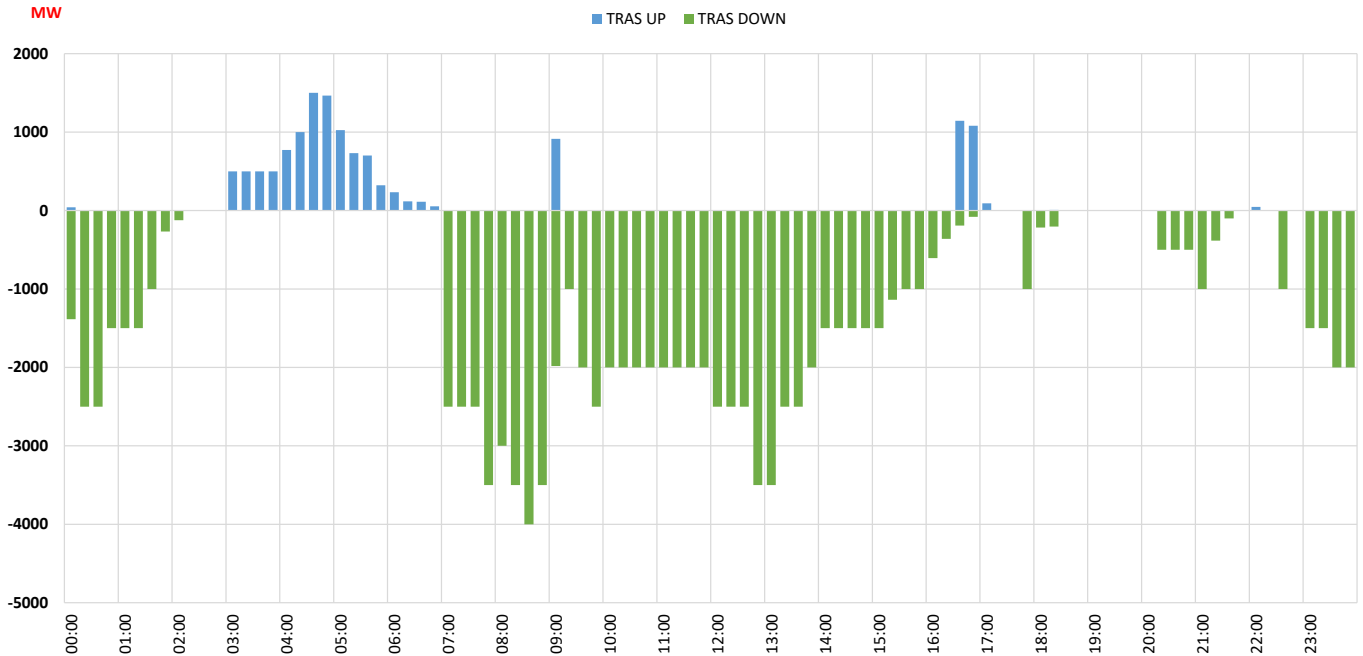

Secondary Reserve Ancillary Services (SRAS) Profile for 19-03-2025

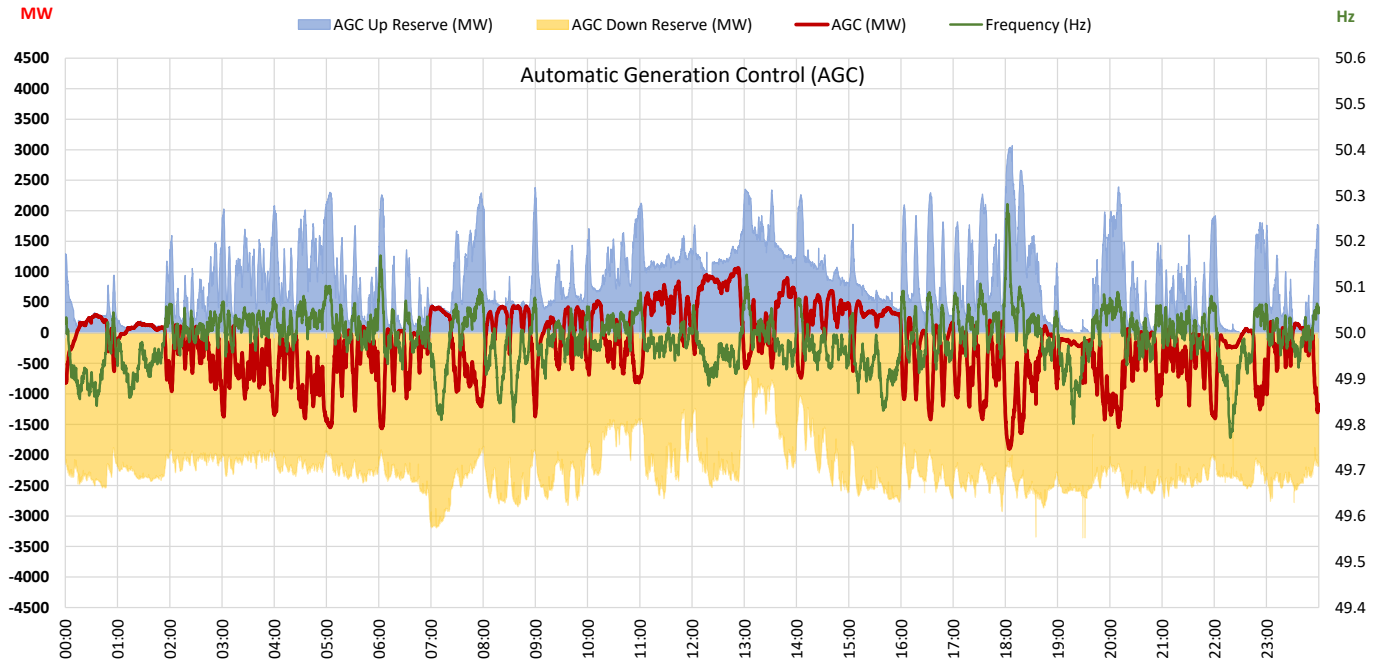

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	3008	-7549	1068	-1903	-189
TRAS:	3030	-26327	1500	-4000	-971
SRAS+TRAS:	6037	-33875	1185	-4873	-1160