


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 20/03/2025

Reserve Profile for 20-03-2025

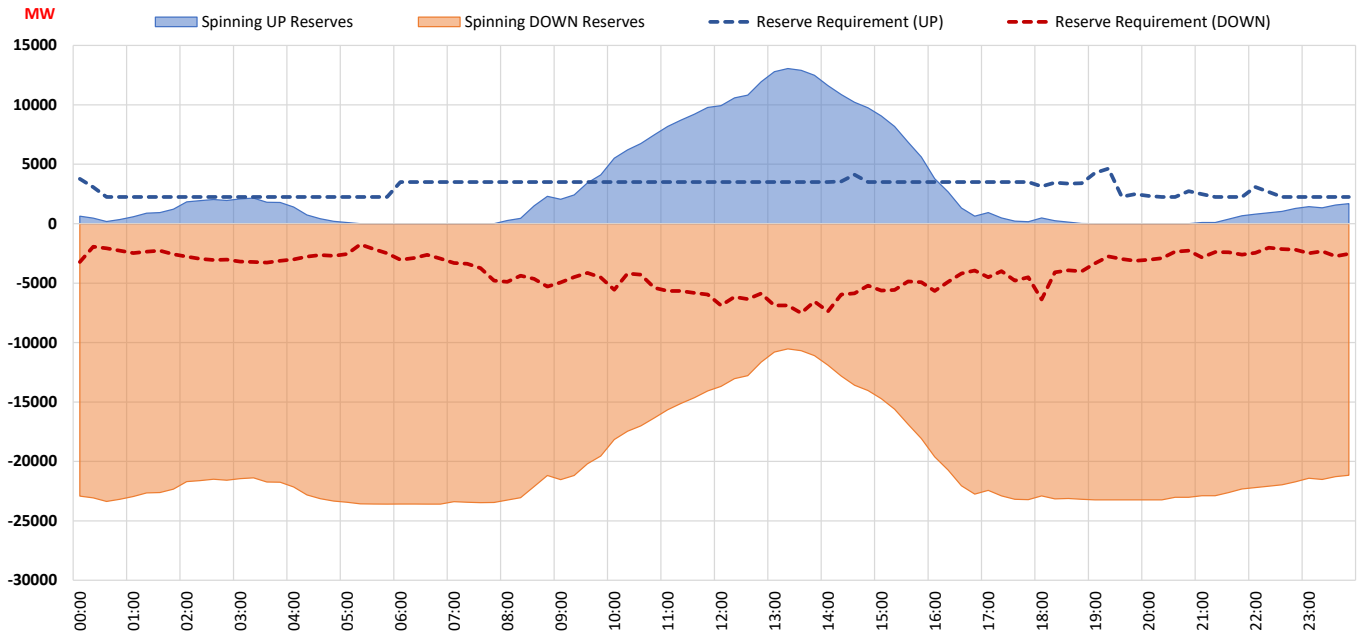


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 20-03-2025

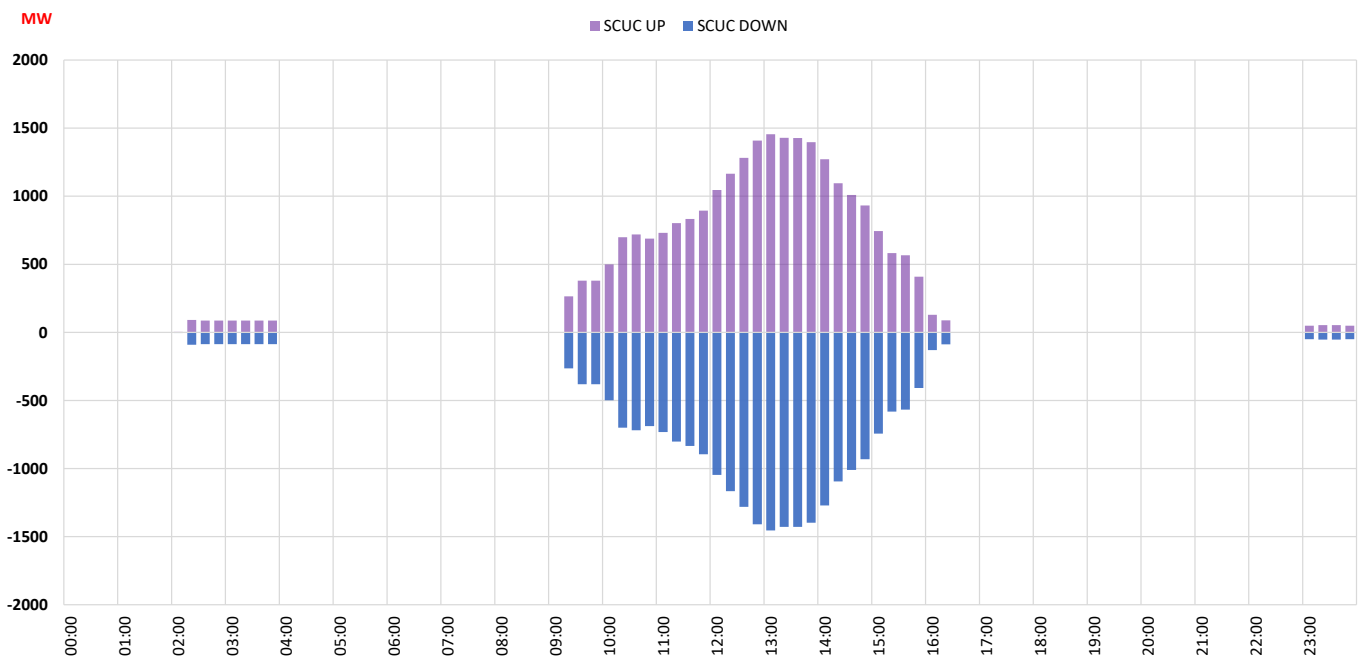


SCUC-Up Scheduled (MWh)	6288
SCUC-Down Scheduled (MWh)	-6288

Tertiary Reserve Ancillary Services (TRAS) Despatched for 20-03-2025

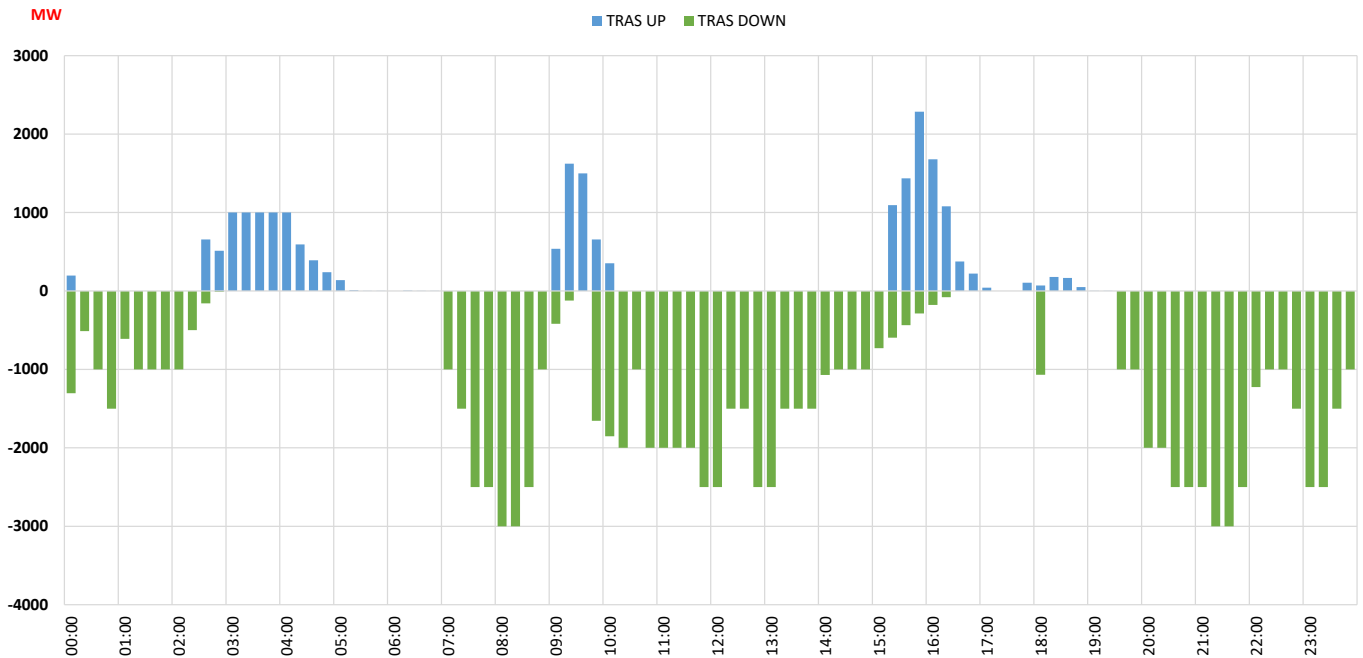

Secondary Reserve Ancillary Services (SRAS) Profile for 20-03-2025

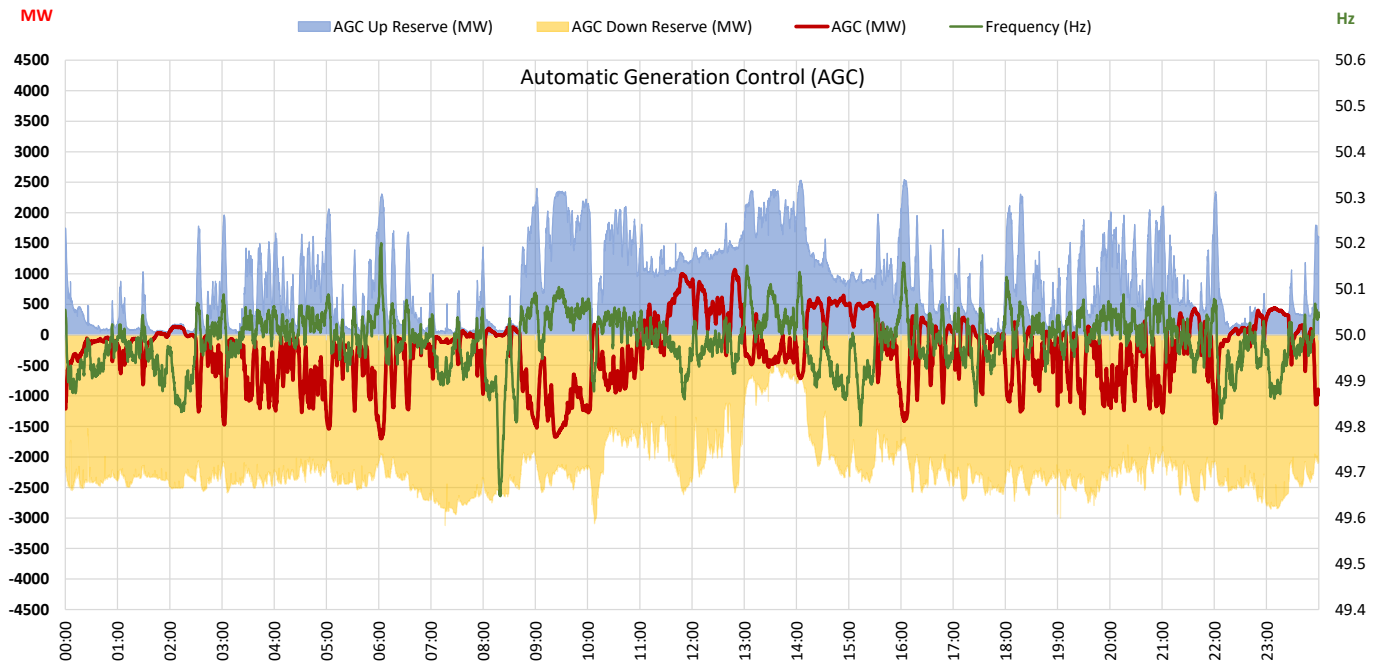

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	2114	-8231	1068	-1700	-255
TRAS:	4407	-24314	2000	-3000	-829
SRAS+TRAS:	6521	-32546	1989	-3931	-1084