


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 23/03/2025

Reserve Profile for 23-03-2025

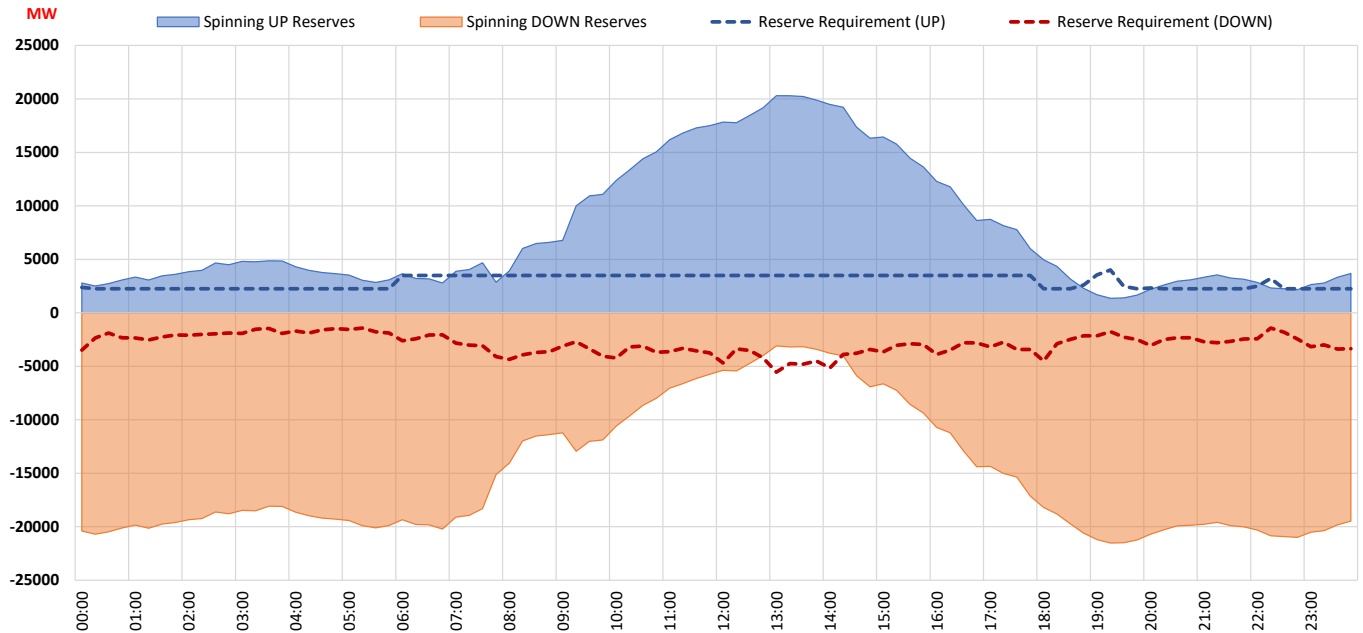


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 23-03-2025

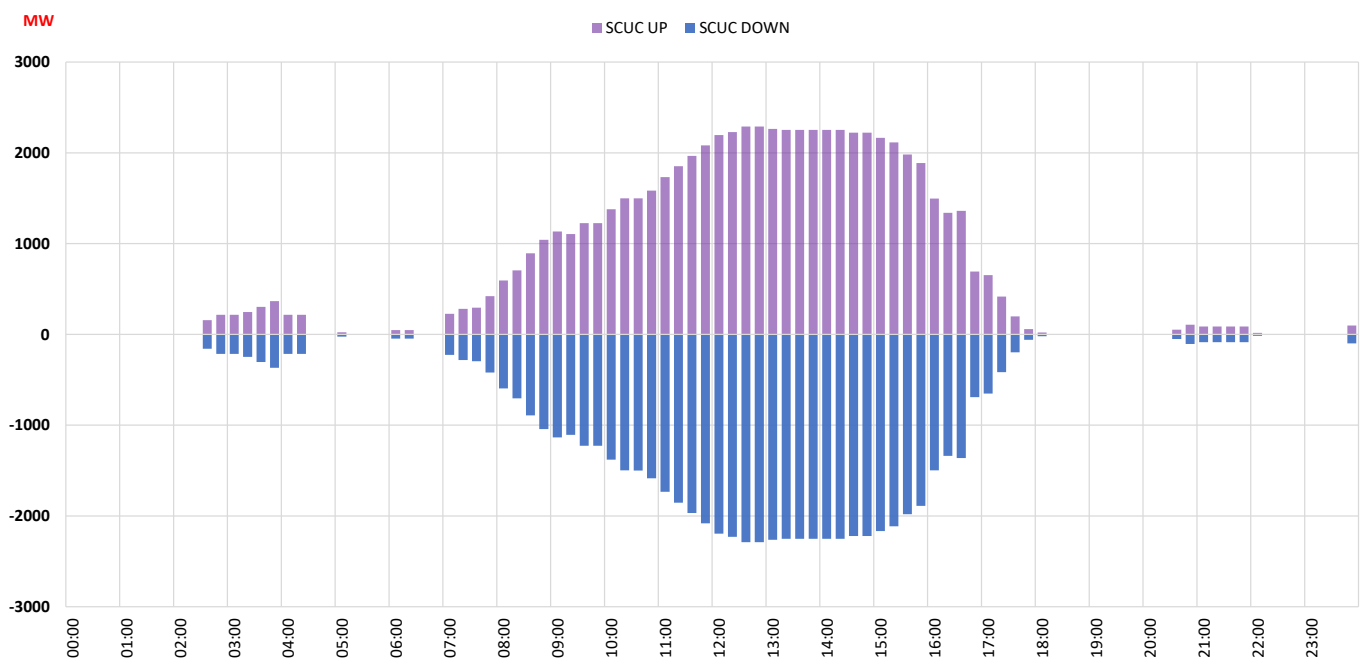


SCUC-Up Scheduled (MWh)	16696
SCUC-Down Scheduled (MWh)	-16695

Tertiary Reserve Ancillary Services (TRAS) Despatched for 23-03-2025

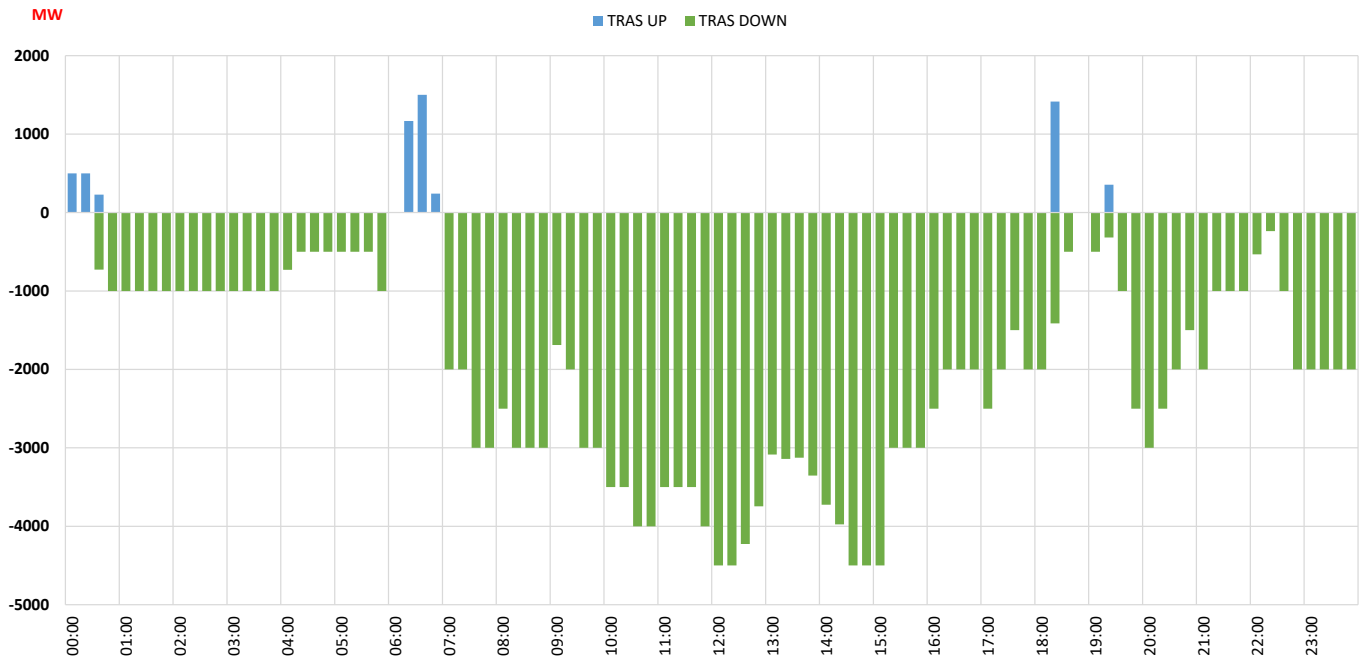

Secondary Reserve Ancillary Services (SRAS) Profile for 23-03-2025

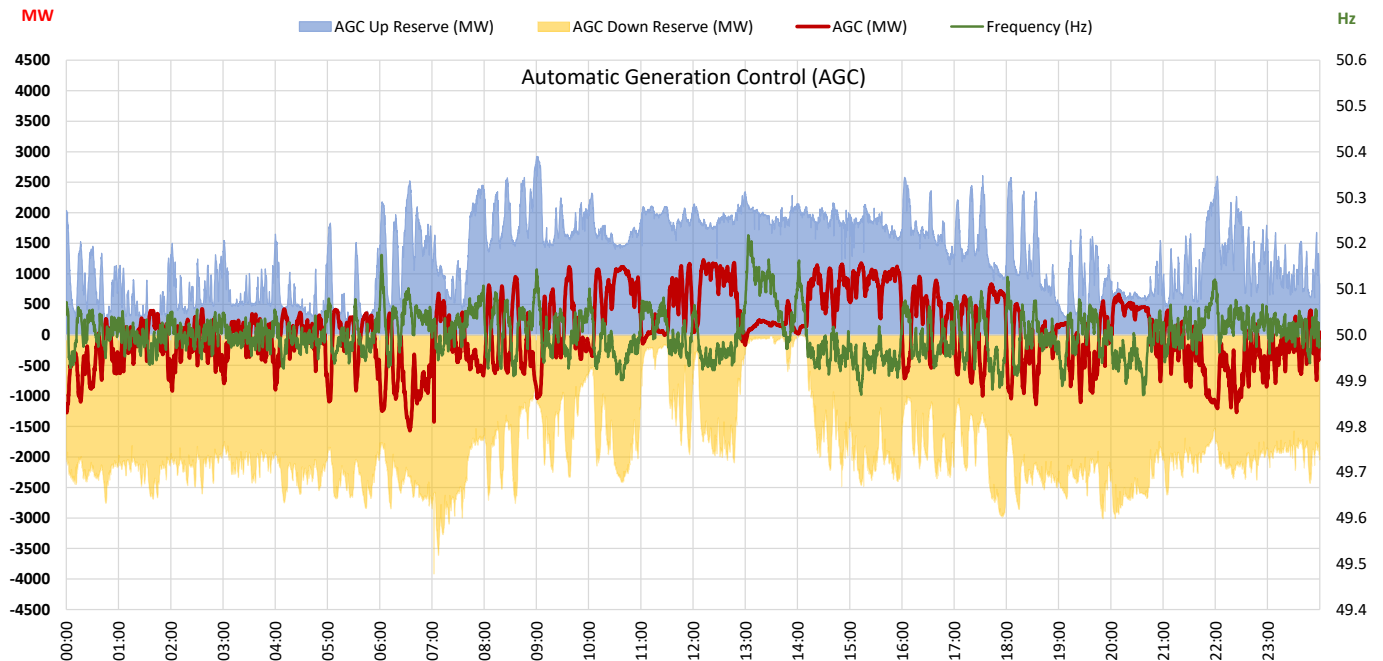

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	5906	-4884	1229	-1569	43
TRAS:	986	-46893	1500	-4500	-1913
SRAS+TRAS:	6893	-51777	1181	-4457	-1870