


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 24/03/2025

Reserve Profile for 24-03-2025

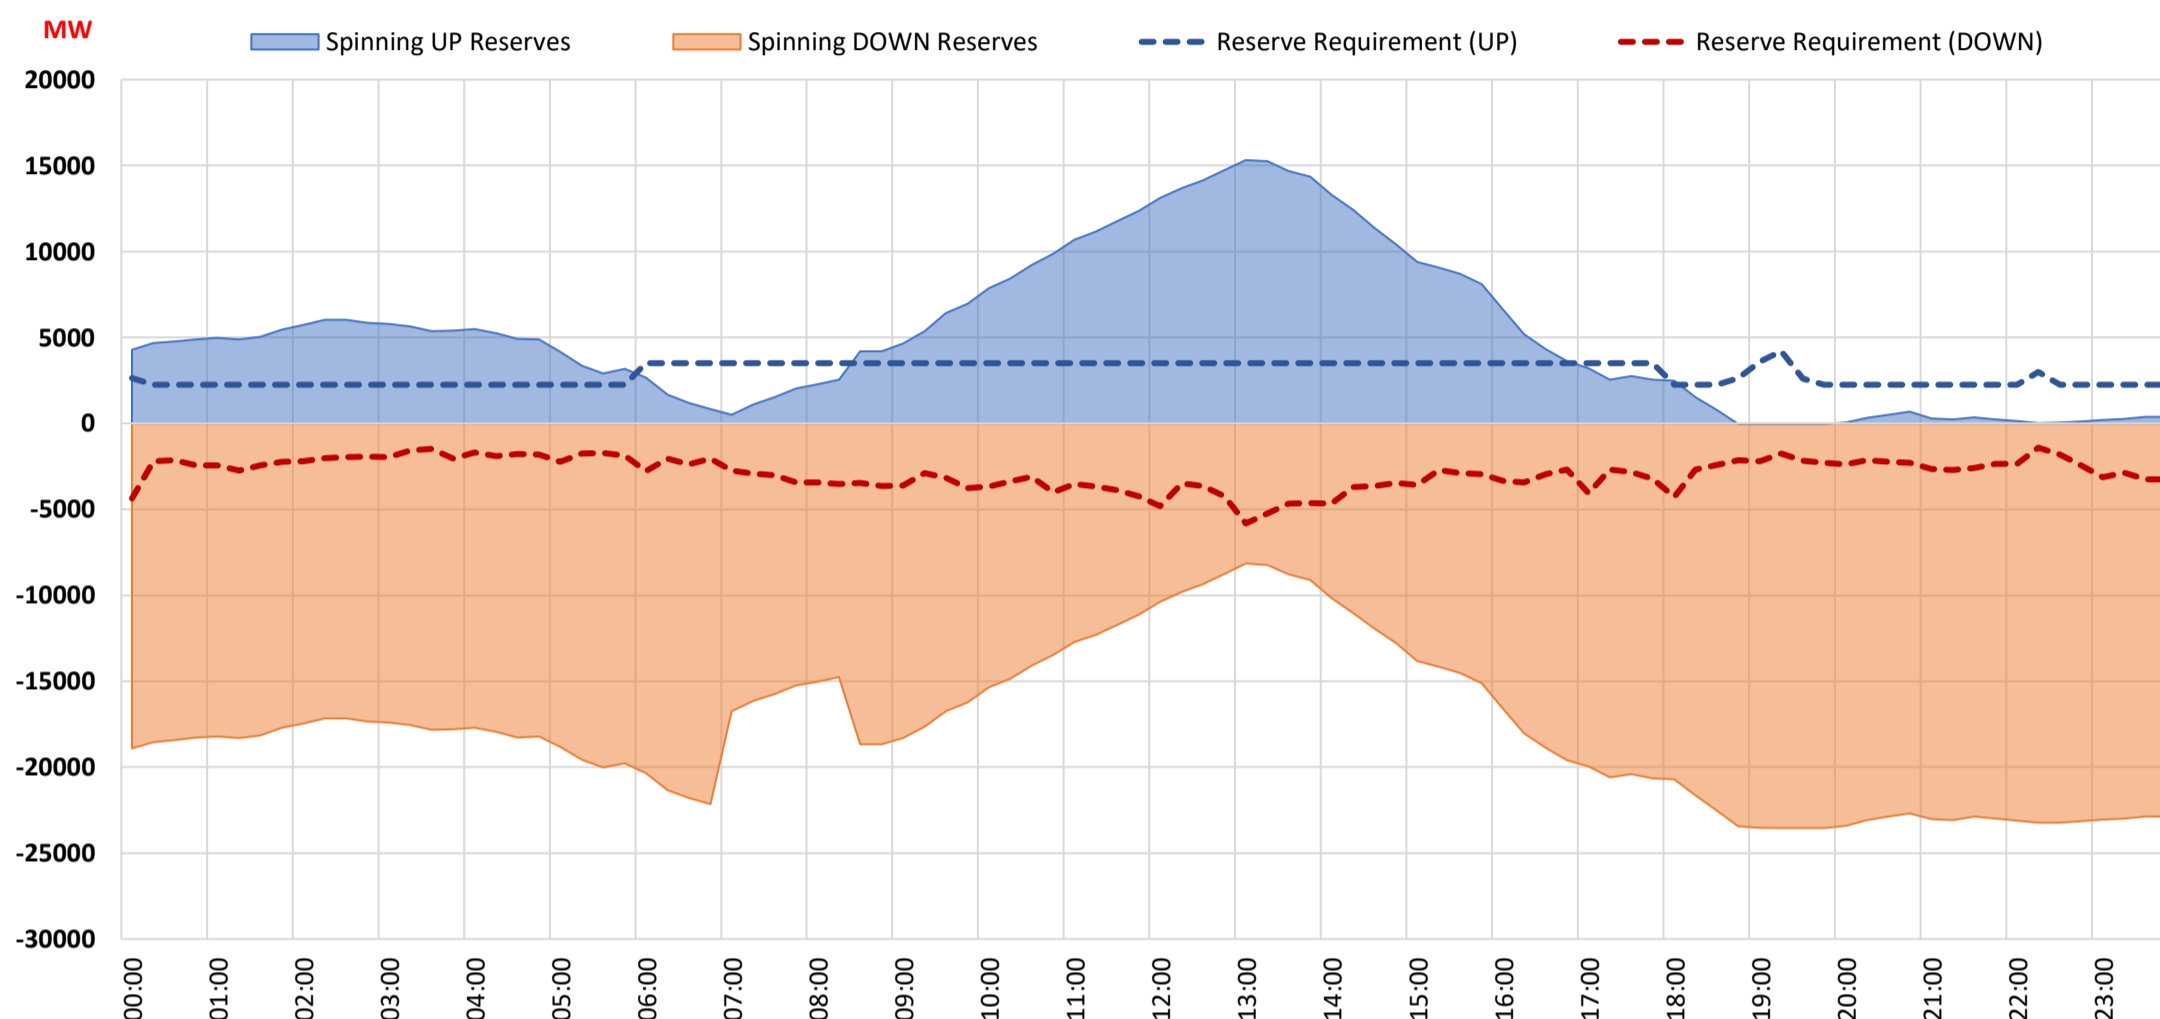


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 24-03-2025

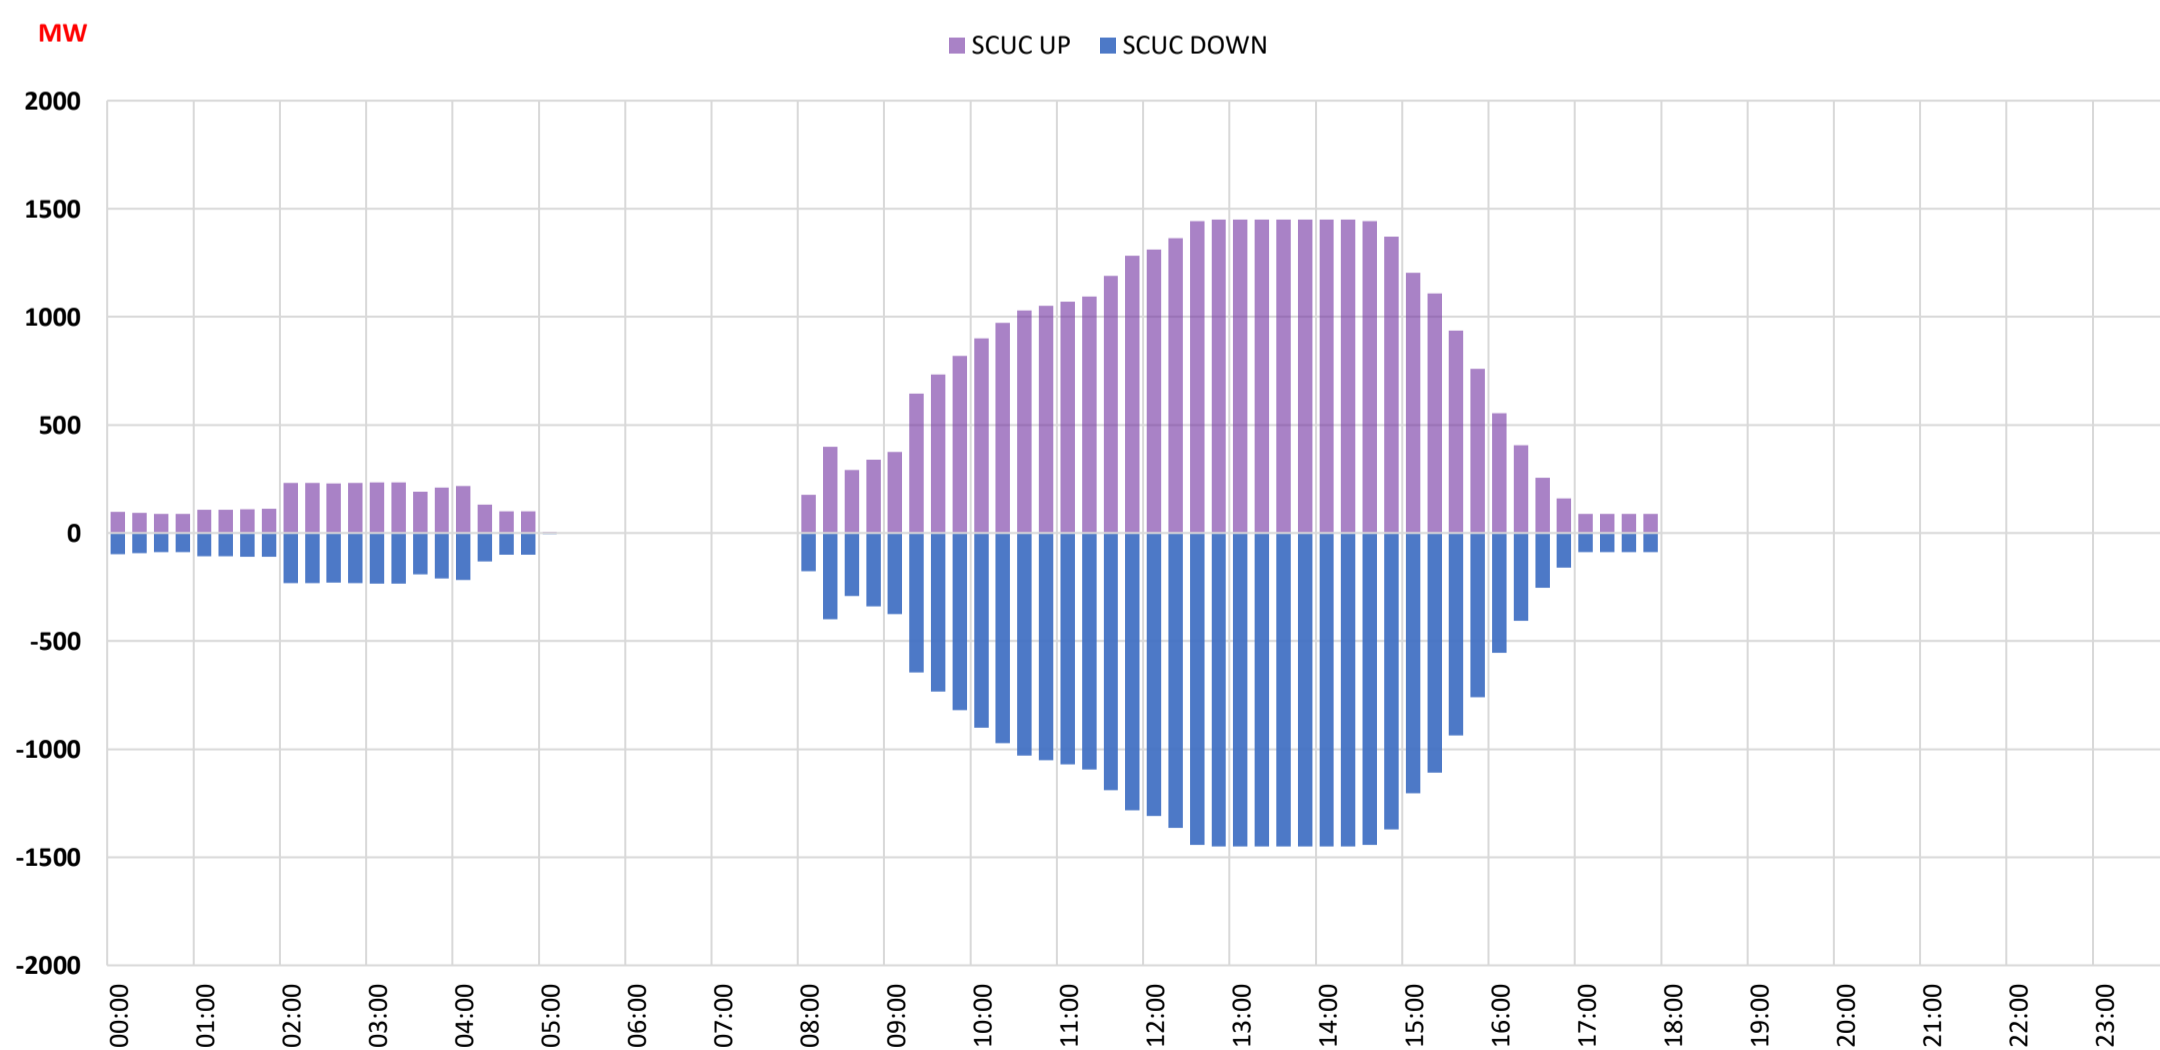


SCUC-Up Scheduled (MWh)	9586
SCUC-Down Scheduled (MWh)	-9586

Tertiary Reserve Ancillary Services (TRAS) Despatched for 24-03-2025

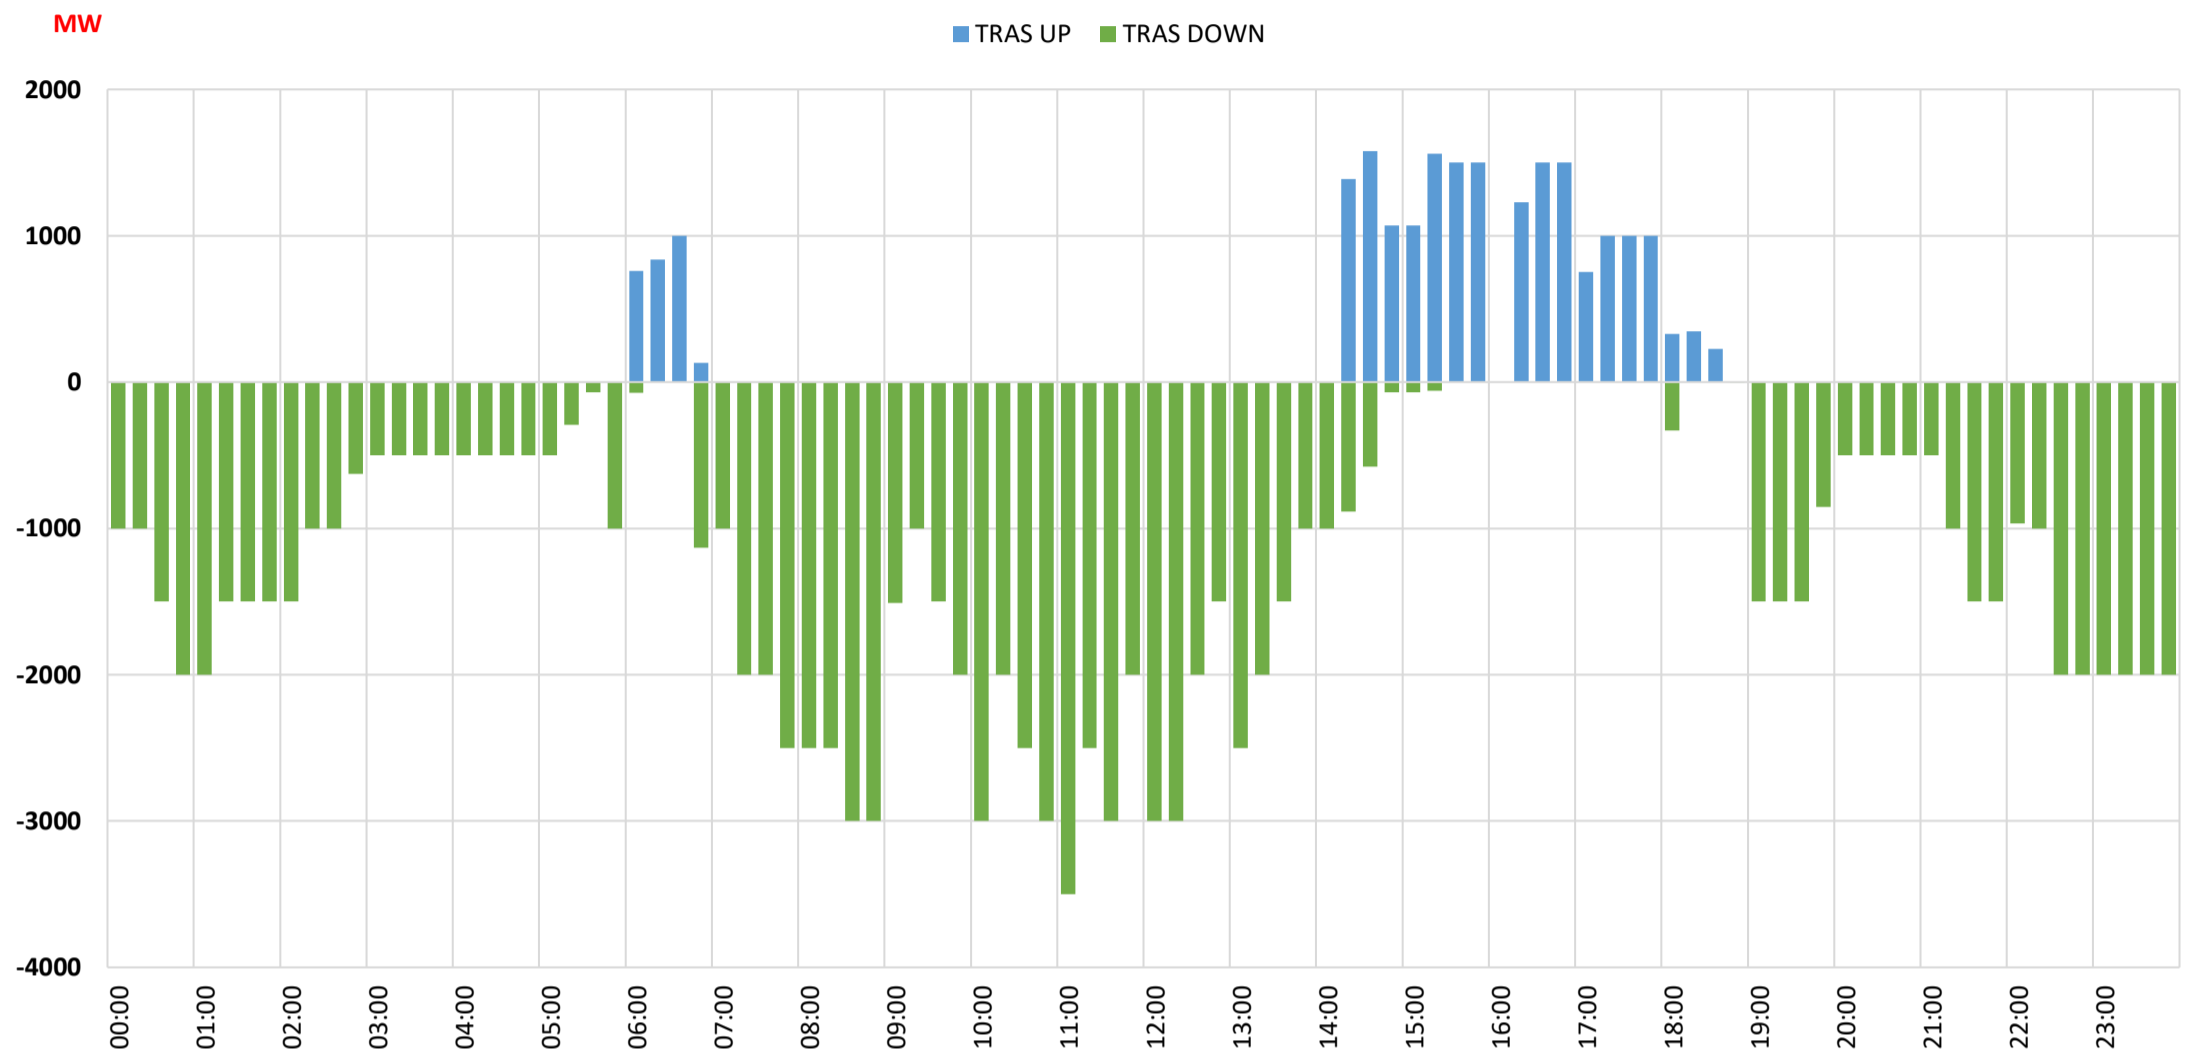

Secondary Reserve Ancillary Services (SRAS) Profile for 24-03-2025

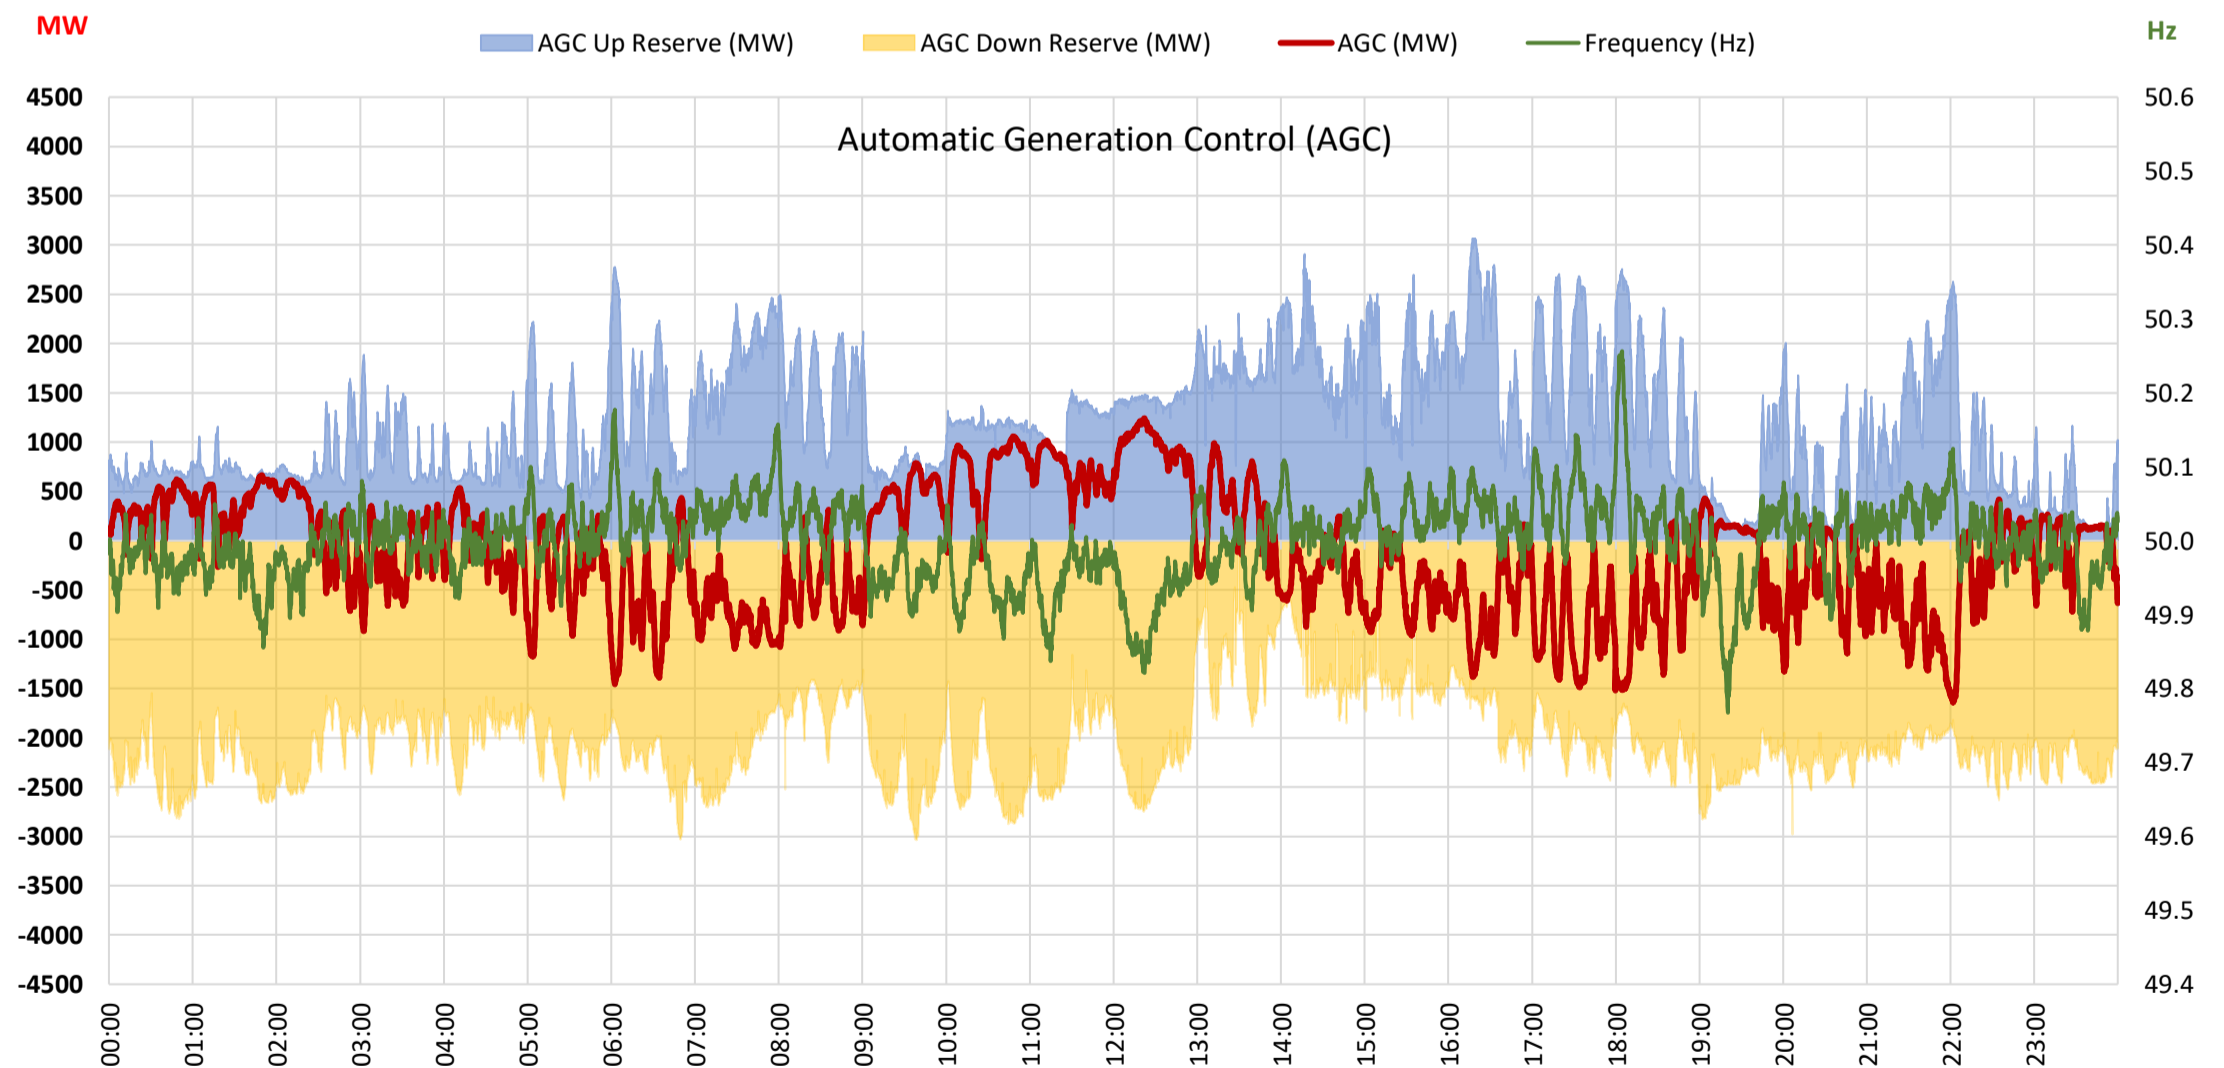

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	4659	-7566	1244	-1642	-121
TRAS:	4769	-28079	1500	-3500	-971
SRAS+TRAS:	9427	-35646	1670	-3914	-1092