


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 25/03/2025

Reserve Profile for 25-03-2025

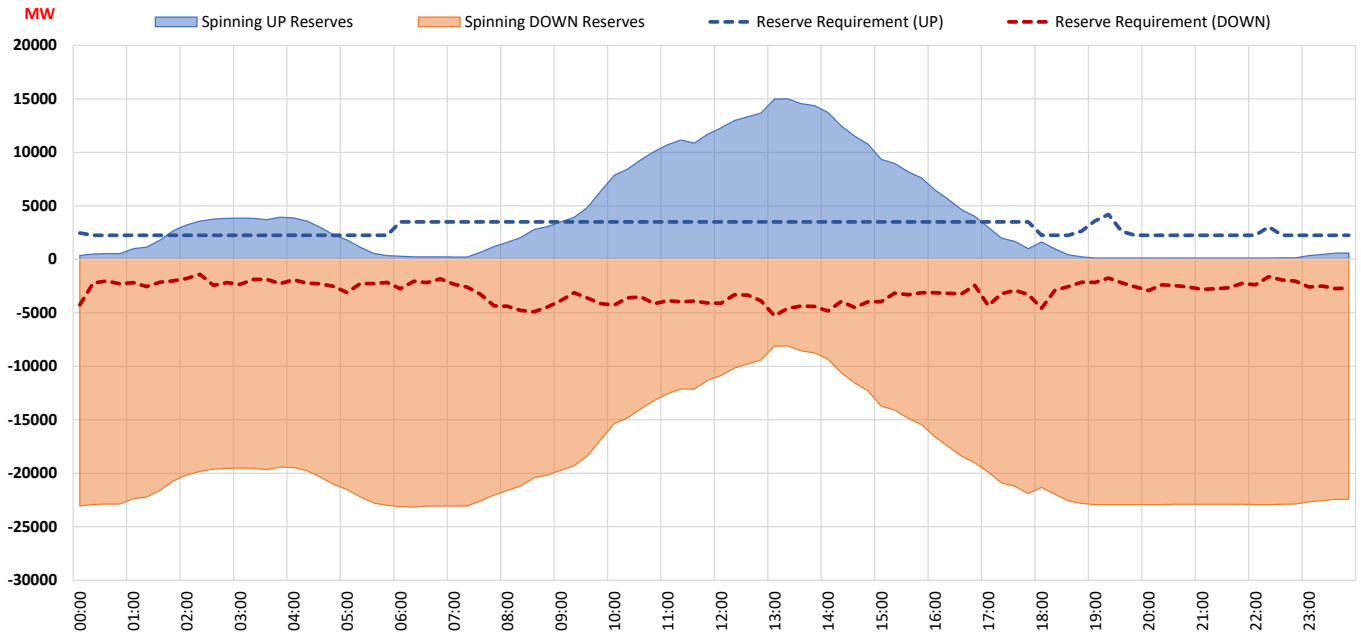


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 25-03-2025

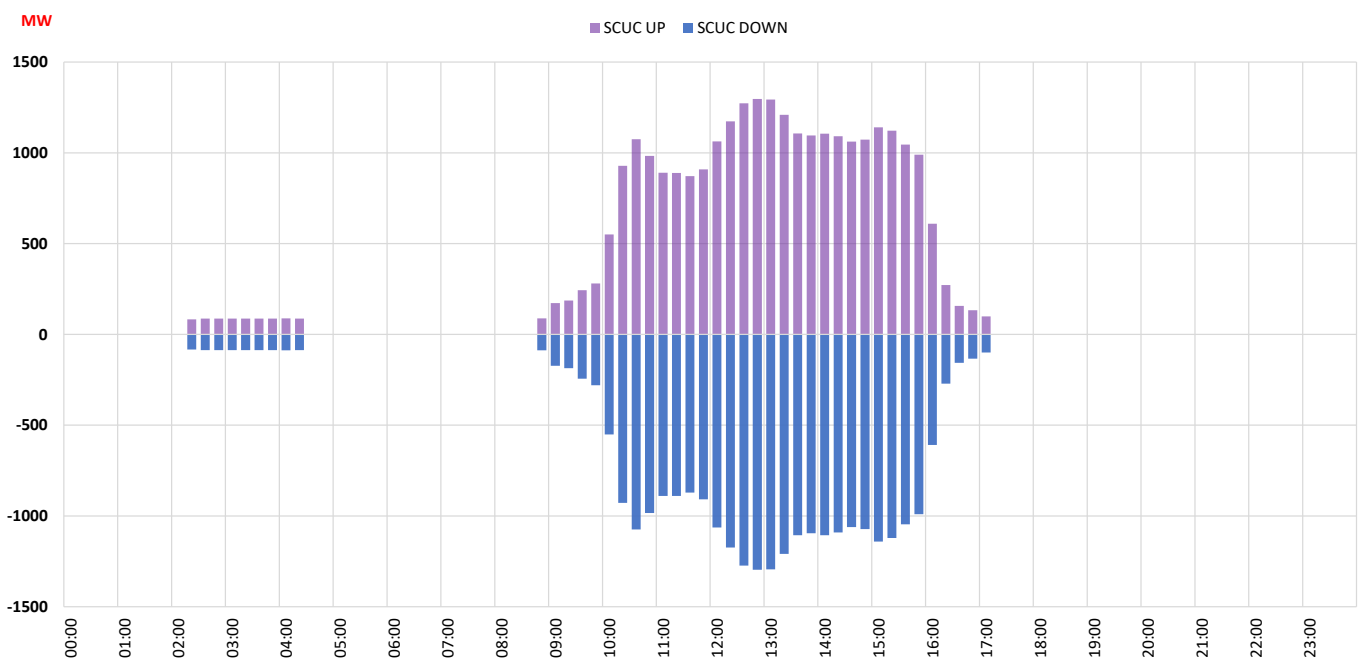


SCUC-Up Scheduled (MWh)	7064
SCUC-Down Scheduled (MWh)	-7064

Tertiary Reserve Ancillary Services (TRAS) Despatched for 25-03-2025

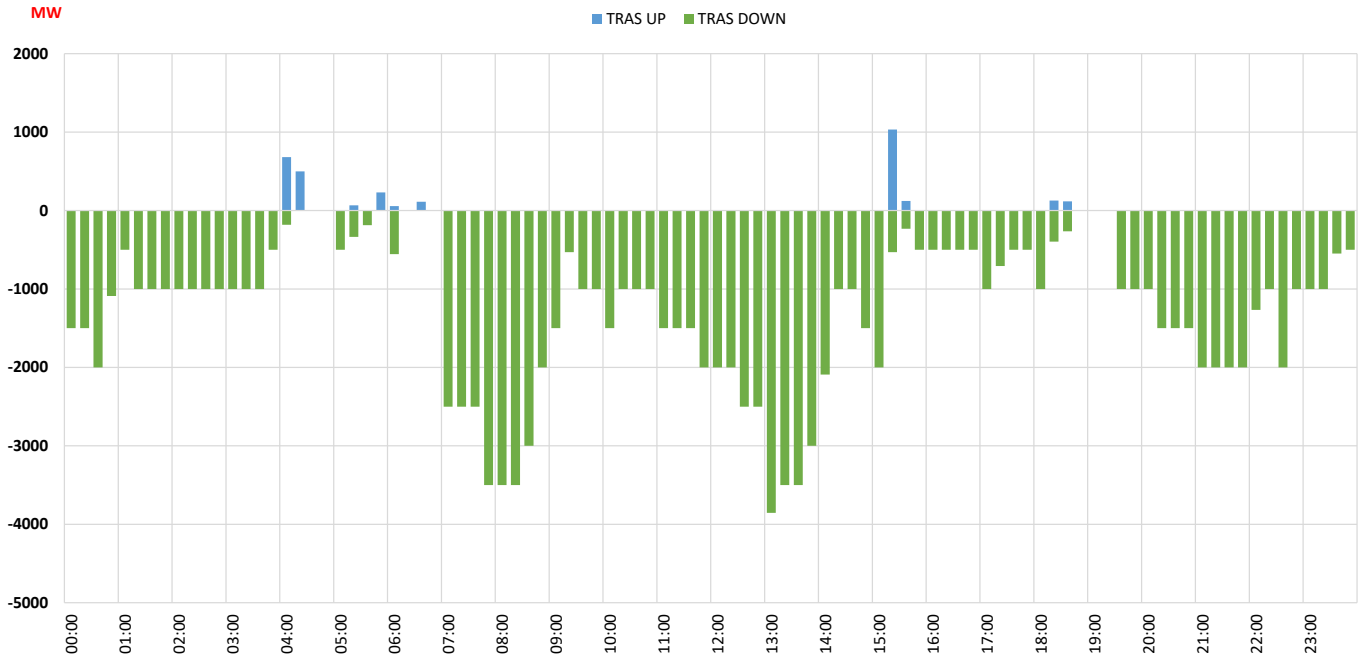

Secondary Reserve Ancillary Services (SRAS) Profile for 25-03-2025

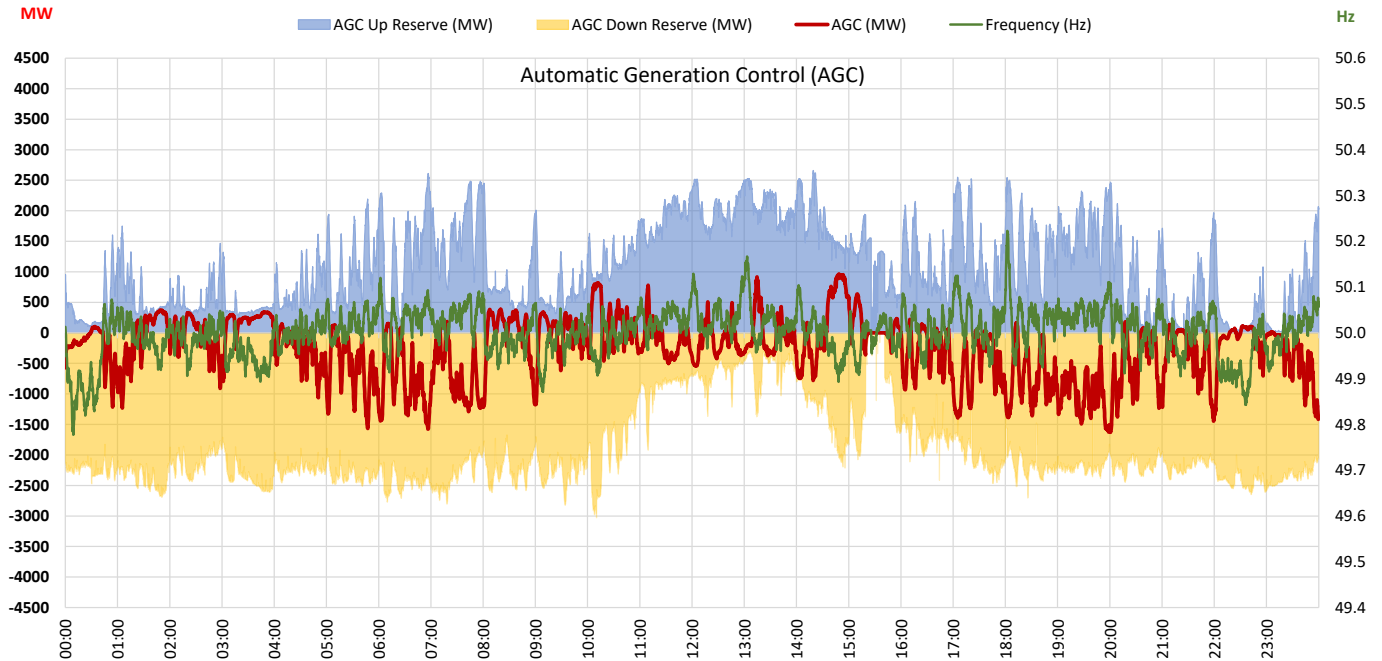

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	1730	-8143	964	-1627	-267
TRAS:	461	-29393	500	-3853	-1206
SRAS+TRAS:	2190	-37536	650	-4735	-1473