


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 28/03/2025

Reserve Profile for 28-03-2025

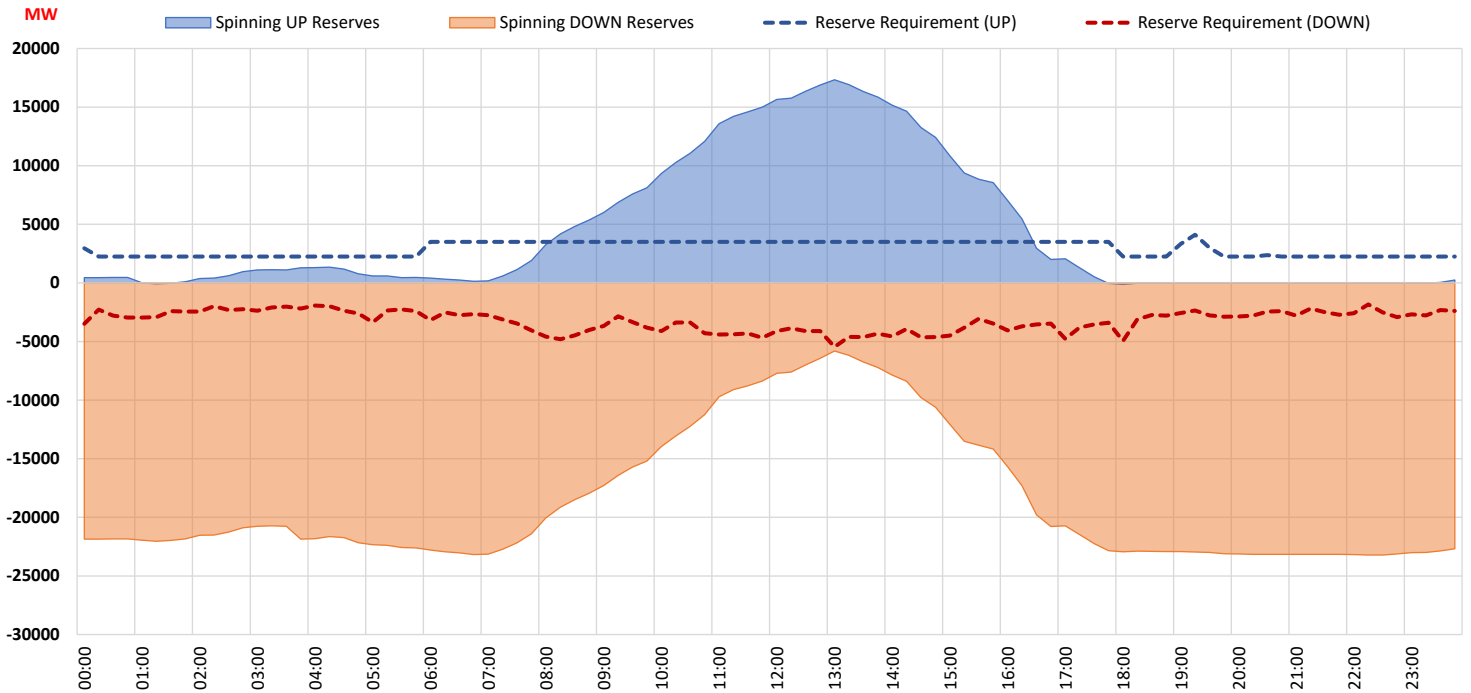


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 28-03-2025

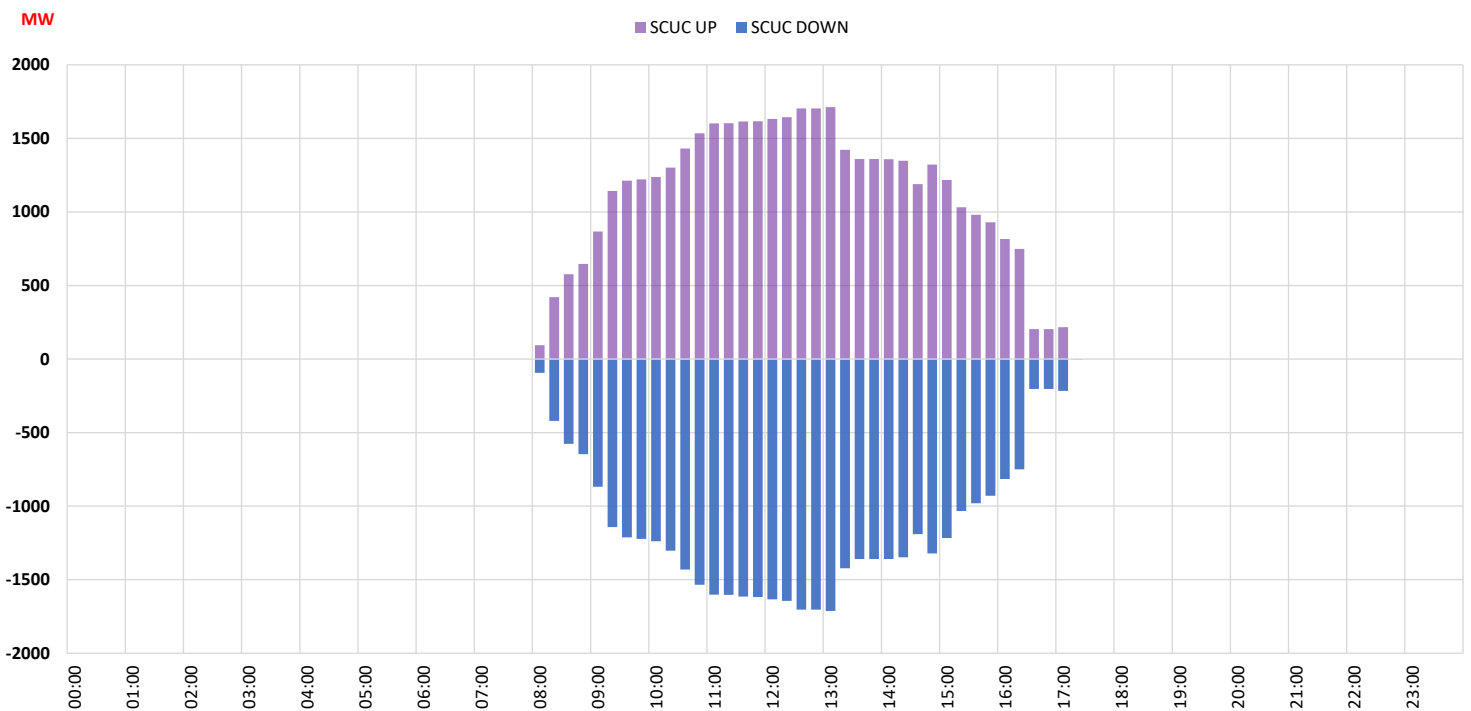


| | |
|---------------------------|--------|
| SCUC-Up Scheduled (MWh) | 10557 |
| SCUC-Down Scheduled (MWh) | -10557 |

Tertiary Reserve Ancillary Services (TRAS) Despatched for 28-03-2025

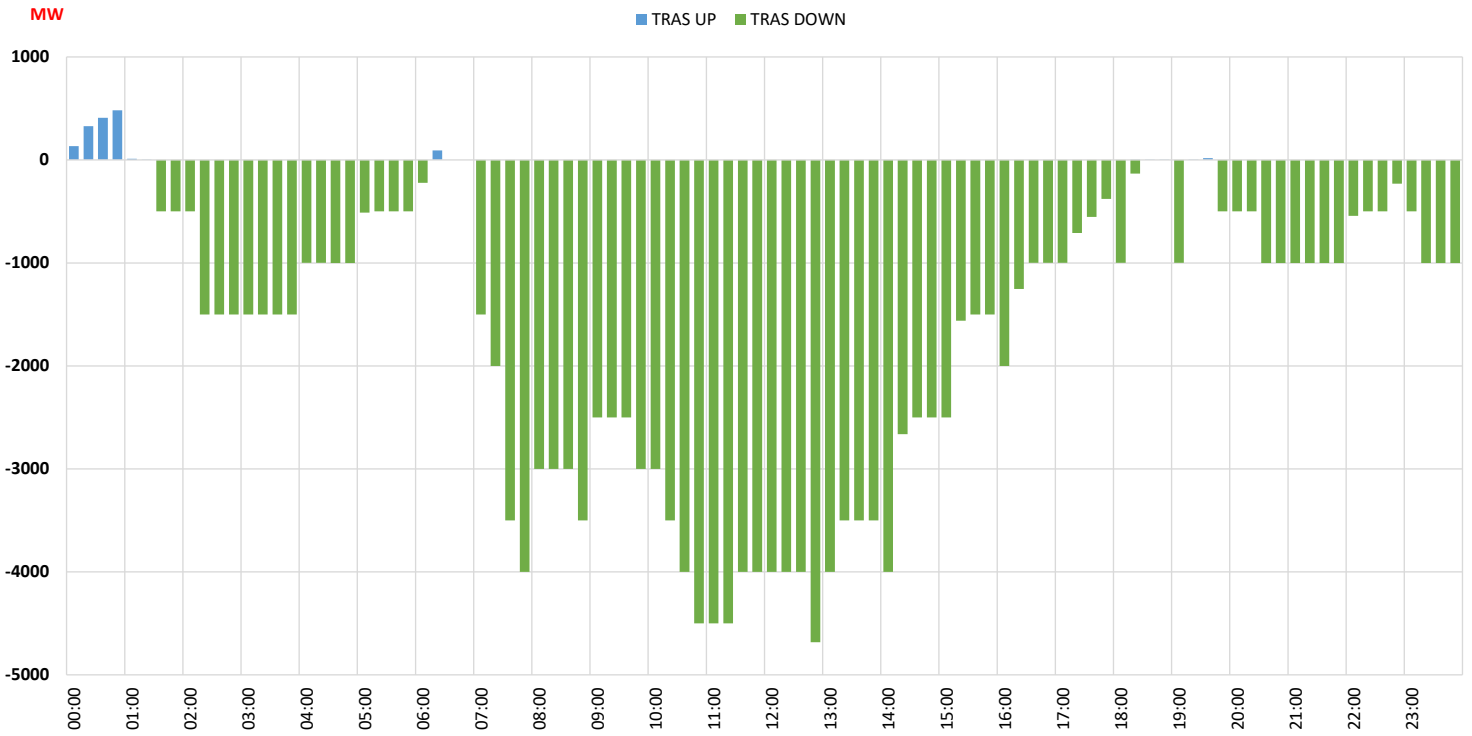

Secondary Reserve Ancillary Services (SRAS) Profile for 28-03-2025

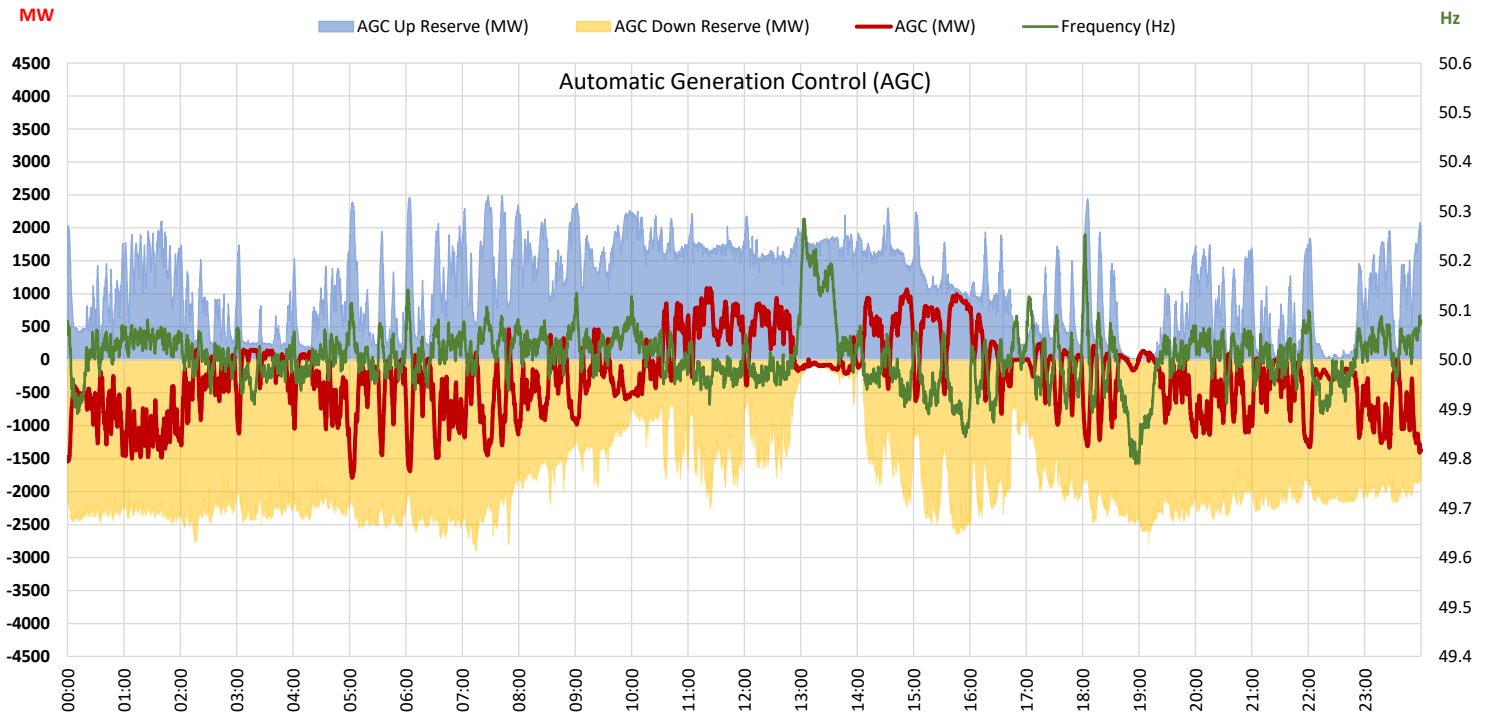

| | Up MWh | Down MWh | Max MW | Min MW | Avg MW |
|-------------------|--------|----------|--------|--------|--------|
| SRAS: | 2734 | -8776 | 1089 | -1789 | -252 |
| TRAS: | 369 | -39235 | 482 | -4683 | -1619 |
| SRAS+TRAS: | 3103 | -48011 | 236 | -5132 | -1871 |