


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 29/03/2025

Reserve Profile for 29-03-2025

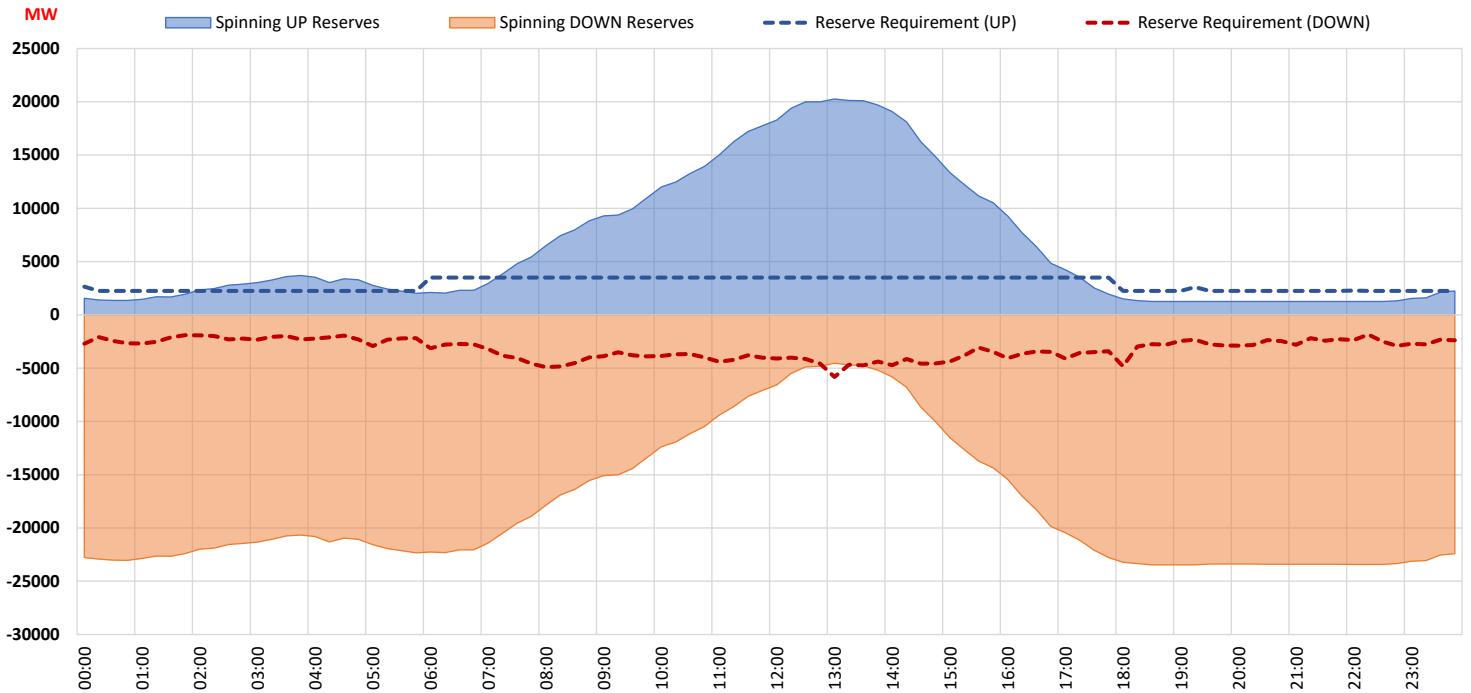


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 29-03-2025

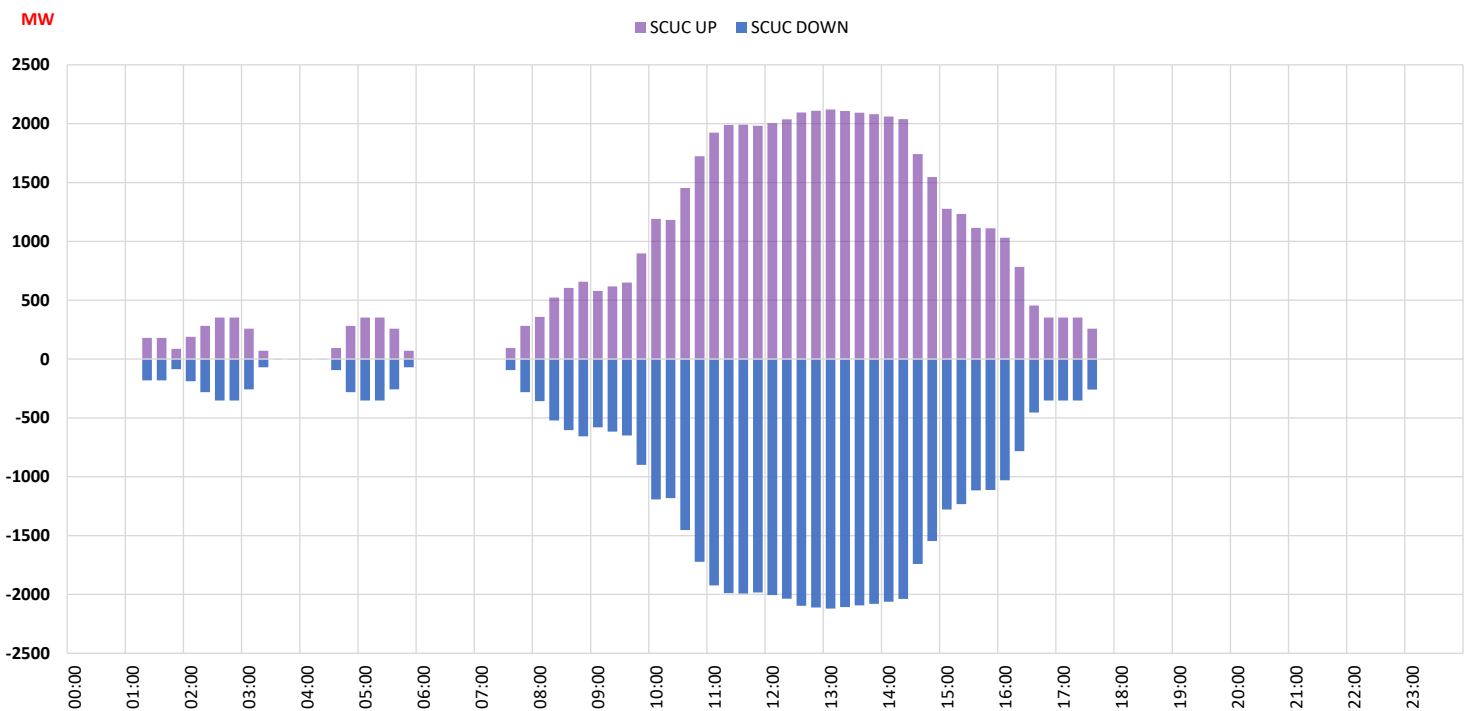


| | |
|---------------------------|--------|
| SCUC-Up Scheduled (MWh) | 13605 |
| SCUC-Down Scheduled (MWh) | -13605 |

Tertiary Reserve Ancillary Services (TRAS) Despatched for 29-03-2025

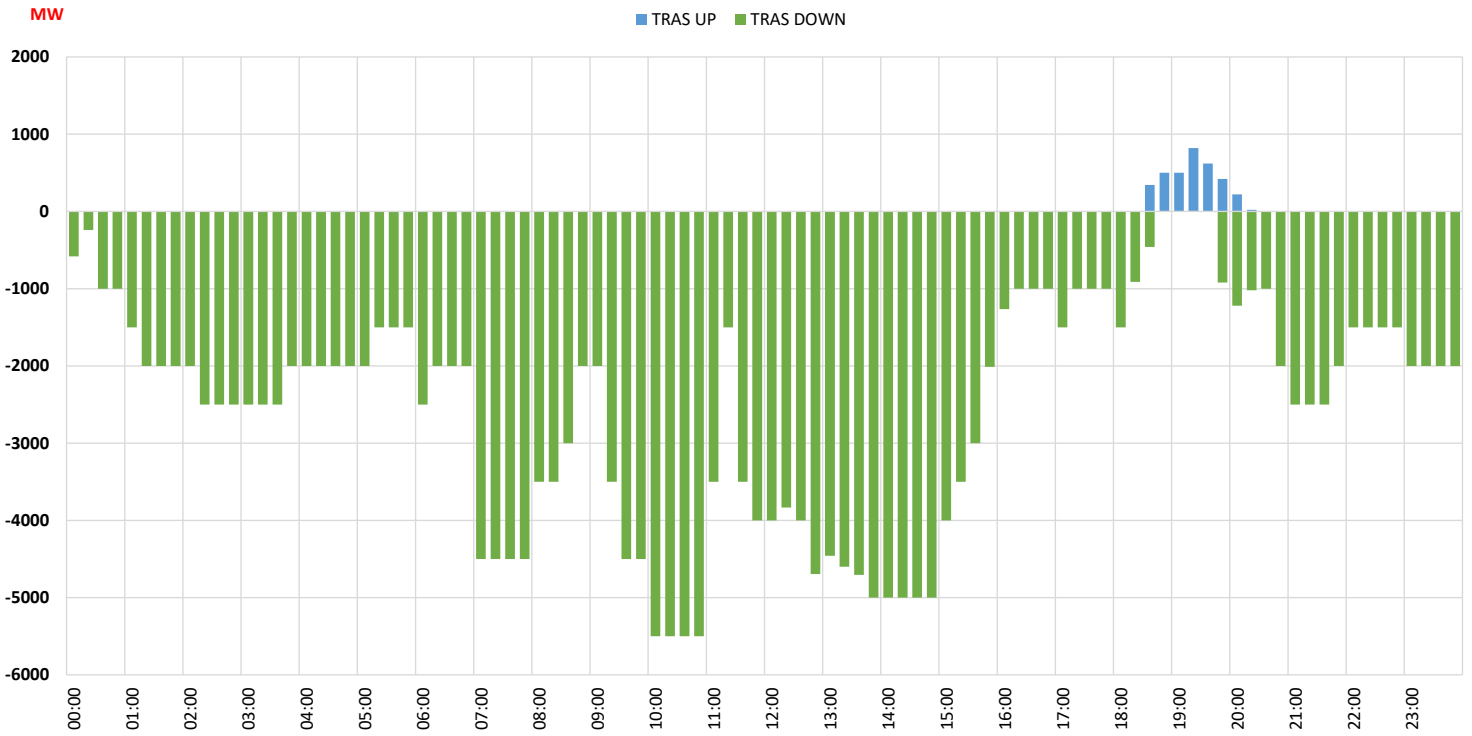

Secondary Reserve Ancillary Services (SRAS) Profile for 29-03-2025

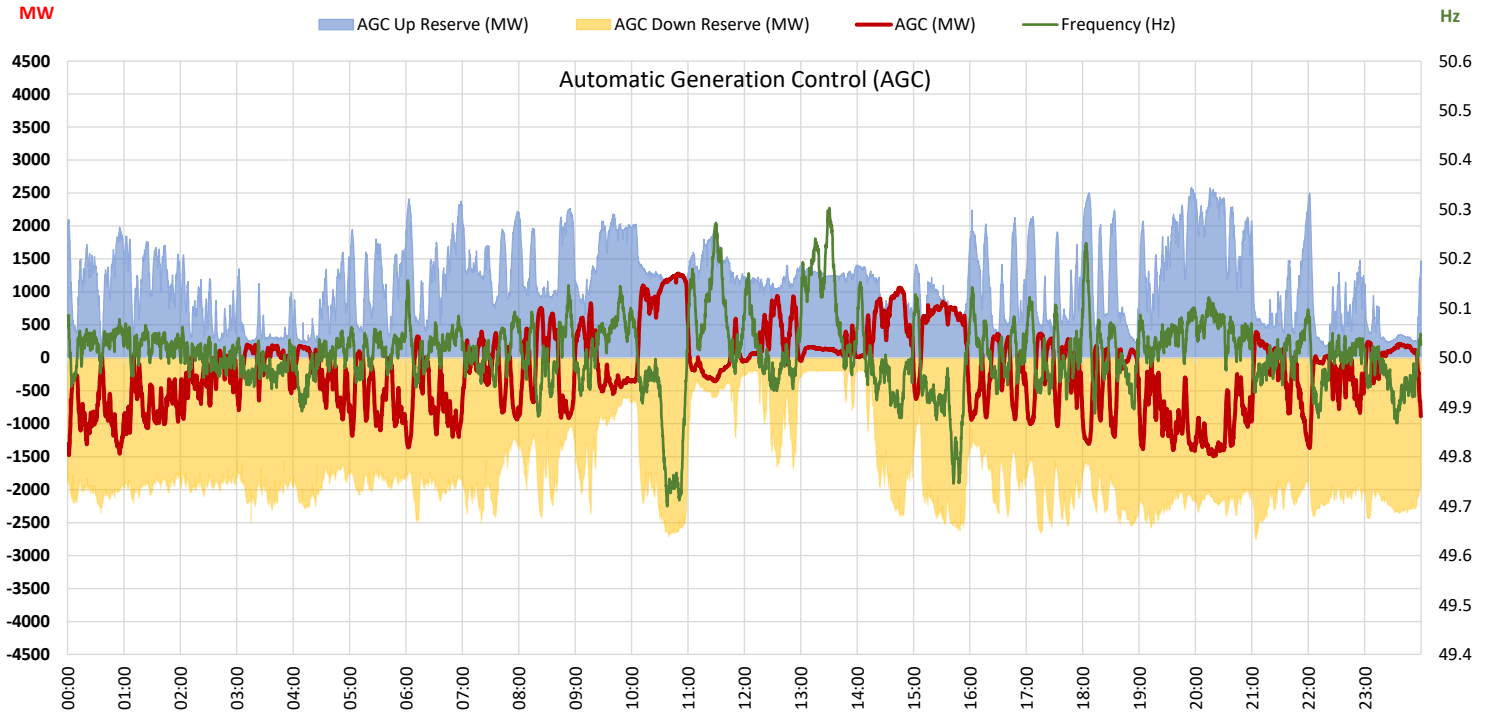

| | Up MWh | Down MWh | Max MW | Min MW | Avg MW |
|-------------------|--------|----------|--------|--------|--------|
| SRAS: | 3418 | -8247 | 1277 | -1496 | -201 |
| TRAS: | 610 | -59853 | 820 | -5500 | -2468 |
| SRAS+TRAS: | 4028 | -68100 | 629 | -5863 | -2670 |