


Grid Controller of India Limited (GRID-INDIA)

Daily Report on Ancillary Services and Security Constrained Unit Commitment (SCUC)


For Date: 31/03/2025

Reserve Profile for 31-03-2025

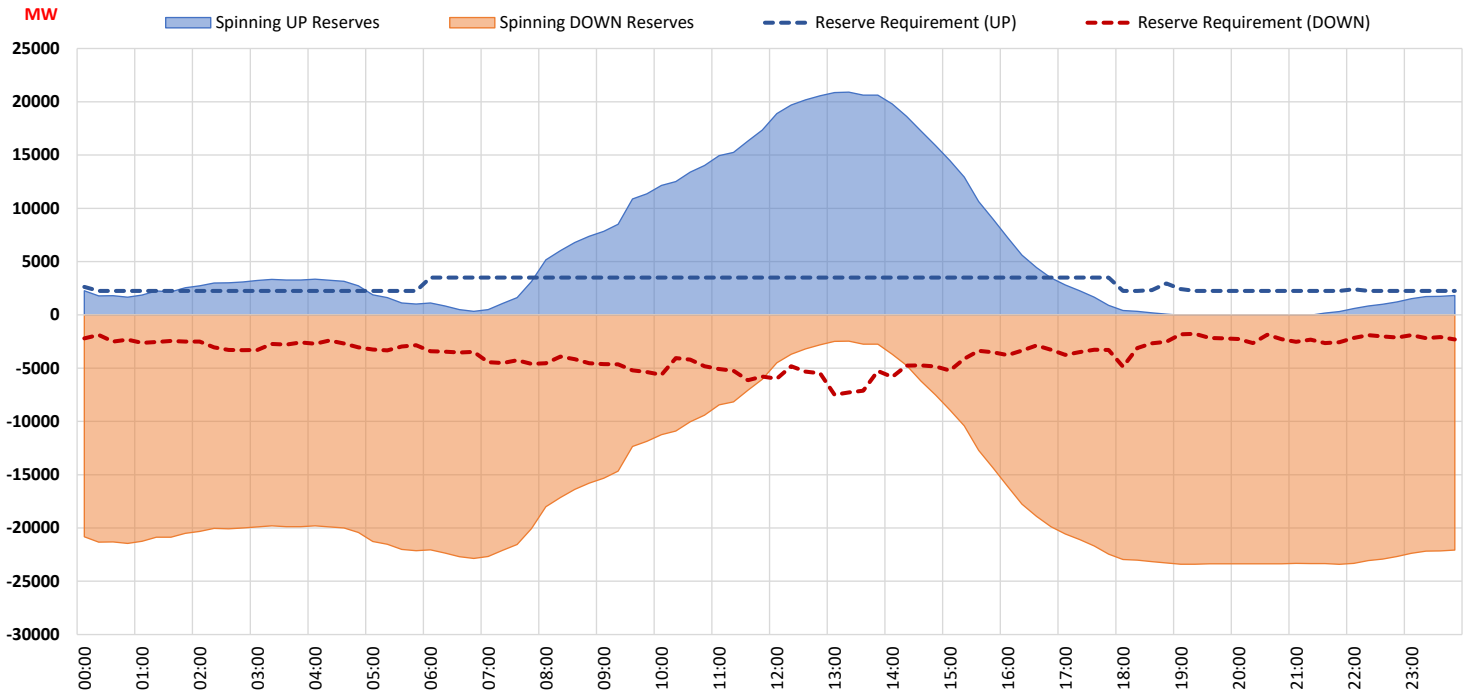


Reserves at the inter-state level are depicted. The reserve requirement at the inter-state level has been considered half of the total system reserve requirement.

SCUC Scheduled for 31-03-2025

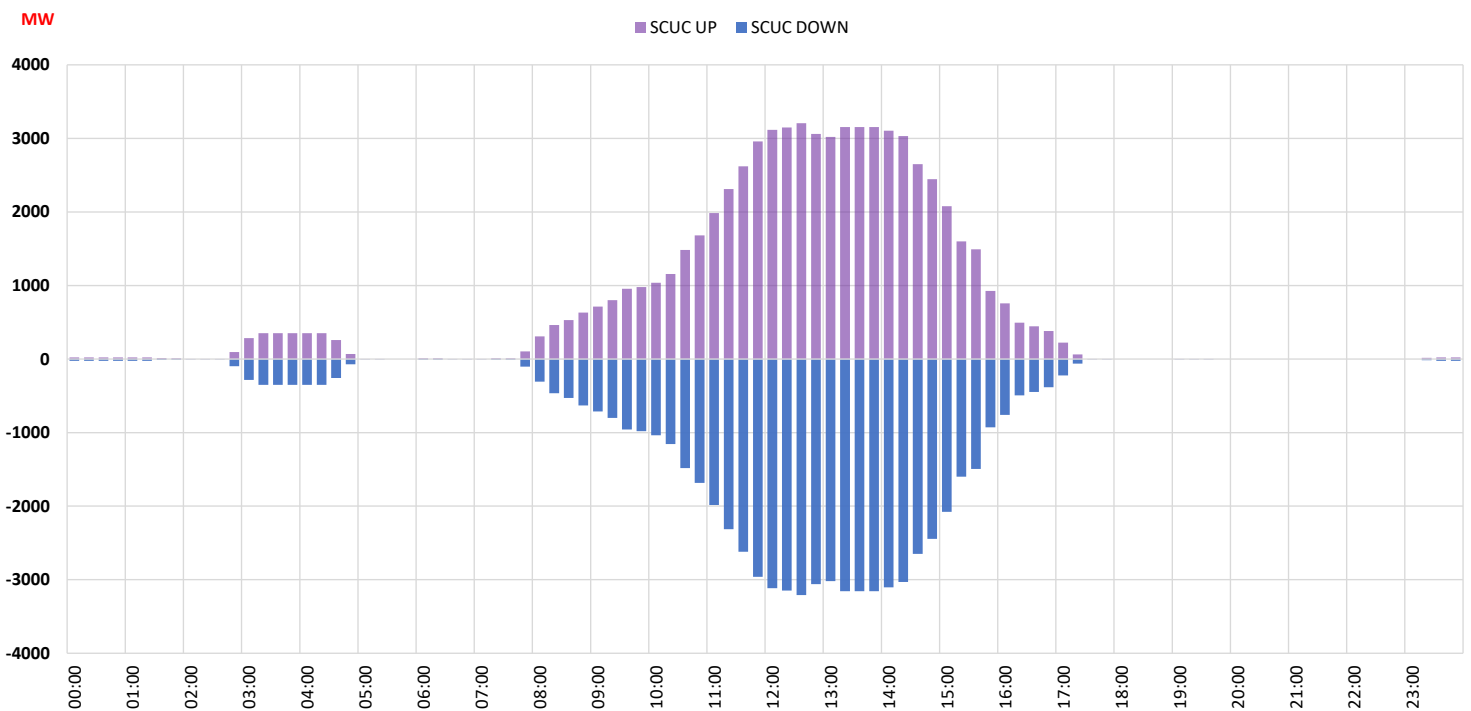


SCUC-Up Scheduled (MWh)	17043
SCUC-Down Scheduled (MWh)	-17043

Tertiary Reserve Ancillary Services (TRAS) Despatched for 31-03-2025

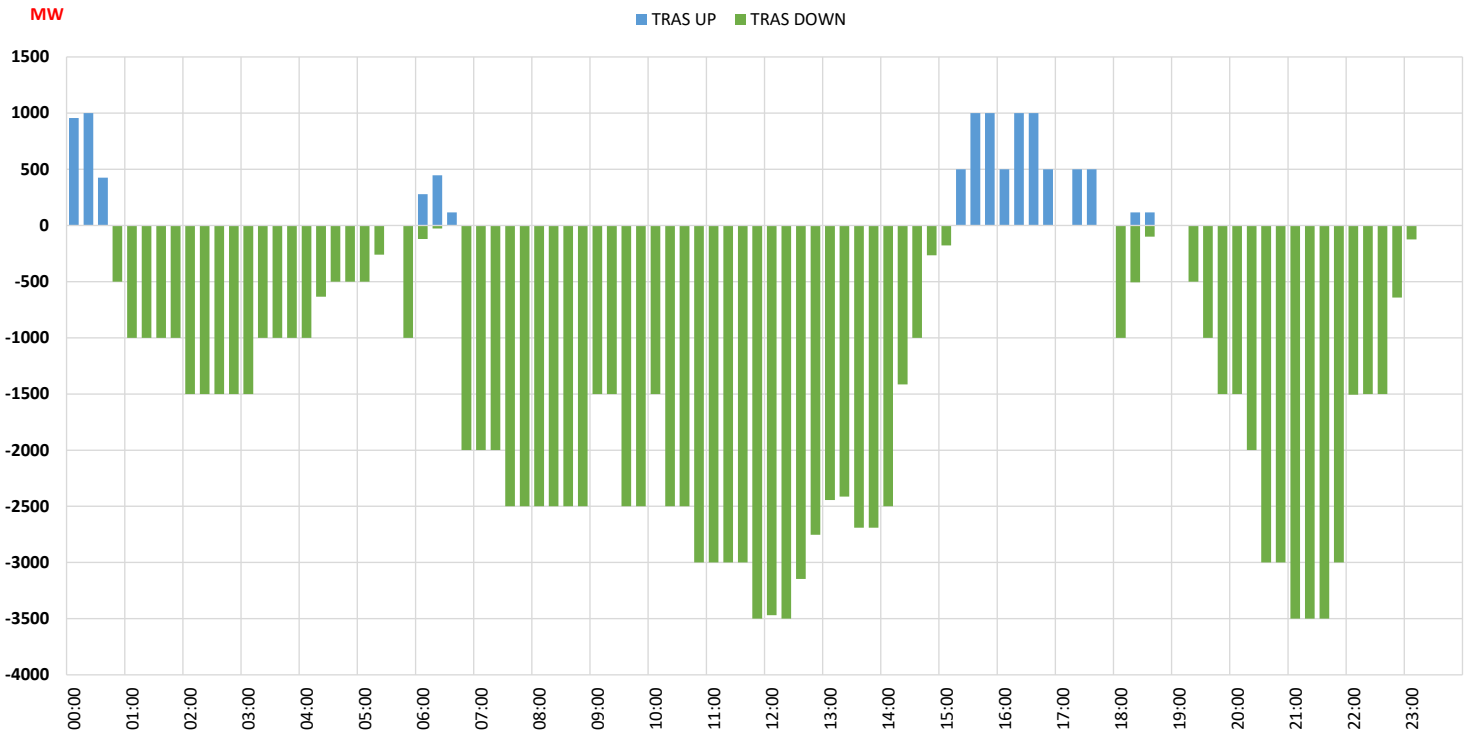

Secondary Reserve Ancillary Services (SRAS) Profile for 31-03-2025

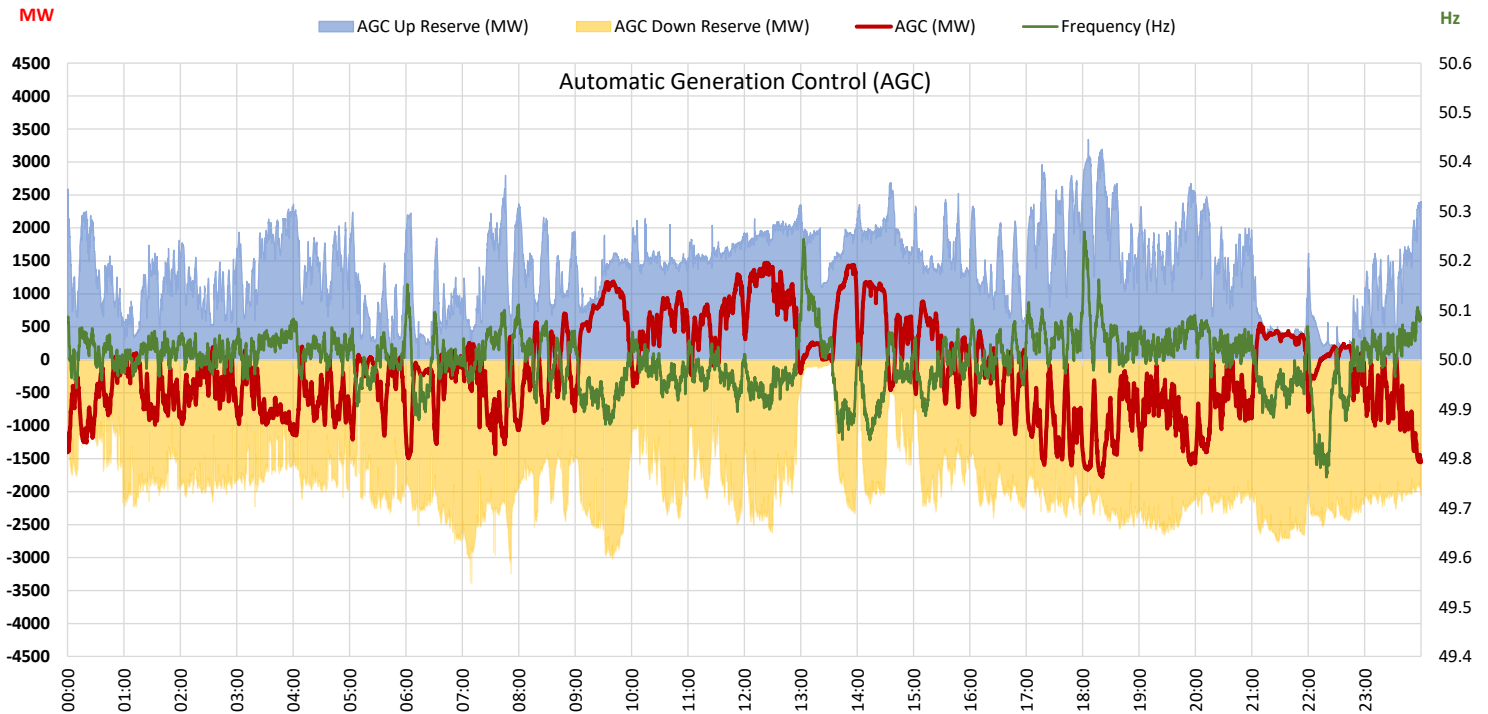

	Up MWh	Down MWh	Max MW	Min MW	Avg MW
SRAS:	4946	-9122	1472	-1775	-174
TRAS:	2398	-32879	1000	-3500	-1270
SRAS+TRAS:	7344	-42001	1343	-4288	-1444