


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 05-10-2015

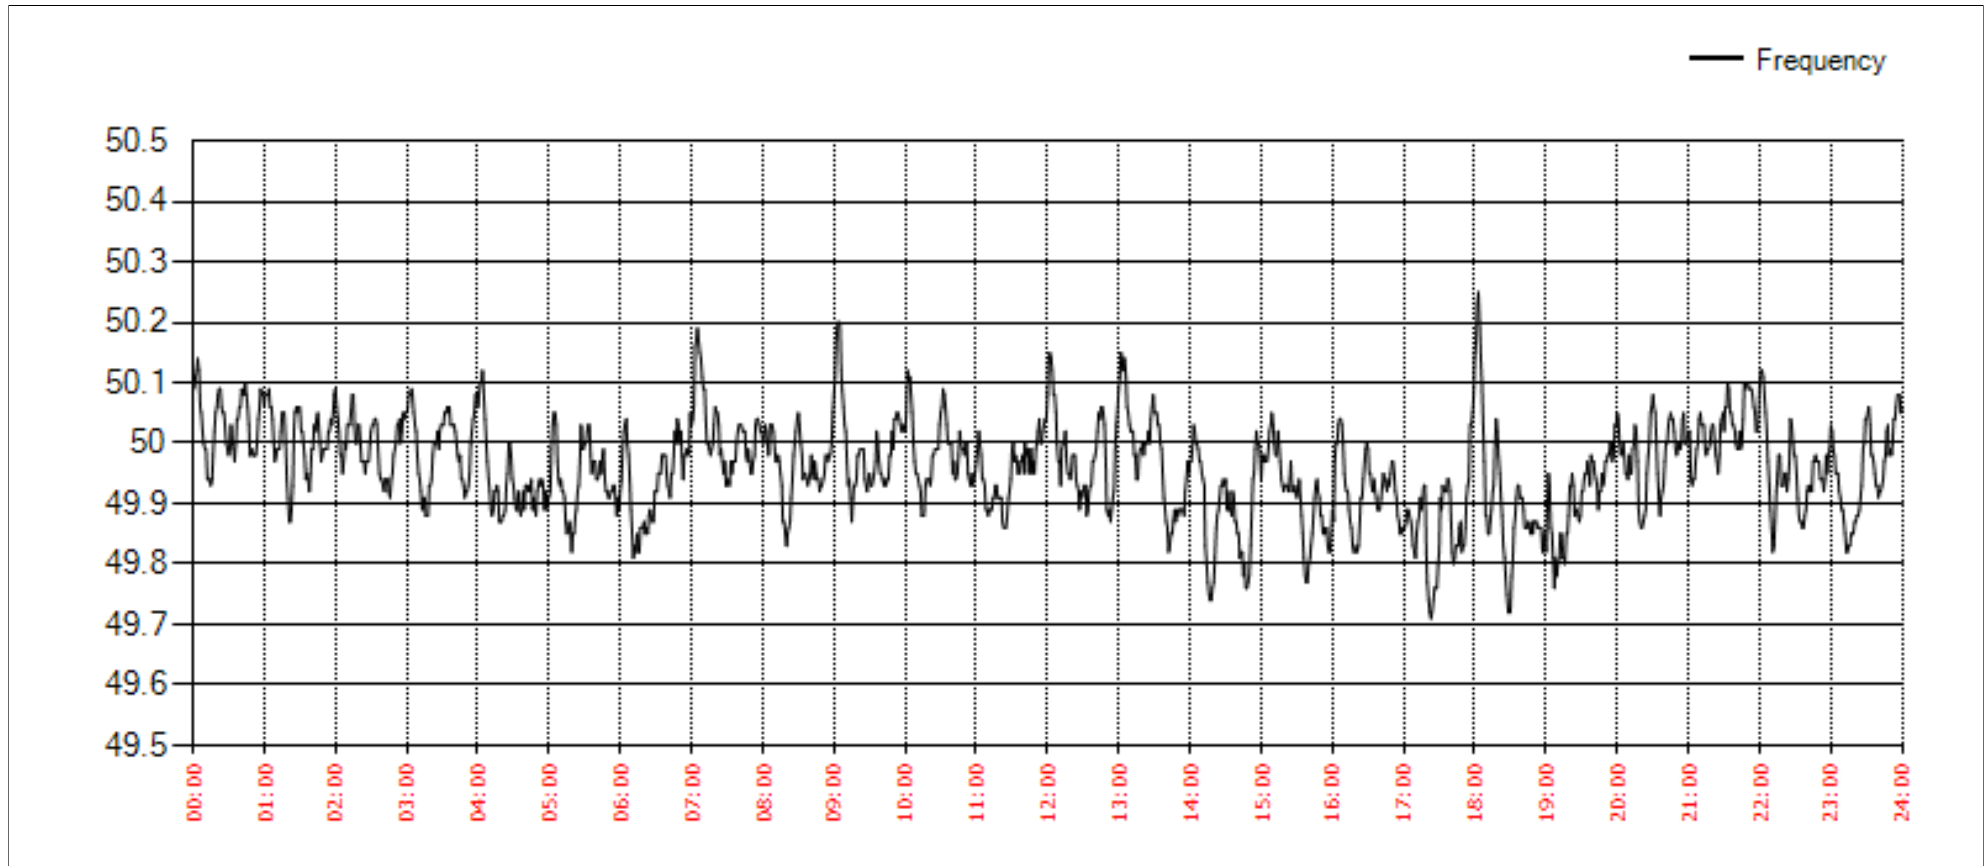

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	0	31	286	317	648	426	987	87	136	2	1438	493
%	0.000	0.000	2.153	19.861	22.014	45.000	29.583	68.542	6.042	9.444	0.139	99.861	34.236

Average Frequency the Day:			49.96	Standard Deviation:			0.079	Frequency Deviation Index:			0.079
----------------------------	--	--	-------	---------------------	--	--	-------	----------------------------	--	--	-------

	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE		
	FREQUENCY	TIME	49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY	TIME	
MAX	50.25	18:03:00					49	MAX	50.09	7:15
MIN	49.71	17:23:00	0	0	0	0		MIN	49.79	17:30
Out of IEGC Band		% of Time	31.458					No of Hours		7.54992