




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

06-Feb-15

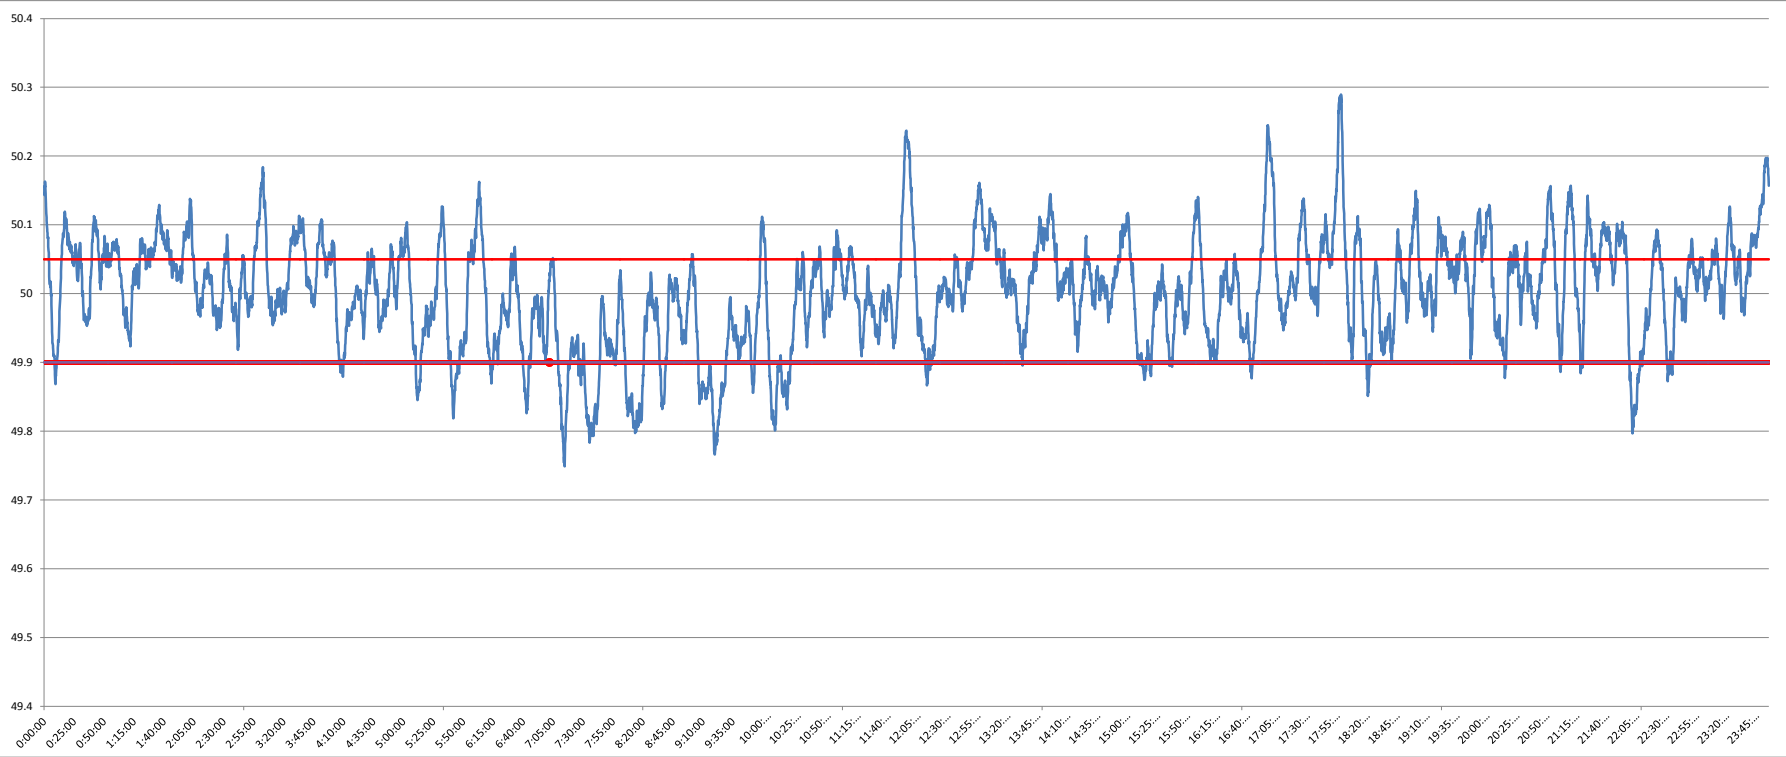

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	10.14	31.46	0.61	9.53	36.09	45.27	7.74	62.60	99.24	31.55	18.87	53.68	36.99	27.26	0.76

Average Frequency	50.00	Frequency Variation Index :	0.061	Standard Deviation :	0.078
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency	
MAX	50.29 18:03:00
Min	49.75 7:14:40

15 minute average Frequency	
Max	50.123 0:00:00
Min	49.839 7:45:00

No. of excursion above 50.03 Hz	125
No. of excursion below 49.97 Hz	110
No. of excursion above 50.00 Hz	137
No. of excursion below 50.00 Hz	139

Average time freq remains below 49.97 per excursion	0:04:07	Average time frequency remains above 50.03 per excursion	0:04:16
--	----------------	---	----------------