


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 12-09-2015

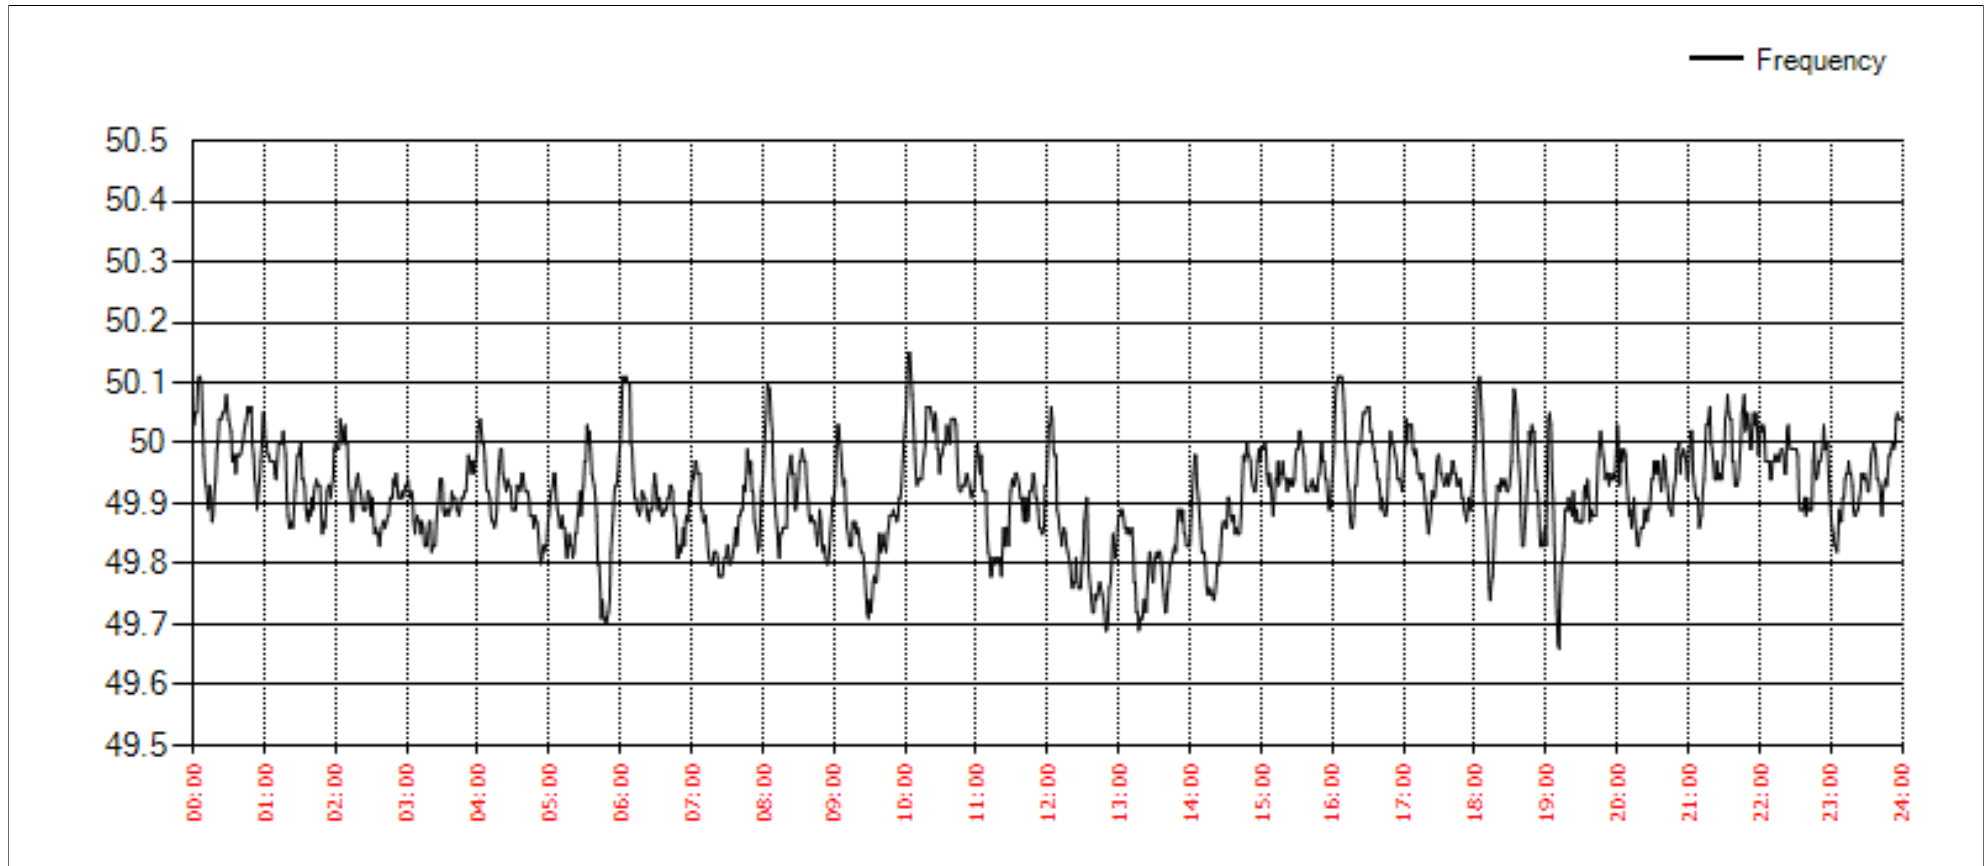

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	5	87	493	585	633	199	804	54	51	0	1435	312
%	0.000	0.347	6.042	34.236	40.625	43.958	13.819	55.833	3.750	3.542	0.000	99.653	21.667

Average Frequency the Day:	49.92	Standard Deviation:	0.081	Frequency Deviation Index:	0.134
-----------------------------------	--------------	----------------------------	--------------	-----------------------------------	--------------

	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE		
	FREQUENCY	TIME	49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY	TIME	
MAX	50.15	10:03:00	0	0	0	3	64	MAX	50.03	16:15
MIN	49.66	19:11:00						MIN	49.75	13:30
Out of IEGC Band	% of Time		44.167					No of Hours		10.60008