


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 13-07-2015

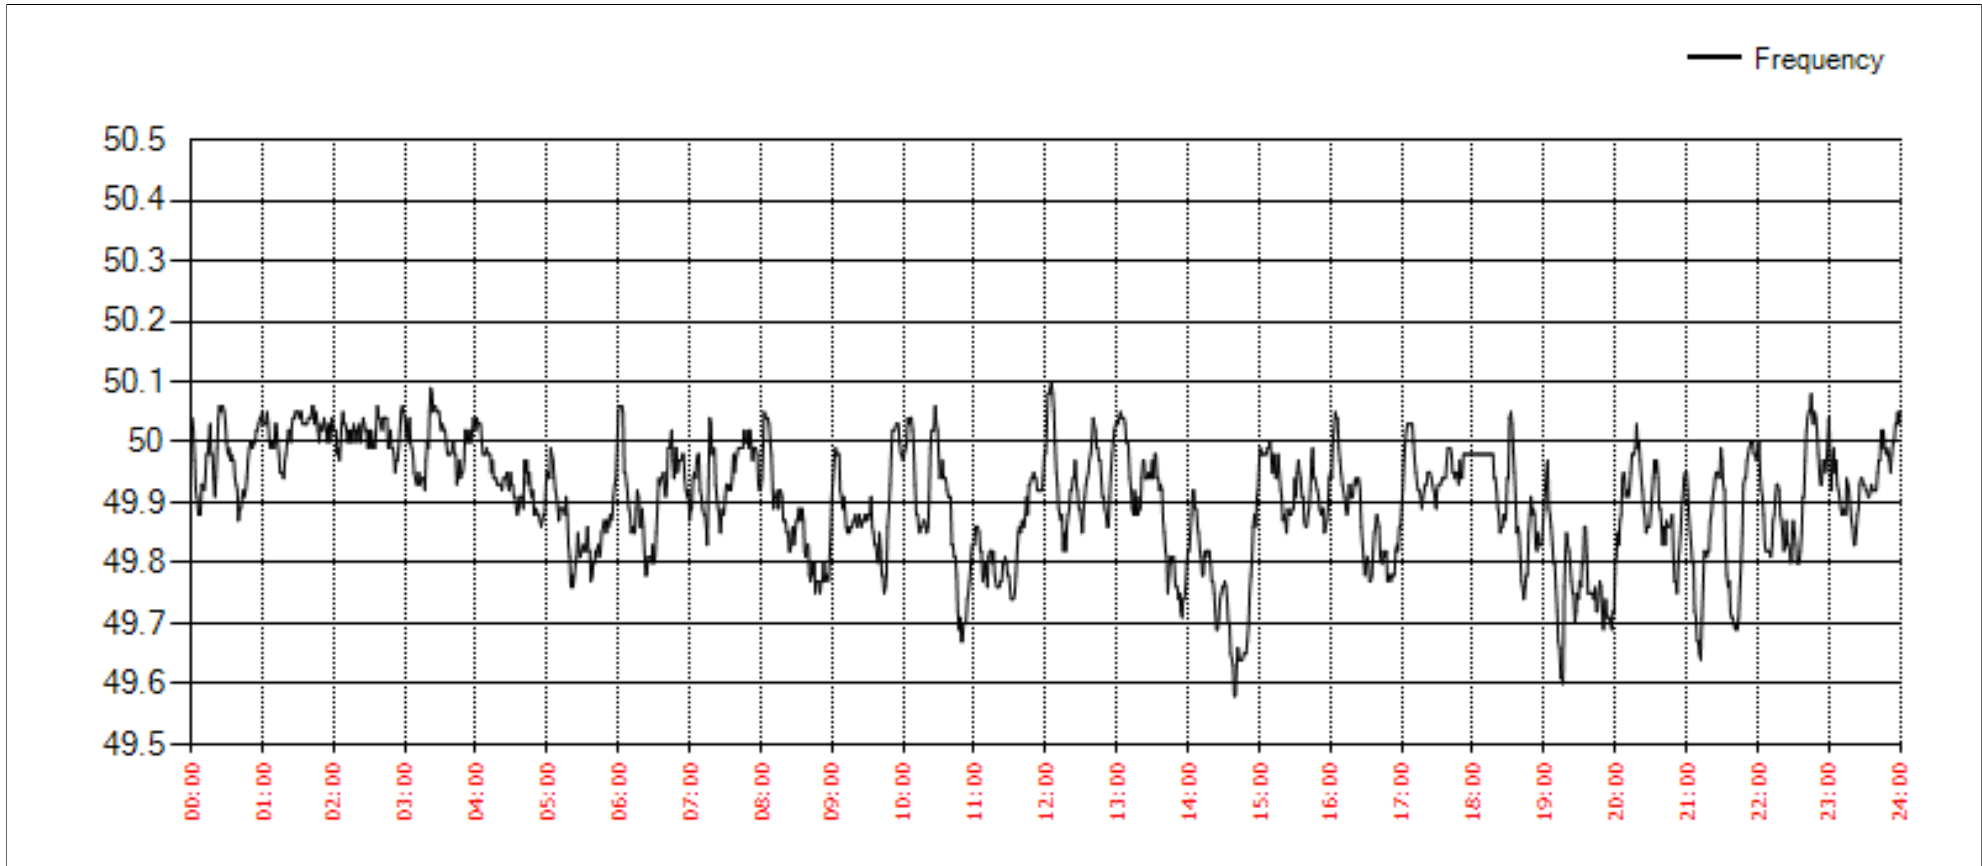

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	33	153	435	621	556	262	798	51	21	0	1407	382
%	0.000	2.292	10.625	30.208	43.125	38.611	18.194	55.417	3.542	1.458	0.000	97.708	26.528

Average Frequency the Day:			49.91	Standard Deviation:			0.095	Frequency Deviation Index:			0.178
----------------------------	--	--	-------	---------------------	--	--	-------	----------------------------	--	--	-------

	INSTANTENEOUS	
	FREQUENCY	TIME
MAX	50.10	12:05:00
MIN	49.58	14:39:00

EXCURSION BELOW:				
49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ
0	0	0	9	48

	QUATERLY HOURLY AVERAGE	
	FREQUENCY	TIME
MAX	50.04	1:45
MIN	49.66	14:45