


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 15-03-2016

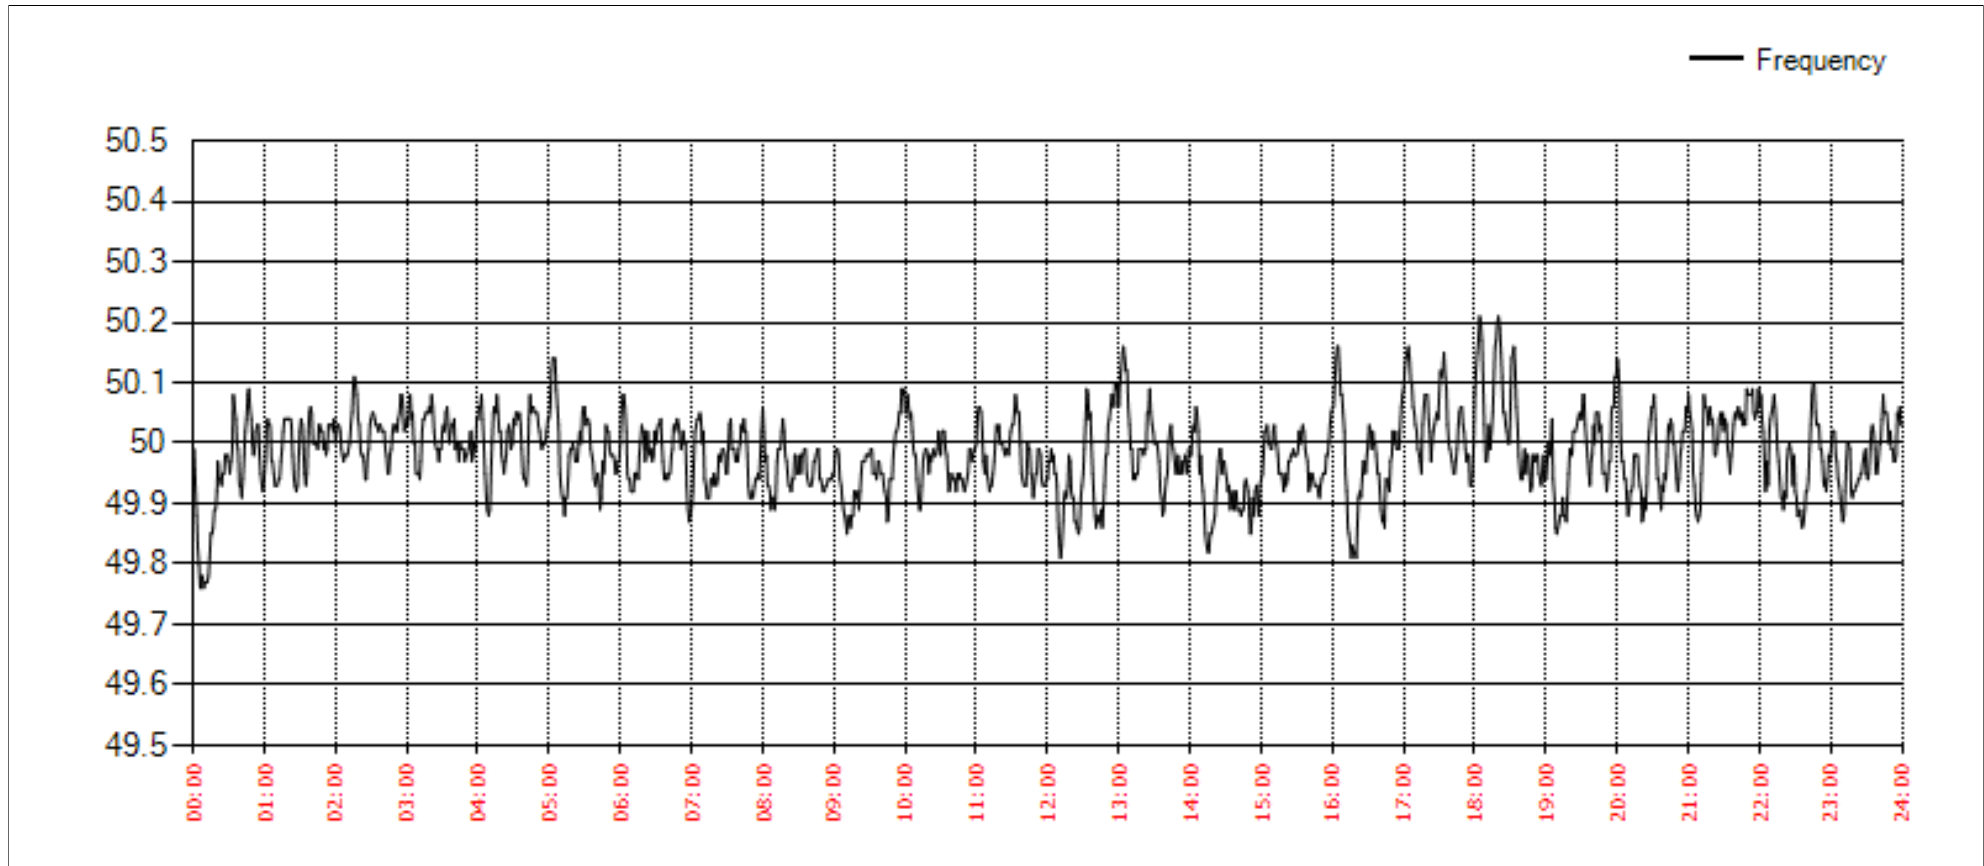

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	0	8	121	129	732	521	1151	102	160	2	1438	623
%	0.000	0.000	0.556	8.403	8.958	50.833	36.181	79.931	7.083	11.111	0.139	99.861	43.264

Average Frequency the Day:	49.98	Standard Deviation:	0.065	Frequency Deviation Index:	0.045
-----------------------------------	--------------	----------------------------	--------------	-----------------------------------	--------------

	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE		
	FREQUENCY	TIME	49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY	TIME	
MAX	50.21	18:04:00					34	MAX	50.10	18:30
MIN	49.76	00:06:00	0	0	0	0		MIN	49.82	0:15
Out of IEGC Band	% of Time		20.069					No of Hours		4.81656