




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

MPPTCL BINA:Frequency

National Grid Frequency Profile for

21-Feb-16

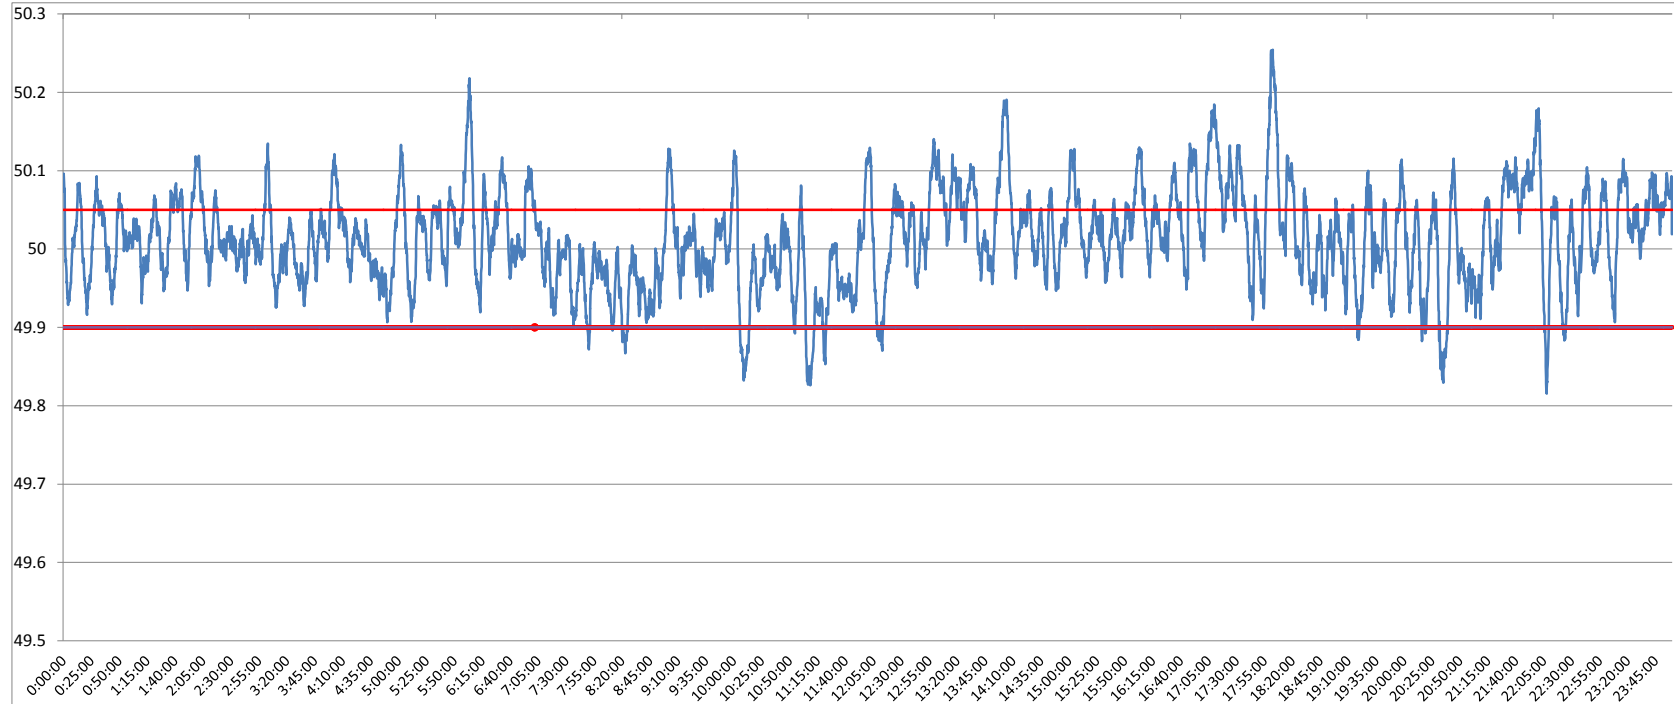

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	3.32	23.68	0.00	3.32	38.58	50.54	7.19	70.01	99.63	38.52	19.18	58.08	37.80	26.67	0.37

Average Frequency	50.01	Frequency Variation Index :	0.039	Standard Deviation :	0.061
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency	
Max	50.25 18:02:20
Min	49.82 22:07:30

15 minute average Frequency		
Max	50.119	17:15:00
Min	49.913	11:15:00

No. of excursion above 50.03 Hz	144
No. of excursion below 49.97 Hz	130
No. of excursion above 50.00 Hz	150
No. of excursion below 50.00 Hz	148

Average time freq remains below 49.97 per excursion	0:02:37	Average time frequency remains above 50.03 per excursion	0:03:47
---	---------	--	---------