




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

23-Jun-15

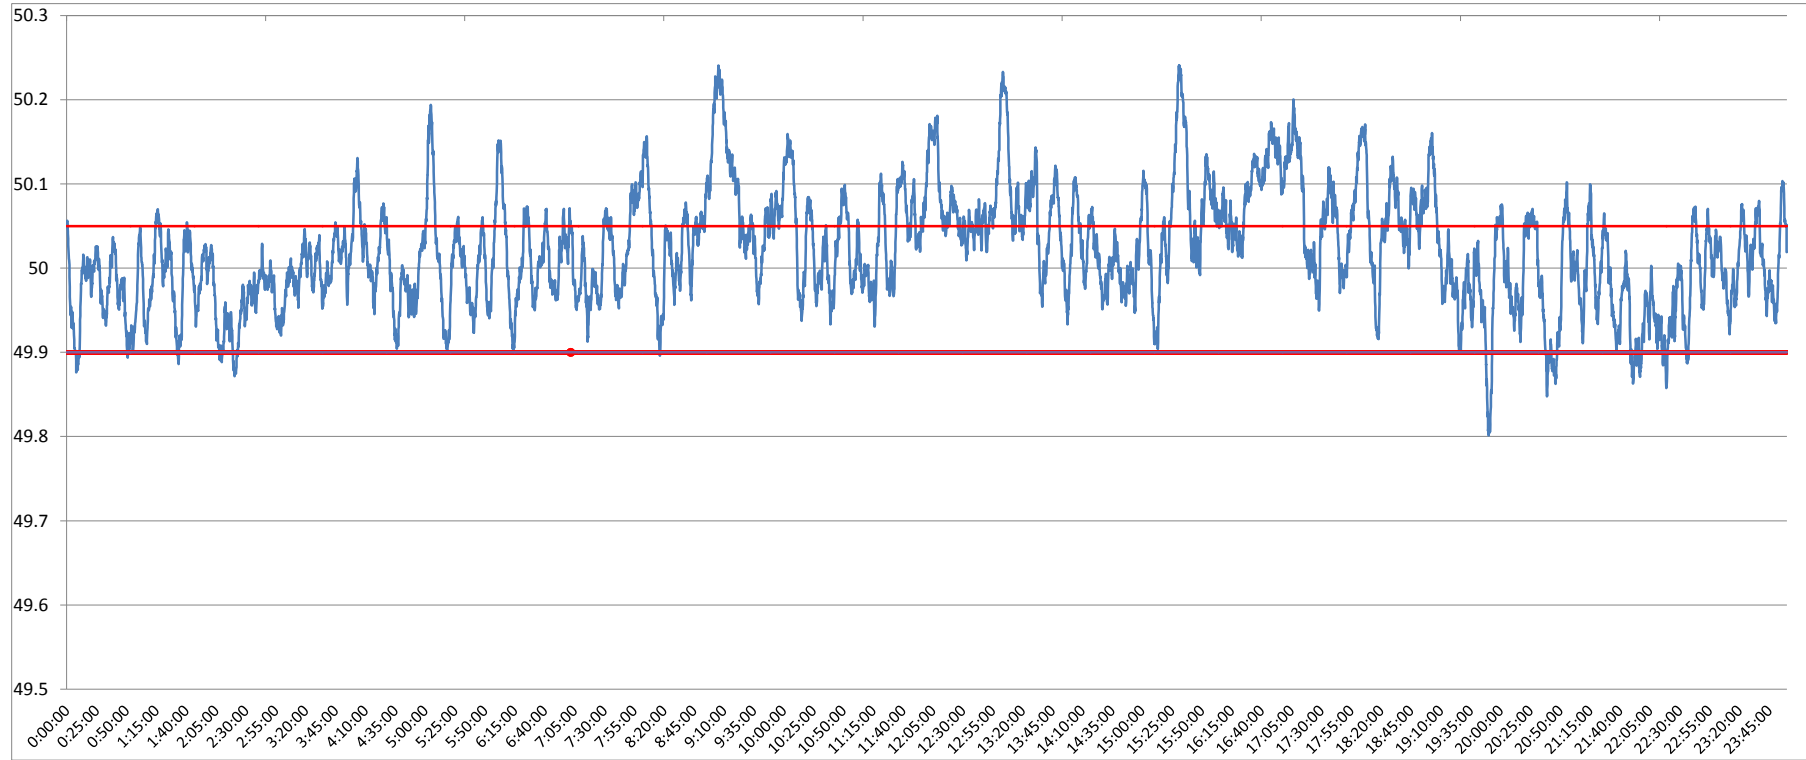

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	2.59	22.23	0.00	2.59	37.99	47.56	10.68	65.59	98.82	35.02	20.02	59.35	42.74	31.82	1.18

Average Frequency	50.02	Frequency Variation Index :	0.050	Standard Deviation :	0.067
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency	
Max	50.24 15:31:20
Min	49.80 19:50:20

15 minute average Frequency	
Max	50.188 9:15:00
Min	49.918 22:00:00

No. of excursion above 50.03 Hz	127
No. of excursion below 49.97 Hz	129
No. of excursion above 50.00 Hz	131
No. of excursion below 50.00 Hz	132

Average time freq remains below 49.97 per excursion	0:02:29	Average time frequency remains above 50.03 per excursion	0:04:51
---	---------	--	---------