




**POWER SYSTEM OPERATION CORPORATION LIMITED**  
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

23-Jul-15

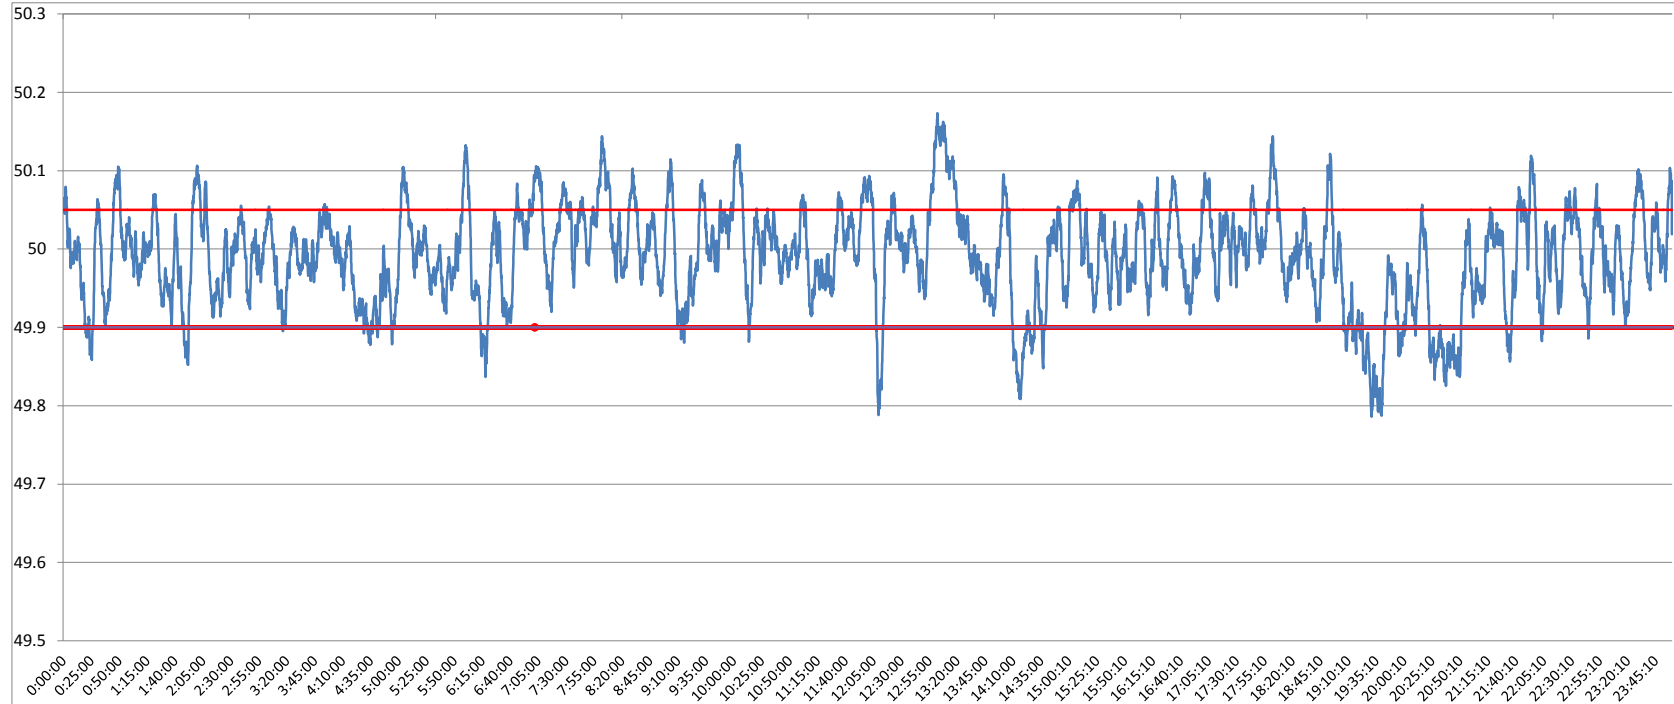

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	8.56	34.99	0.23	8.33	45.28	43.09	3.07	75.54	100.00	38.82	12.86	46.09	26.19	15.89	0.00

<b>Average Frequency</b>	<b>49.99</b>	<b>Frequency Variation Index :</b>	<b>0.040</b>	<b>Standard Deviation :</b>	<b>0.063</b>
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

<b>Instantaneous Frequency</b>	
<b>Max</b>	<b>50.17 13:02:20</b>
<b>Min</b>	<b>49.79 19:31:00</b>

<b>15 minute average Frequency</b>		
<b>Max</b>	<b>50.134</b>	<b>13:15:00</b>
<b>Min</b>	<b>49.836</b>	<b>19:45:00</b>

<b>No. of excursion above 50.03 Hz</b>	<b>135</b>
<b>No. of excursion below 49.97 Hz</b>	<b>135</b>
<b>No. of excursion above 50.00 Hz</b>	<b>161</b>
<b>No. of excursion below 50.00 Hz</b>	<b>158</b>

<b>Average time freq remains below 49.97 per excursion</b>	<b>0:03:44</b>	<b>Average time frequency remains above 50.03 per excursion</b>	<b>0:02:48</b>
--	----------------	---	----------------