




**POWER SYSTEM OPERATION CORPORATION LIMITED**

NATIONAL LOAD DESPATCH CENTRE NEW DELHI

National Grid Frequency Profile for

18-06-2014

MOHINDERGARH:Frequency

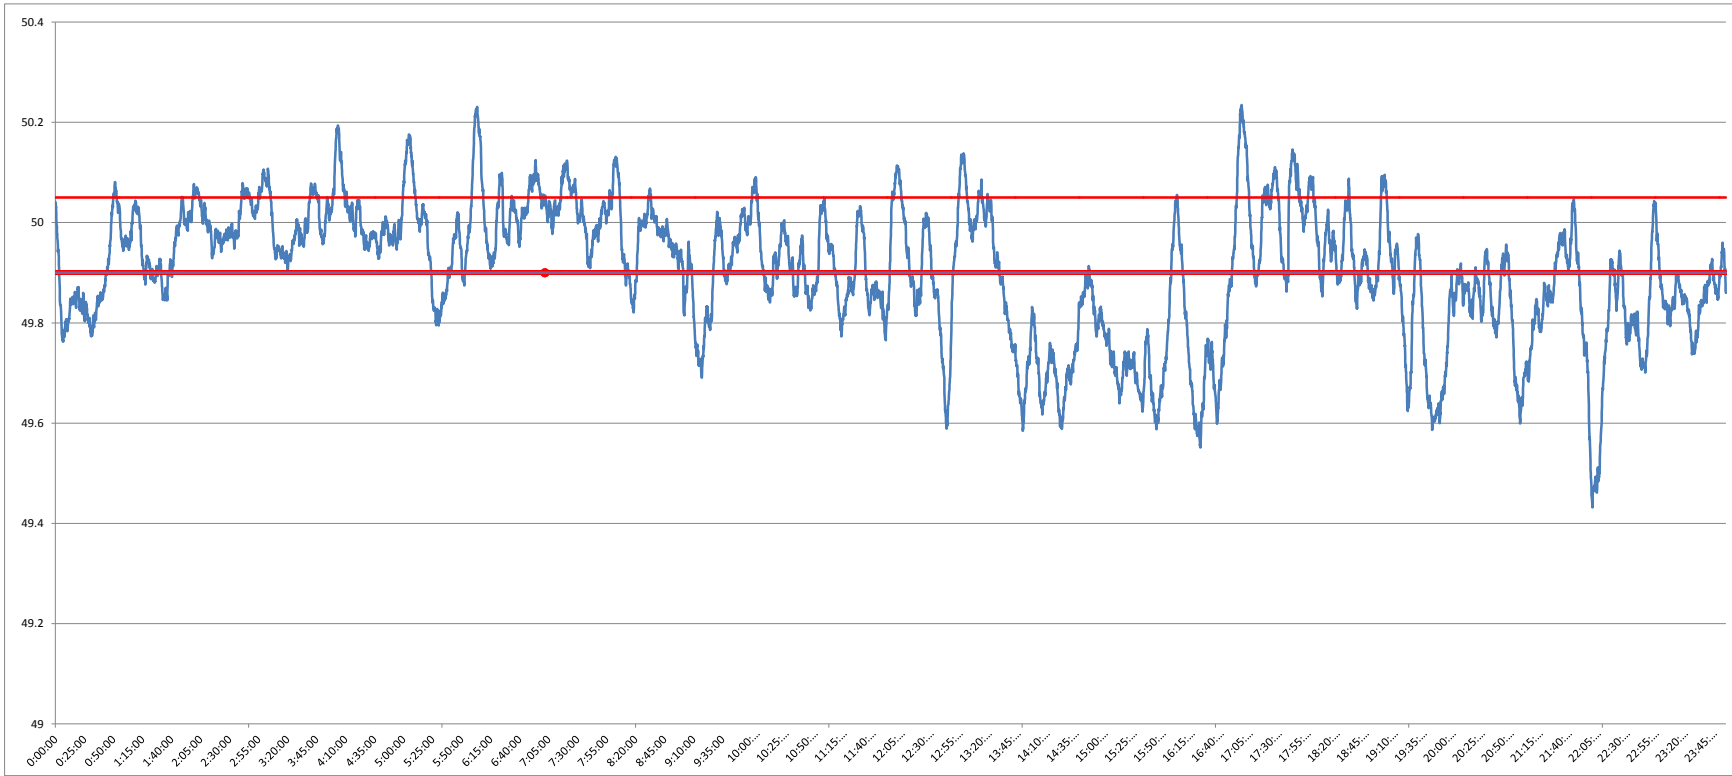

<49.2	<49.7	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	>50.2	<49.90	49.90-50.05	>50.05	50.05-50.1	49.7-50.2	49.97-50.03
0	8.74	11.08	24.73	29.54	22.21	3.28	0.43	44.57	43.92	11.50	7.82	90.84	18.95

<b>Average Frequency</b>	<b>49.91</b>	<b>Frequency Variation Index :</b>	<b>0.265</b>	<b>Standard Deviation :</b>	<b>0.132</b>
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency			15 minute average Frequency		
MAX	50.235	17:02:30	Max	50.091	4:15:00
Min	49.43	22:04:50	Min	49.551	22:15:00