




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

Frequency Analysis for

10-Apr-14

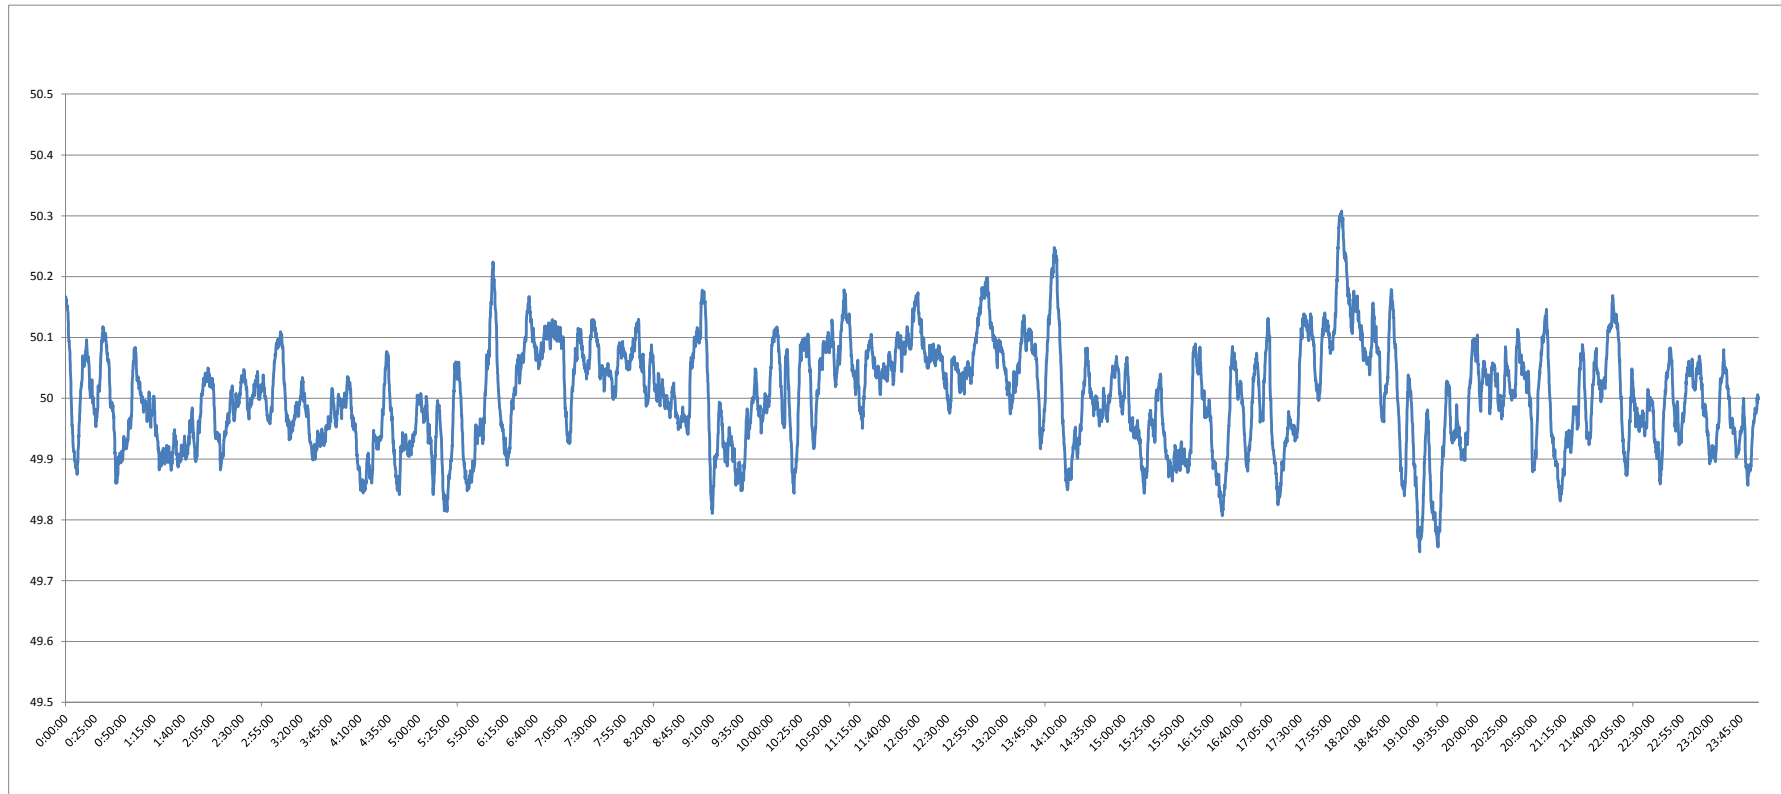

<49.2	<49.7	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	>50.2	<49.90	49.90-50.05	>50.05	50.05-50.1	49.7-50.2	49.97-50.03
0	0.00	0.58	11.05	37.13	39.42	10.84	0.98	11.63	58.03	30.34	18.55	99.02	24.79

Average Frequency	50.00	Frequency Variation Index :	0.070	Standard Deviation :	0.084
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency			15 minute average Frequency		
MAX	50.31	18:05:30	Max	50.214	18:15:00
Min	49.75	19:11:50	Min	49.850	19:30:00