




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DADRI:Frequency

National Grid Frequency Profile for

09-Jan-15

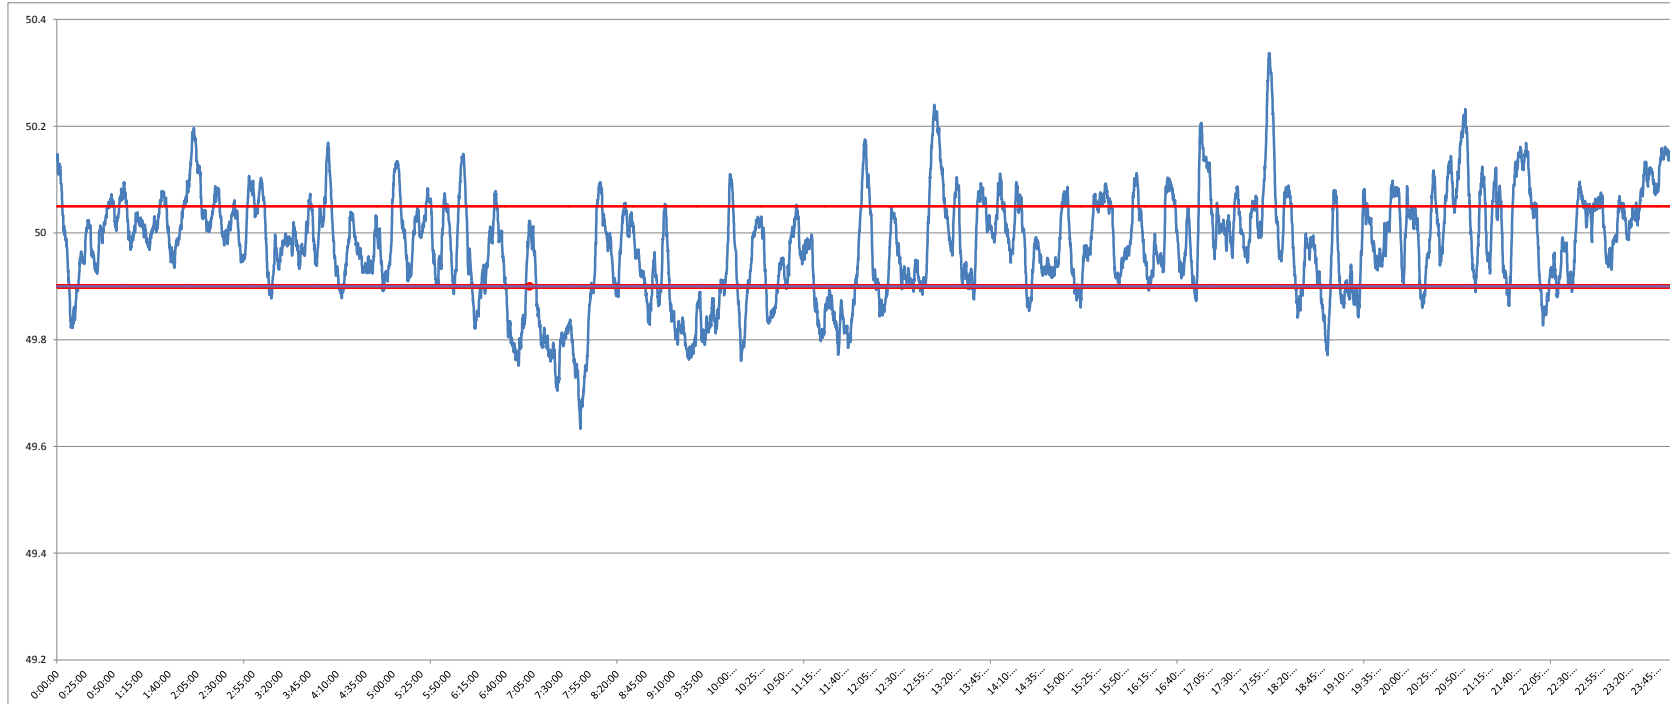

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.30	20.19	45.29	3.94	15.95	37.13	34.51	7.19	56.82	98.72	24.13	14.88	42.65	30.58	23.00	0.98

Average Frequency	49.98	Frequency Variation Index :	0.098	Standard Deviation :	0.096
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
MAX	50.34	18:02:00
Min	49.63	7:47:20

15 minute average Frequency		
Max	50.145	13:15:00
Min	49.768	7:30:00

No. of excursion above 50.03 Hz	109
No. of excursion below 49.97 Hz	99
No. of excursion above 50.00 Hz	98
No. of excursion below 50.00 Hz	97

Average time freq remains below 49.97 per excursion	0:06:35	Average time frequency remains above 50.03 per excursion	0:04:02
--	----------------	---	----------------