




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

24-Jan-15

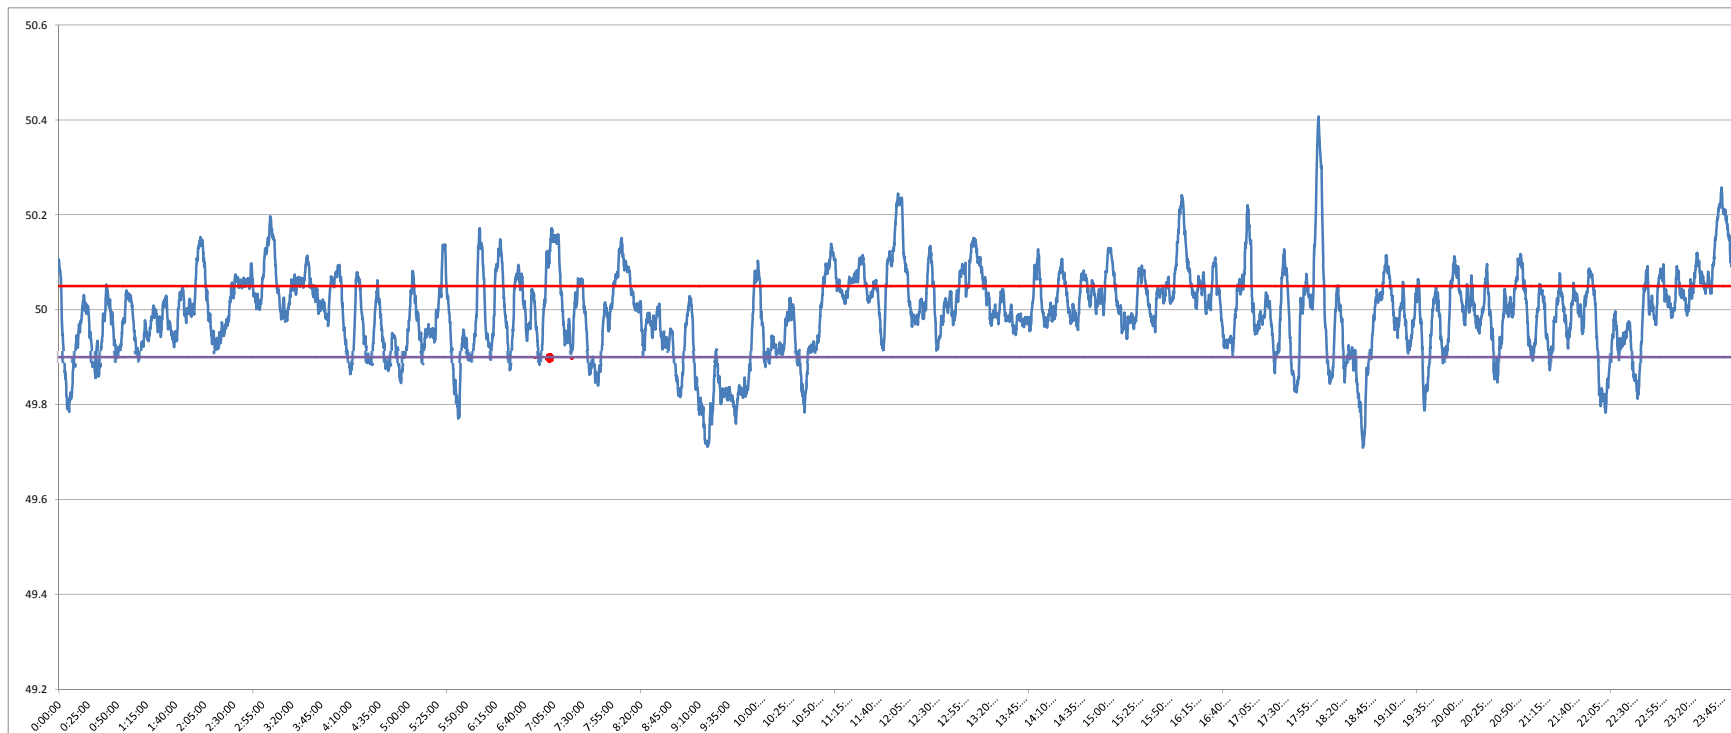

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	13.68	35.51	1.77	11.91	36.82	40.51	7.41	61.05	98.41	29.73	16.30	49.43	34.76	25.27	1.59

Average Frequency	49.99	Frequency Variation Index :	0.079	Standard Deviation :	0.088
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
MAX	50.41	18:02:40
Min	49.71	18:40:50

15 minute average Frequency		
Max	50.176	0:00:00
Min	49.802	9:30:00

No. of excursion above 50.03 Hz	118
No. of excursion below 49.97 Hz	106
No. of excursion above 50.00 Hz	121
No. of excursion below 50.00 Hz	124

Average time freq remains below 49.97 per excursion	0:04:49	Average time frequency remains above 50.03 per excursion	0:04:14
------------------------------------------------------------	----------------	-----------------------------------------------------------------	----------------