




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

28-Jan-15

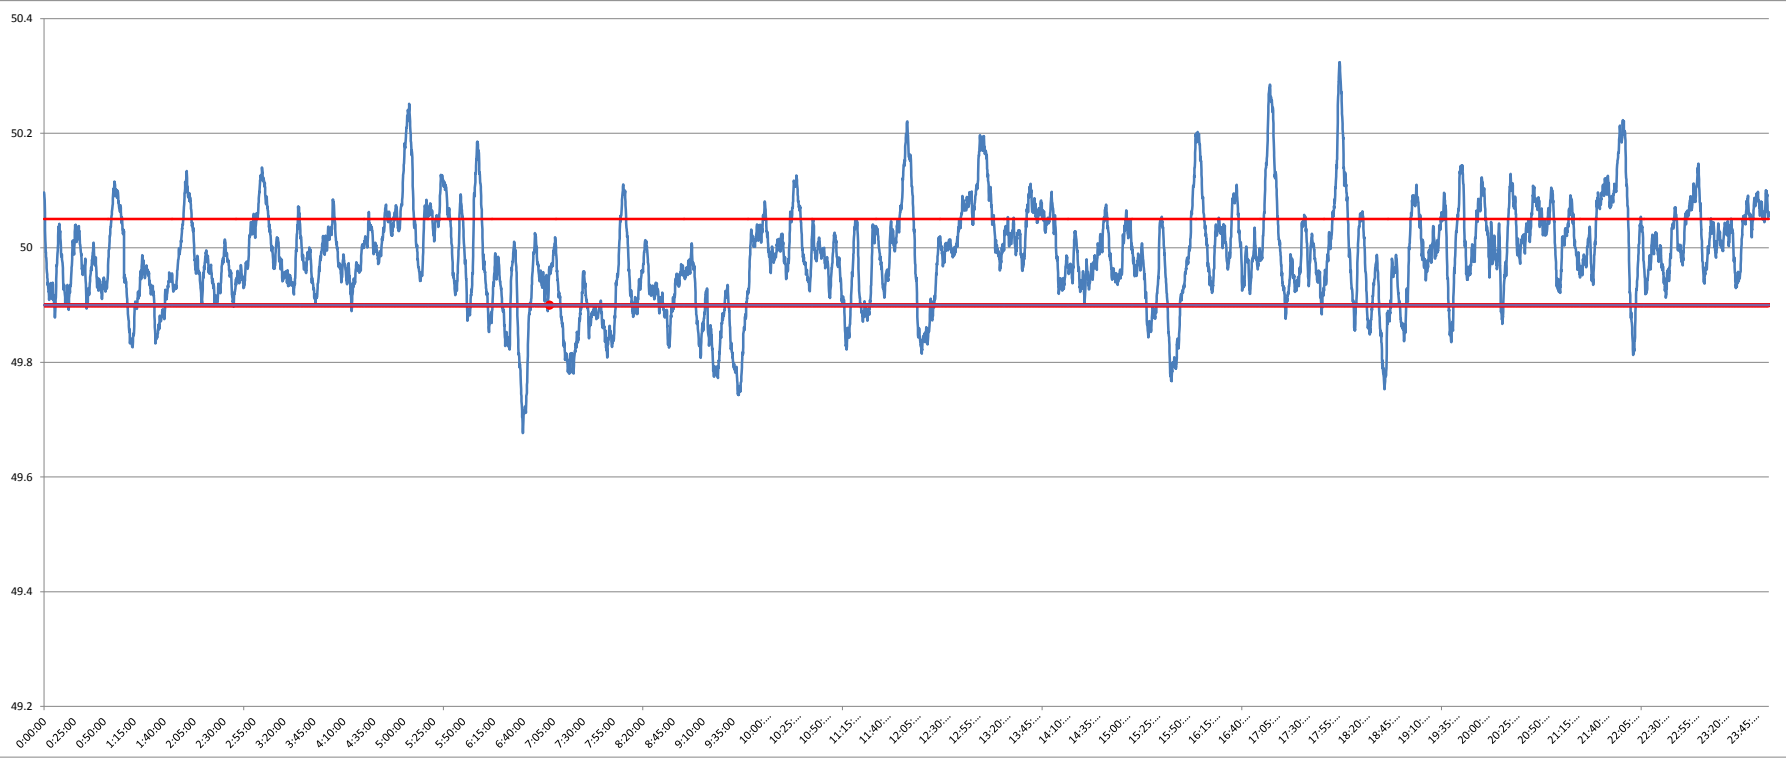

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.06	14.70	42.86	2.09	12.55	42.91	35.03	6.19	64.14	98.77	27.99	13.82	42.35	29.16	21.16	1.17

Average Frequency	49.99	Frequency Variation Index :	0.076	Standard Deviation :	0.086
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency	
MAX	50.32 18:01:40
Min	49.68 6:39:40

15 minute average Frequency	
Max	50.139 22:00:00
Min	49.816 9:45:00

No. of excursion above 50.03 Hz	110
No. of excursion below 49.97 Hz	121
No. of excursion above 50.00 Hz	117
No. of excursion below 50.00 Hz	117

Average time freq remains below 49.97 per excursion	0:05:06	Average time frequency remains above 50.03 per excursion	0:03:49
--	----------------	---	----------------