




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

MPPTCL BINA:Frequency

National Grid Frequency Profile for

25-Jul-14

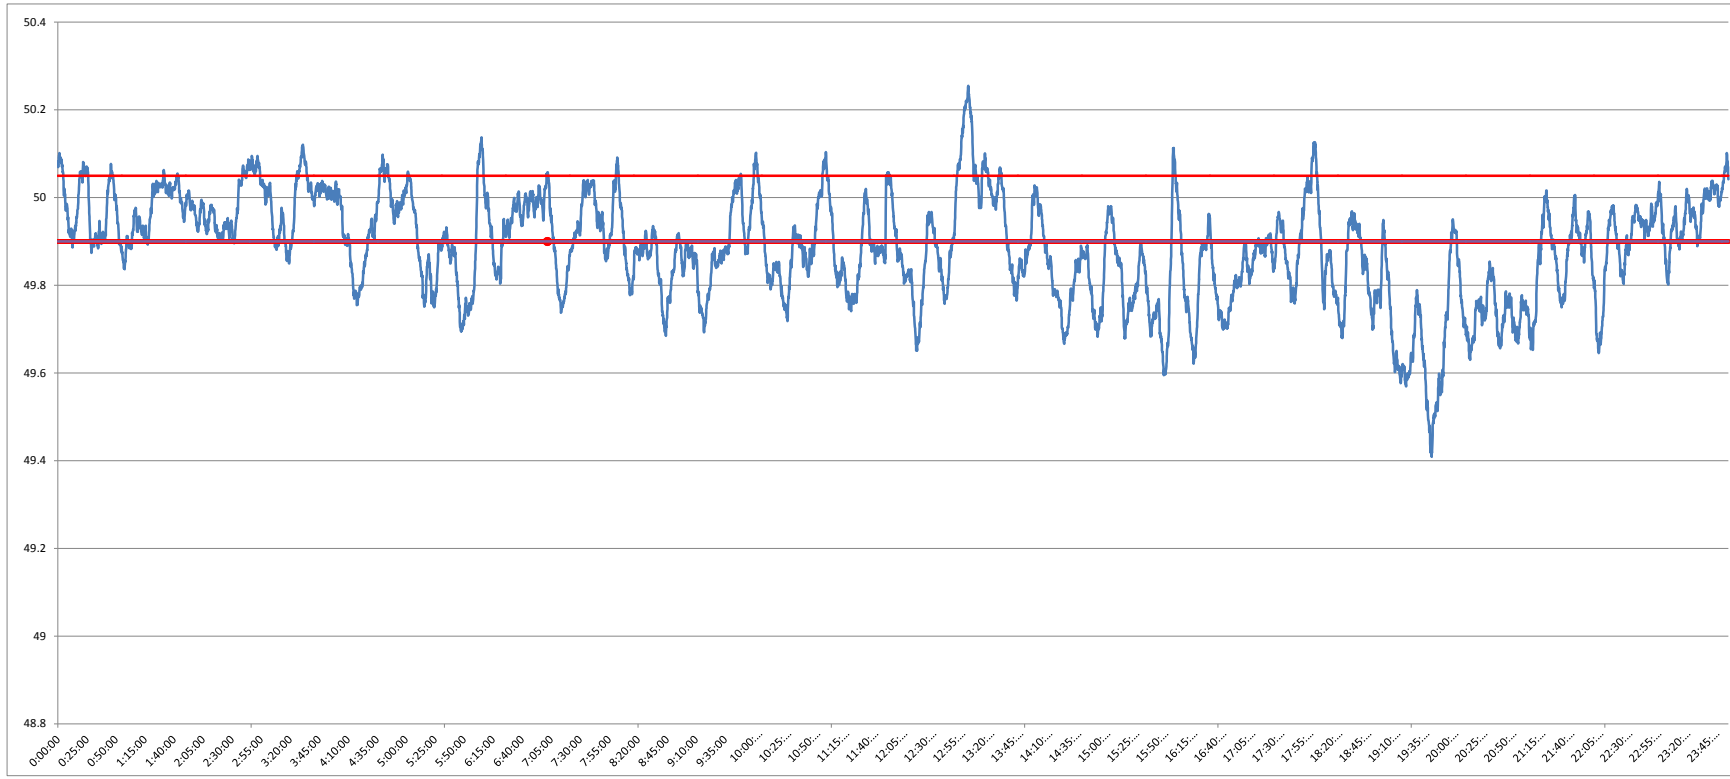

<49.2	<49.7	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	>50.2	<49.90	49.90-50.05	>50.05	50.05-50.1	49.7-50.2	49.97-50.03
0	6.60	17.34	28.34	28.62	17.78	0.95	0.37	52.30	40.98	6.71	5.43	93.03	15.88

Average Frequency		49.89	Frequency Variation Index :		0.274	Standard Deviation :		0.120
--------------------------	--	--------------	------------------------------------	--	--------------	-----------------------------	--	--------------

Instantaneous Frequency			15 minute average Frequency		
MAX	50.255	13:04:40	Max	50.133	13:15:00
Min	49.41	19:44:00	Min	49.613	19:45:00

