




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

MPPTCL BINA:Frequency

National Grid Frequency Profile for 16/06/2014

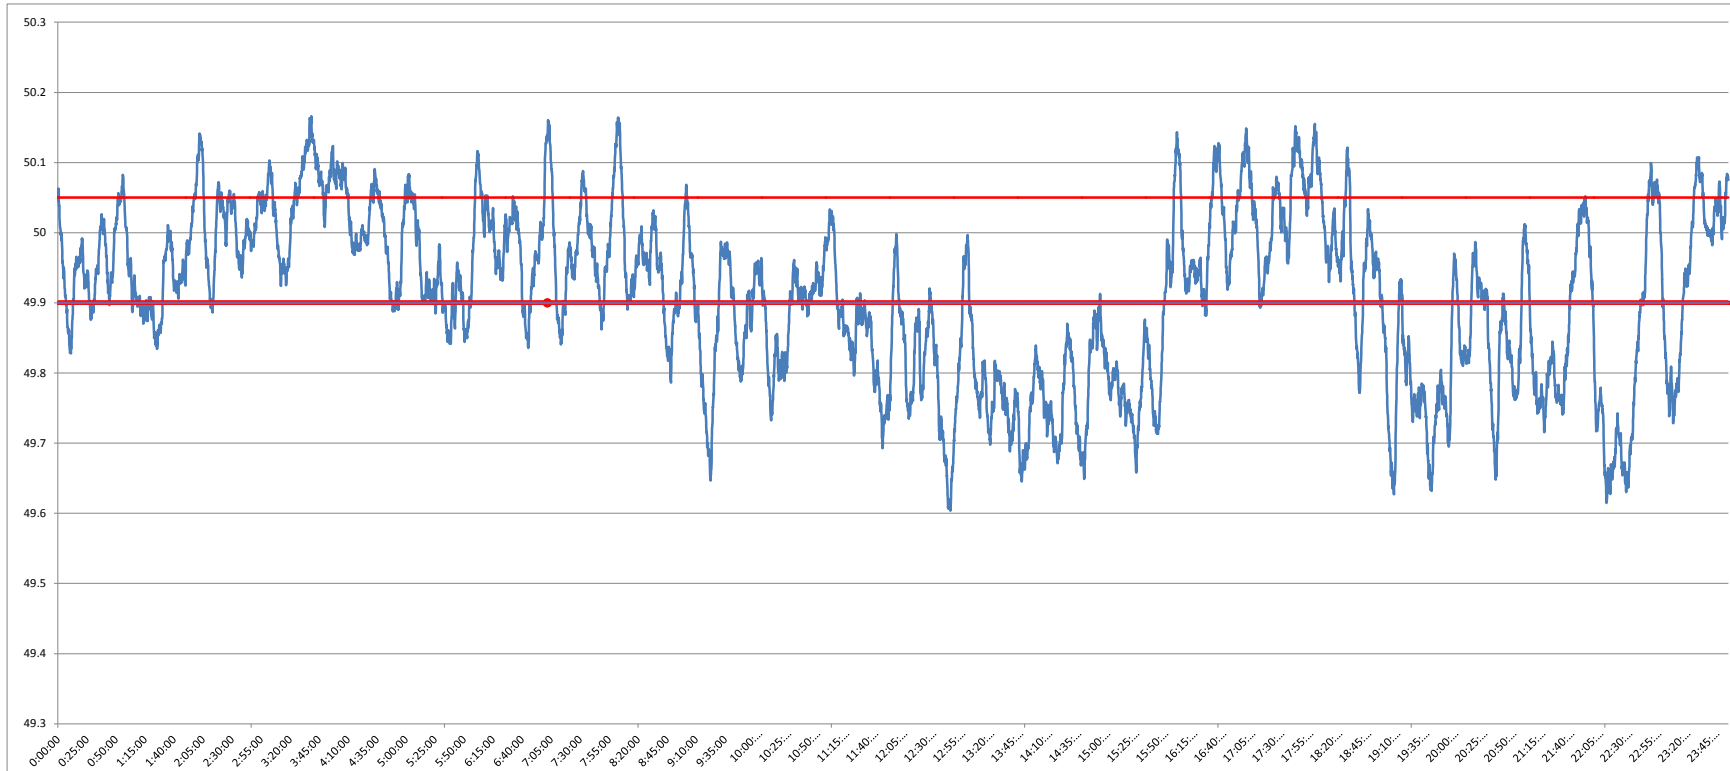

<49.2	<49.7	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	>50.2	<49.90	49.90-50.05	>50.05	50.05-50.1	49.7-50.2	49.97-50.03
0	4.66	16.85	21.03	31.66	21.83	3.97	0.00	42.55	44.26	13.19	9.24	95.34	16.34

Average Frequency		49.91	Frequency Variation Index :	0.224	Standard Deviation :	0.120
--------------------------	--	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency			15 minute average Frequency		
MAX	50.166	3:38:30	Max	50.118	3:45:00
Min	49.60	12:49:20	Min	49.675	22:30:00

