




**POWER SYSTEM OPERATION CORPORATION LIMITED**  
 NATIONAL LOAD DESPATCH CENTRE NEW DELHI

MPPTCL BINA:Frequency

National Grid Frequency Profile for

26-Sep-14

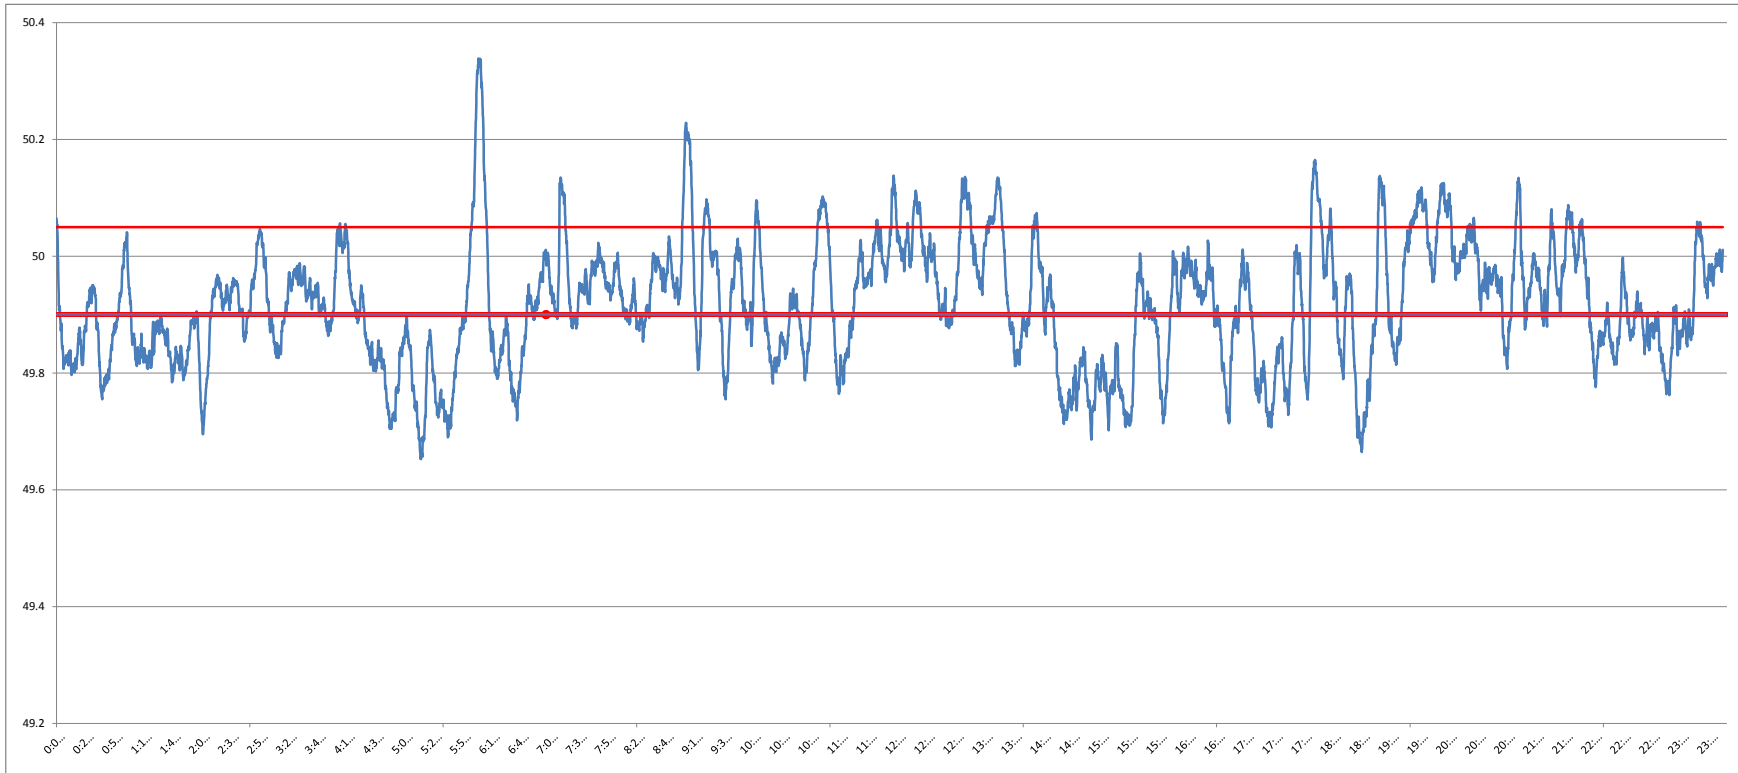

<49.2	<49.7	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	>50.2	<49.90	49.90-50.05	>50.05	50.05-50.1	49.7-50.2	49.97-50.03
0	0.79	12.66	31.47	35.14	16.15	3.09	0.71	44.92	45.15	9.93	6.15	98.50	16.78

<b>Average Frequency</b>	<b>49.92</b>	<b>Frequency Variation Index :</b>	<b>0.178</b>	<b>Standard Deviation :</b>	<b>0.104</b>
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency			15 minute average Frequency		
MAX	50.339	6:03:40	Max	141.911	0:00:00
Min	49.65	5:14:10	Min	49.746	5:45:00

