


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 28-09-2015

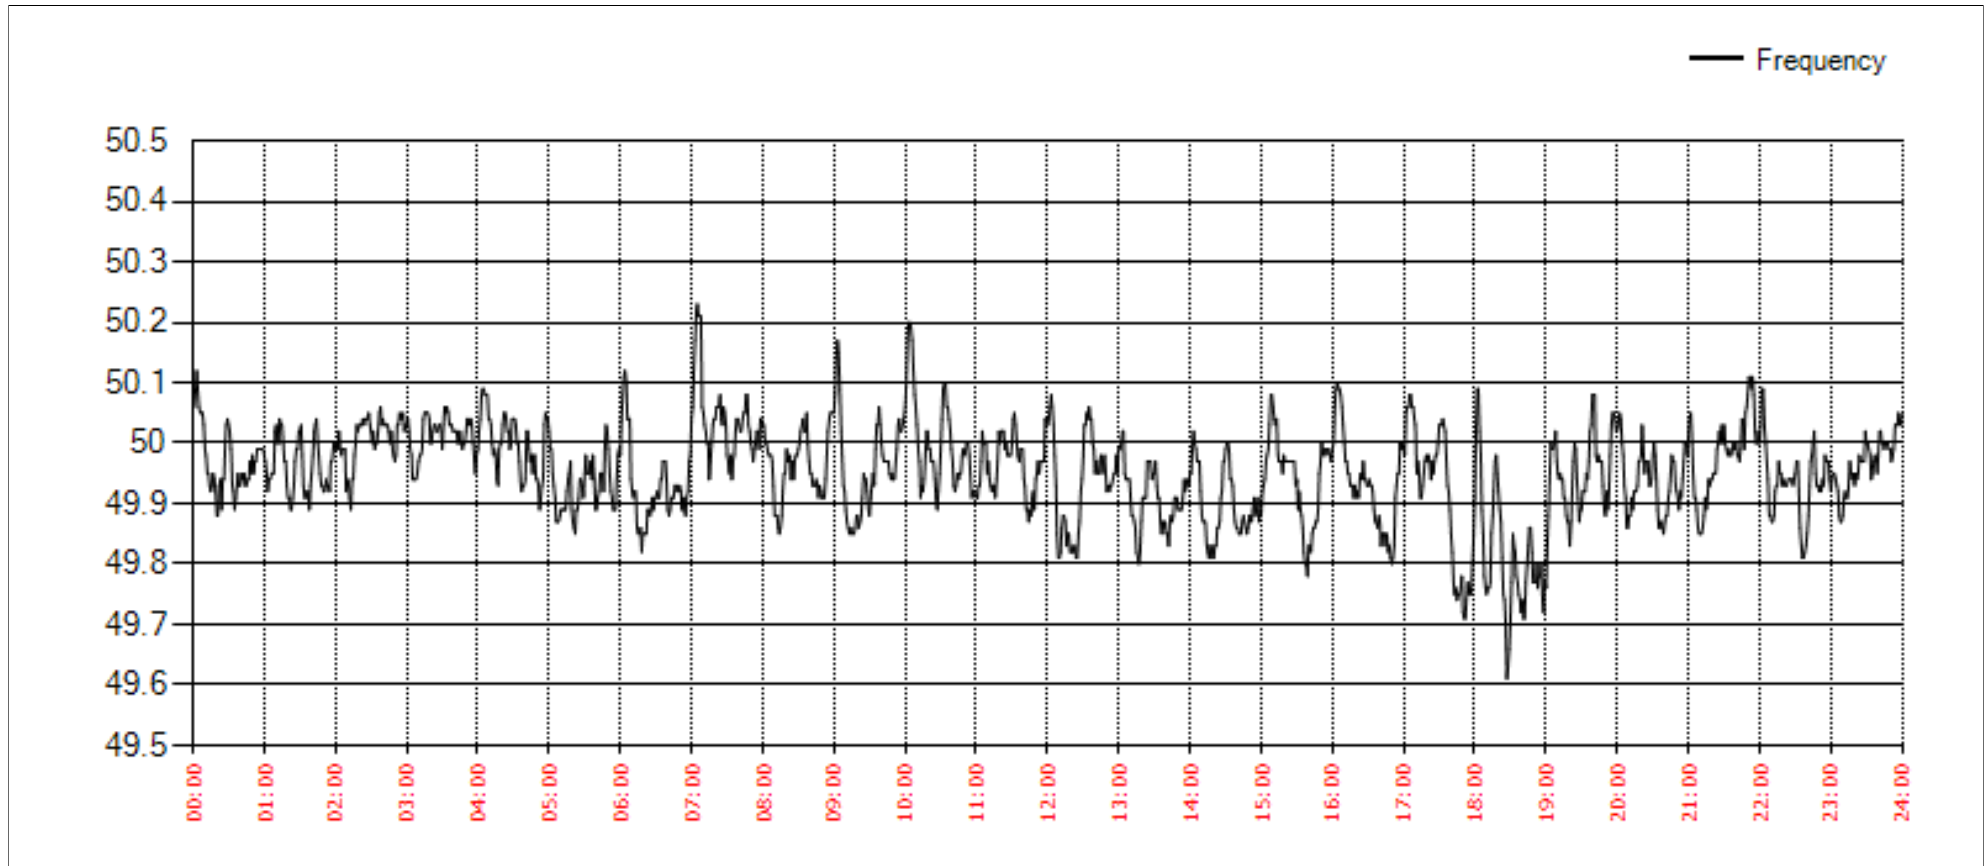

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	3	47	271	321	702	390	1030	97	89	5	1432	520
%	0.000	0.208	3.264	18.819	22.292	48.750	27.083	71.528	6.736	6.181	0.347	99.444	36.111

Average Frequency the Day:			49.95	Standard Deviation:			0.079	Frequency Deviation Index:			0.085
----------------------------	--	--	-------	---------------------	--	--	-------	----------------------------	--	--	-------

	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE		
	FREQUENCY	TIME	49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY	TIME	
MAX	50.23	07:05:00				1	49	MAX	50.10	7:15
MIN	49.61	18:27:00	0	0	0			MIN	49.77	18:00
Out of IEGC Band		% of Time	28.472					No of Hours		6.83328