




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

09-May-16

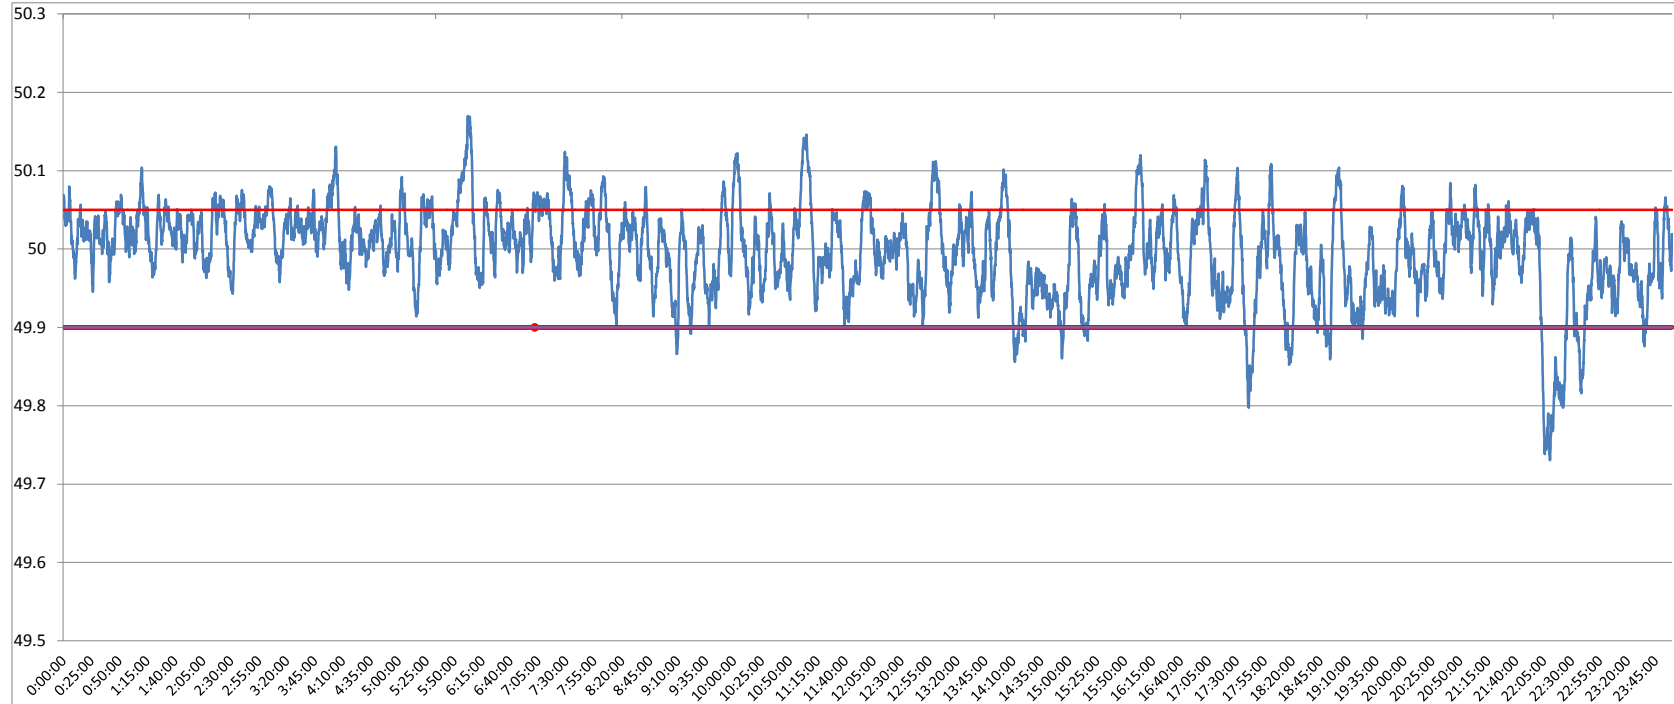

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	4.75	29.63	0.66	4.09	43.48	49.72	2.05	81.18	100.00	41.81	12.14	51.69	28.56	14.07	0.00

Average Frequency	50.00	Frequency Variation Index :	0.033	Standard Deviation :	0.057
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
Max	50.17	6:02:00
Min	49.73	22:10:30

15 minute average Frequency		
Max	50.058	11:15:00
Min	49.819	22:15:00

No. of excursion above 50.03 Hz	188
No. of excursion below 49.97 Hz	152
No. of excursion above 50.00 Hz	165
No. of excursion below 50.00 Hz	163

Average time freq remains below 49.97 per excursion	0:02:48	Average time frequency remains above 50.03 per excursion	0:02:11
---	---------	--	---------