




DADRI:Frequency

National Grid Frequency Profile for 3-Jan-2018

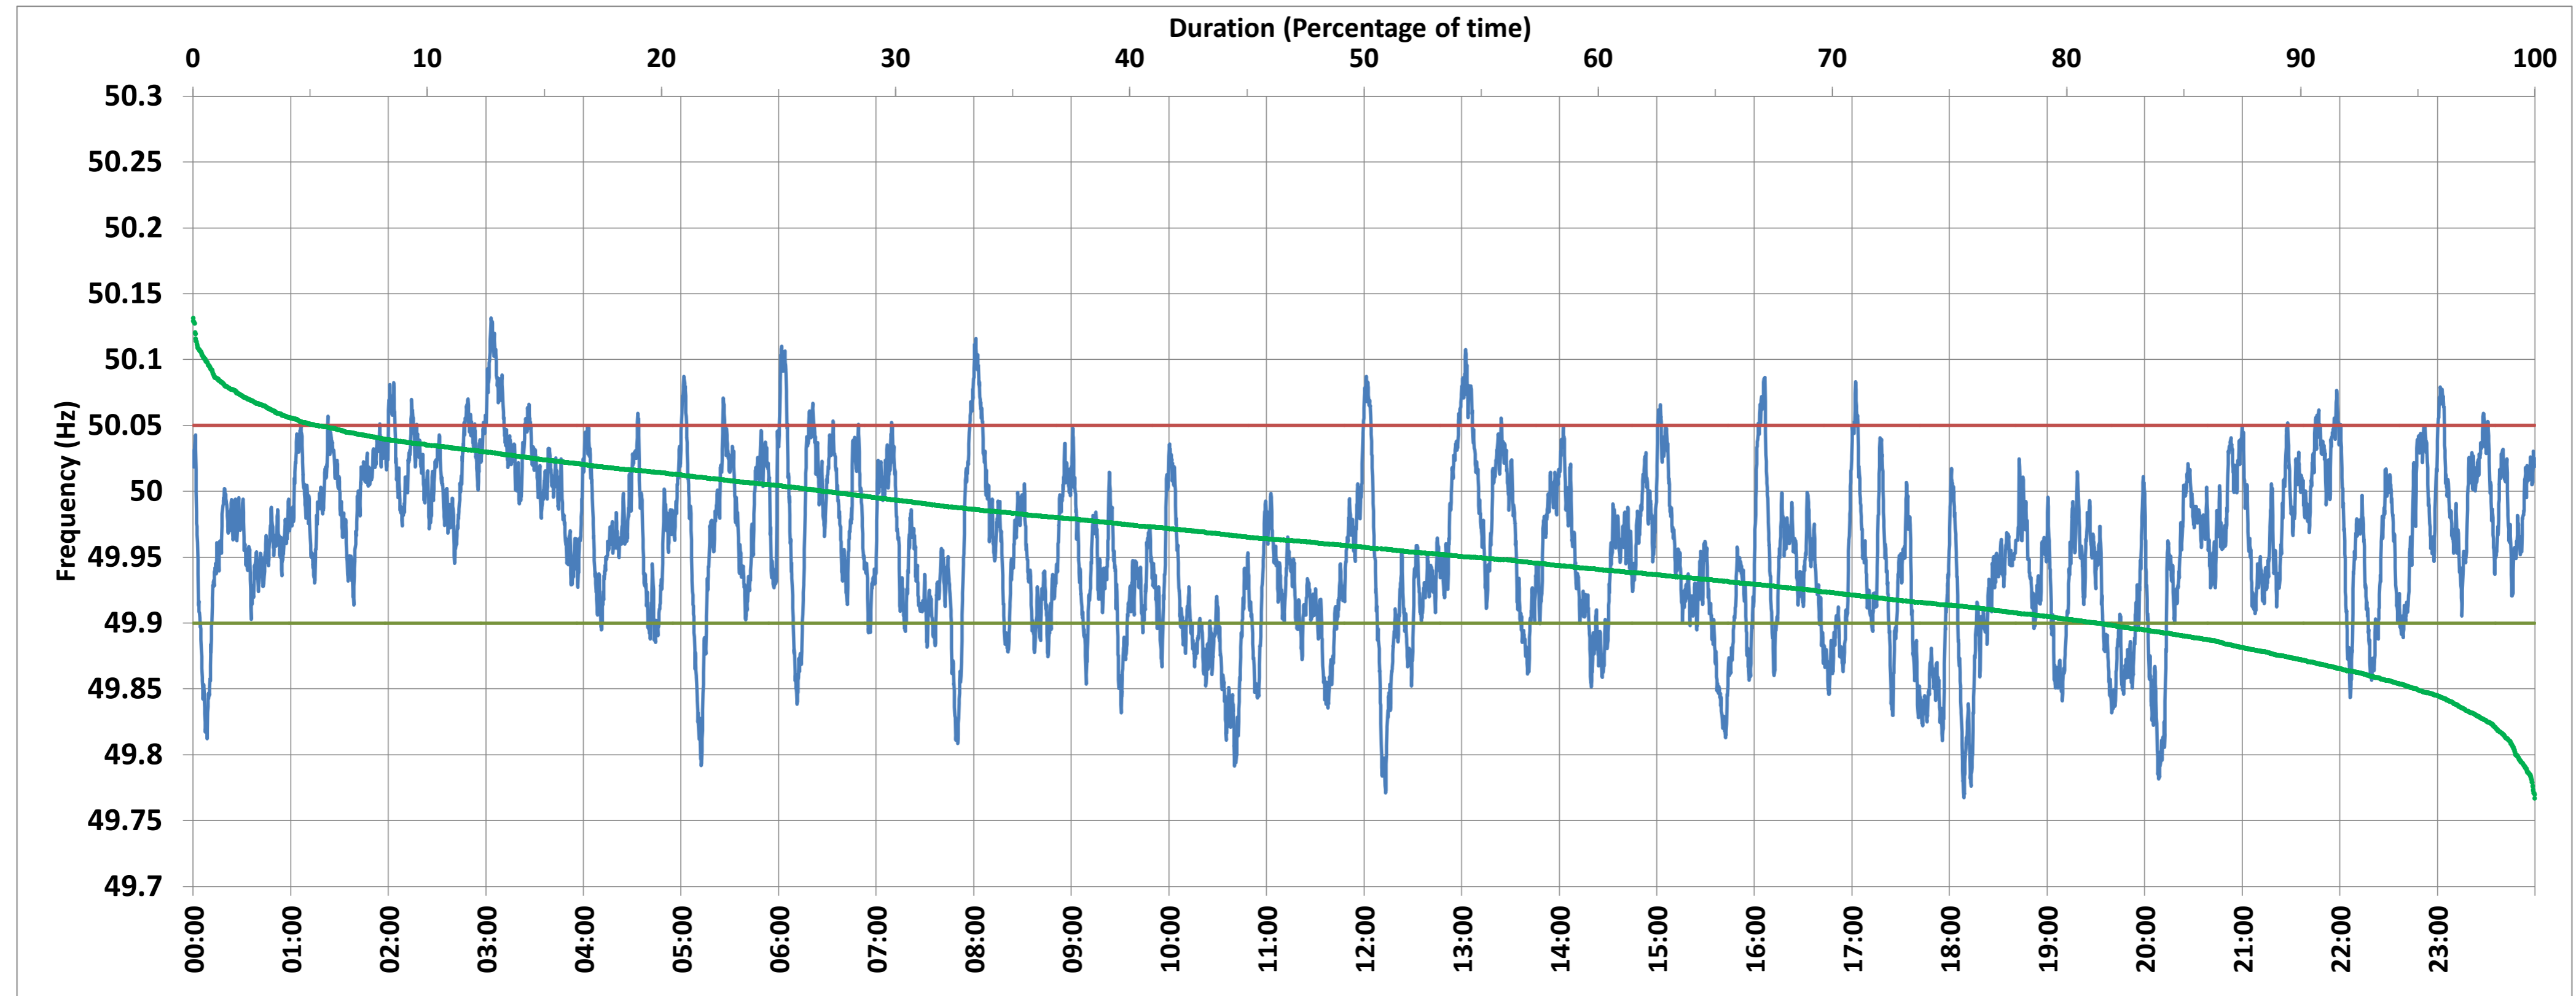

<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0.00	18.62	57.28	0.81	17.81	54.28	26.56	0.53	76.08	100.00	30.21	4.83	27.03	12.51	5.30	0.00

Average Frequency :	49.956	Frequency Variation Index :	0.058	Standard Deviation :	0.062
---------------------	--------	-----------------------------	-------	----------------------	-------

Instantaneous Frequency		
Max	50.132	3:03:10
Min	49.767	18:08:40

15 minute Average Frequency		
Max	50.077	3:15:00
Min	49.843	10:45:00

No. of excursions above 50.03 Hz	98
No. of excursions below 49.97 Hz	123
No. of excursions above 50.00 Hz	106
No. of excursions below 50.00 Hz	104

Average time freq remains below 49.97 per excursion	0:06:42	Average time frequency remains above 50.03 per excursion	0:01:50
---	---------	--	---------