




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

03-Jun-17

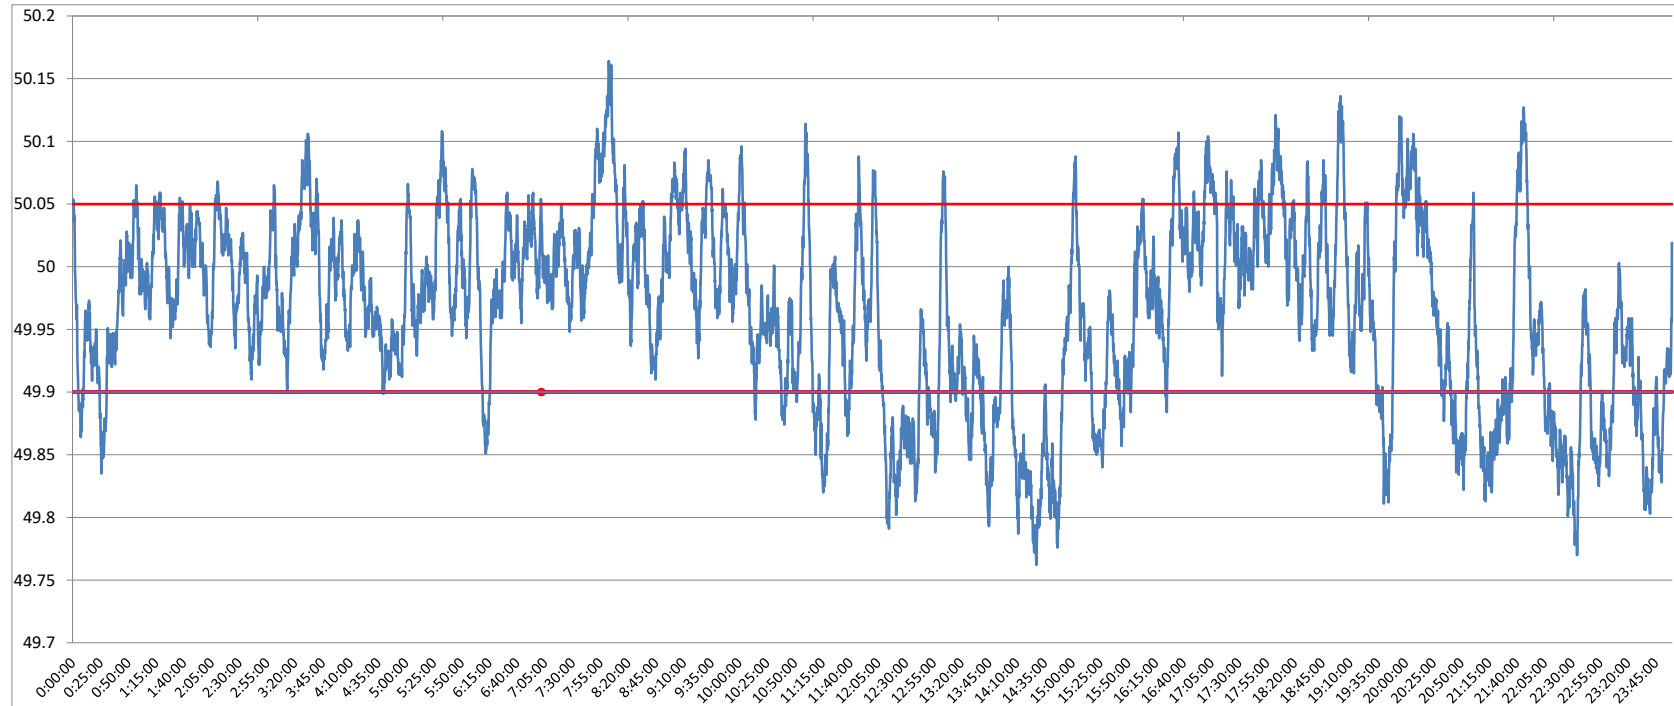

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	21.19	49.72	0.90	20.29	43.24	33.87	1.70	67.08	100.00	29.97	10.45	34.50	20.31	11.72	0.00

Average Frequency	49.96	Frequency Variation Index :	0.067	Standard Deviation :	0.074
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
Max	50.16	8:02:40
Min	49.76	14:27:30

15 minute average Frequency		
Max	50.076	8:15:00
Min	49.813	14:30:00

No. of excursion above 50.03 Hz	103
No. of excursion below 49.97 Hz	104
No. of excursion above 50.00 Hz	99
No. of excursion below 50.00 Hz	90

Average time freq remains below 49.97 per excursion	0:06:53	Average time frequency remains above 50.03 per excursion	0:02:50
---	---------	--	---------