




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

HISSAR:Frequency

National Grid Frequency Profile for

02-May-17

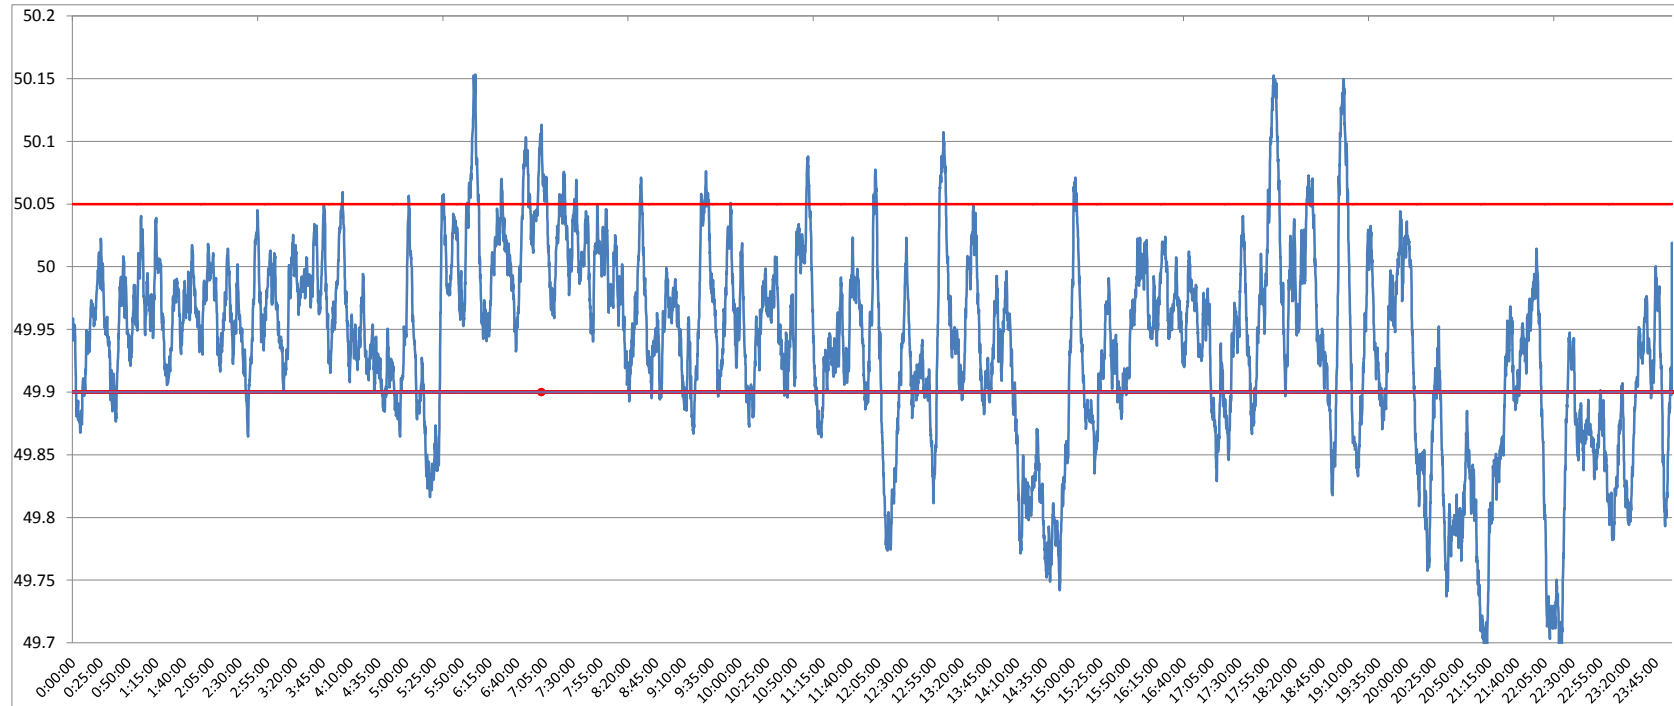

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.13	25.59	64.17	5.27	20.20	54.75	18.48	1.18	69.16	99.87	26.57	4.13	19.64	9.26	5.25	0.00

Average Frequency	49.94	Frequency Variation Index :	0.095	Standard Deviation :	0.076
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
Max	50.15	6:02:30
Min	49.69	21:11:40

15 minute average Frequency		
Max	50.056	7:00:00
Min	49.748	21:15:00

No. of excursion above 50.03 Hz	55
No. of excursion below 49.97 Hz	135
No. of excursion above 50.00 Hz	94
No. of excursion below 50.00 Hz	93

Average time freq remains below 49.97 per excursion	0:06:51	Average time frequency remains above 50.03 per excursion	0:02:25
--	----------------	---	----------------